
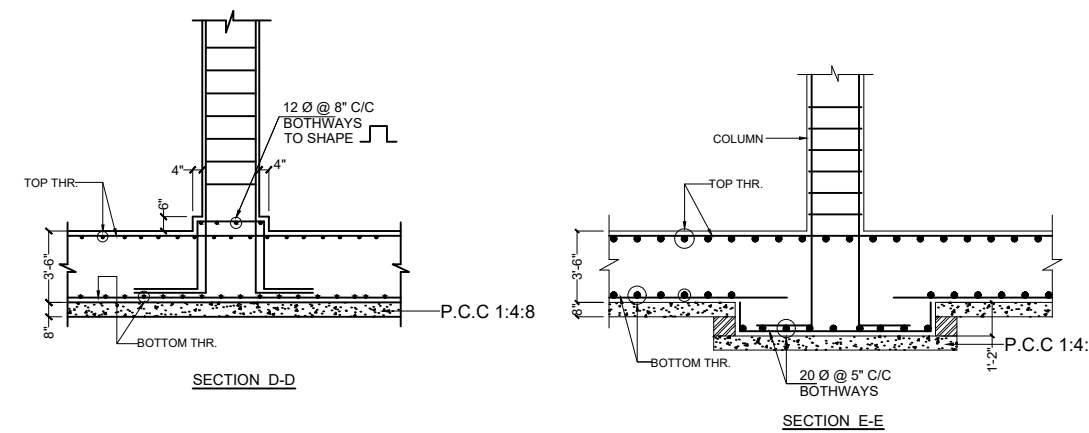
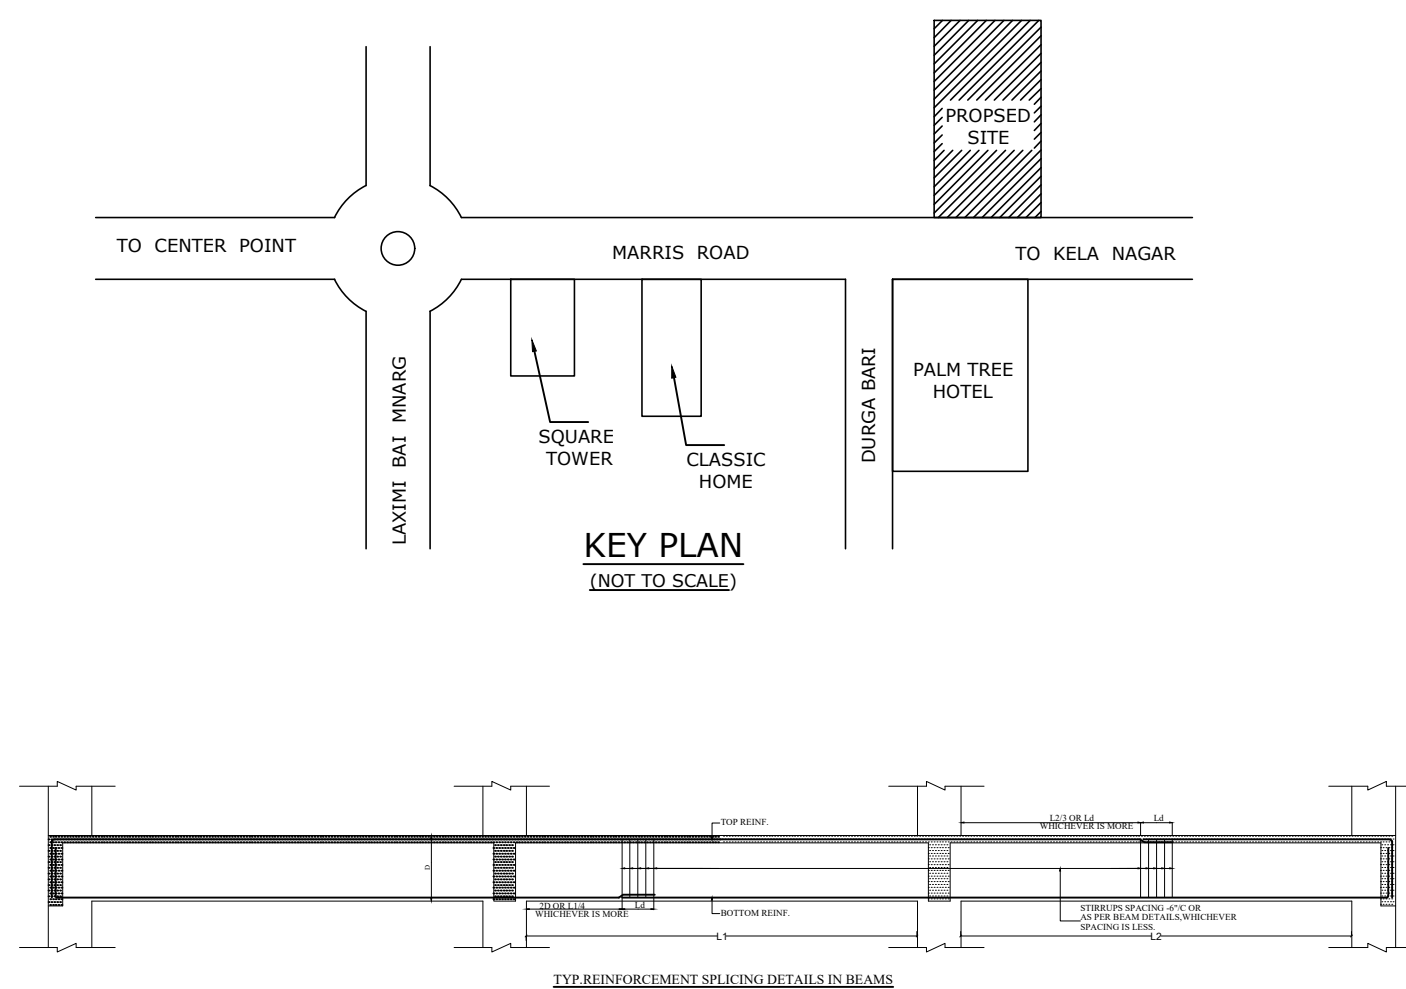


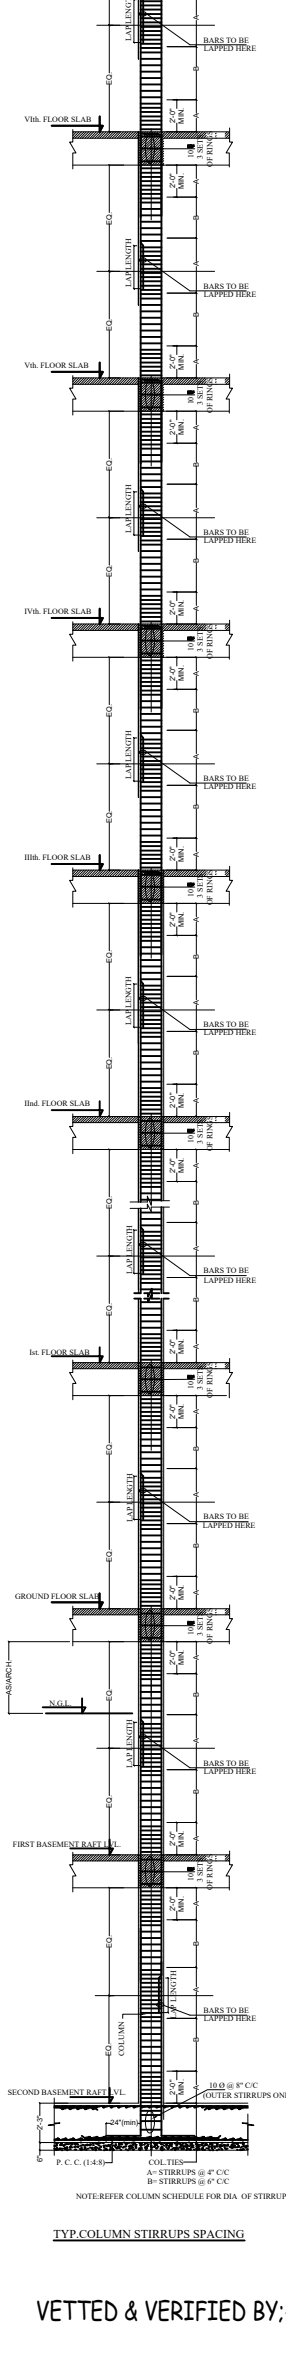

A. GENERAL		B. REINFORCEMENT SCHEDULE FOR RAFT SLAB		
1.	RAFT THICKNESS = 2'-0"	DN.	MARKED	REINFORCEMENT
2.	GRADE OF CONC. = M-25	1.	A.	14 @ 8" C/C
3.	14 @ 12" C/C TO SHAPE TO BE USED TO HOLD TOP REIN. OF RAFT SLAB	2.	B.	20 @ 8" C/C

VETTED & VERIFIED BY:

1. FOUNDATIONS & COLUMNS HAVE BEEN DESIGNED FOR NINE FLOORS (B-8)
2. SAFE BEARING CAPACITY OF SOIL HAS BEEN TAKEN AS 206 KN/SQ.M. AT 3.0 M DEPTH AS PER SOIL TESTING REPORT PROVIDED.
3. PROVIDE HORIZONTAL WATER BAR IN RAFT WHEREVER CASTING IN BALANCE PORTION IS DONE AFTER 7 DAYS.
4. USE EPOXY BASED COMPOUND FOR BONDING OF OLD CONC. & NEW CONC. AT EVERY CONSTRUCTION JOINT.