


Completion Drawing

Hindrance Box

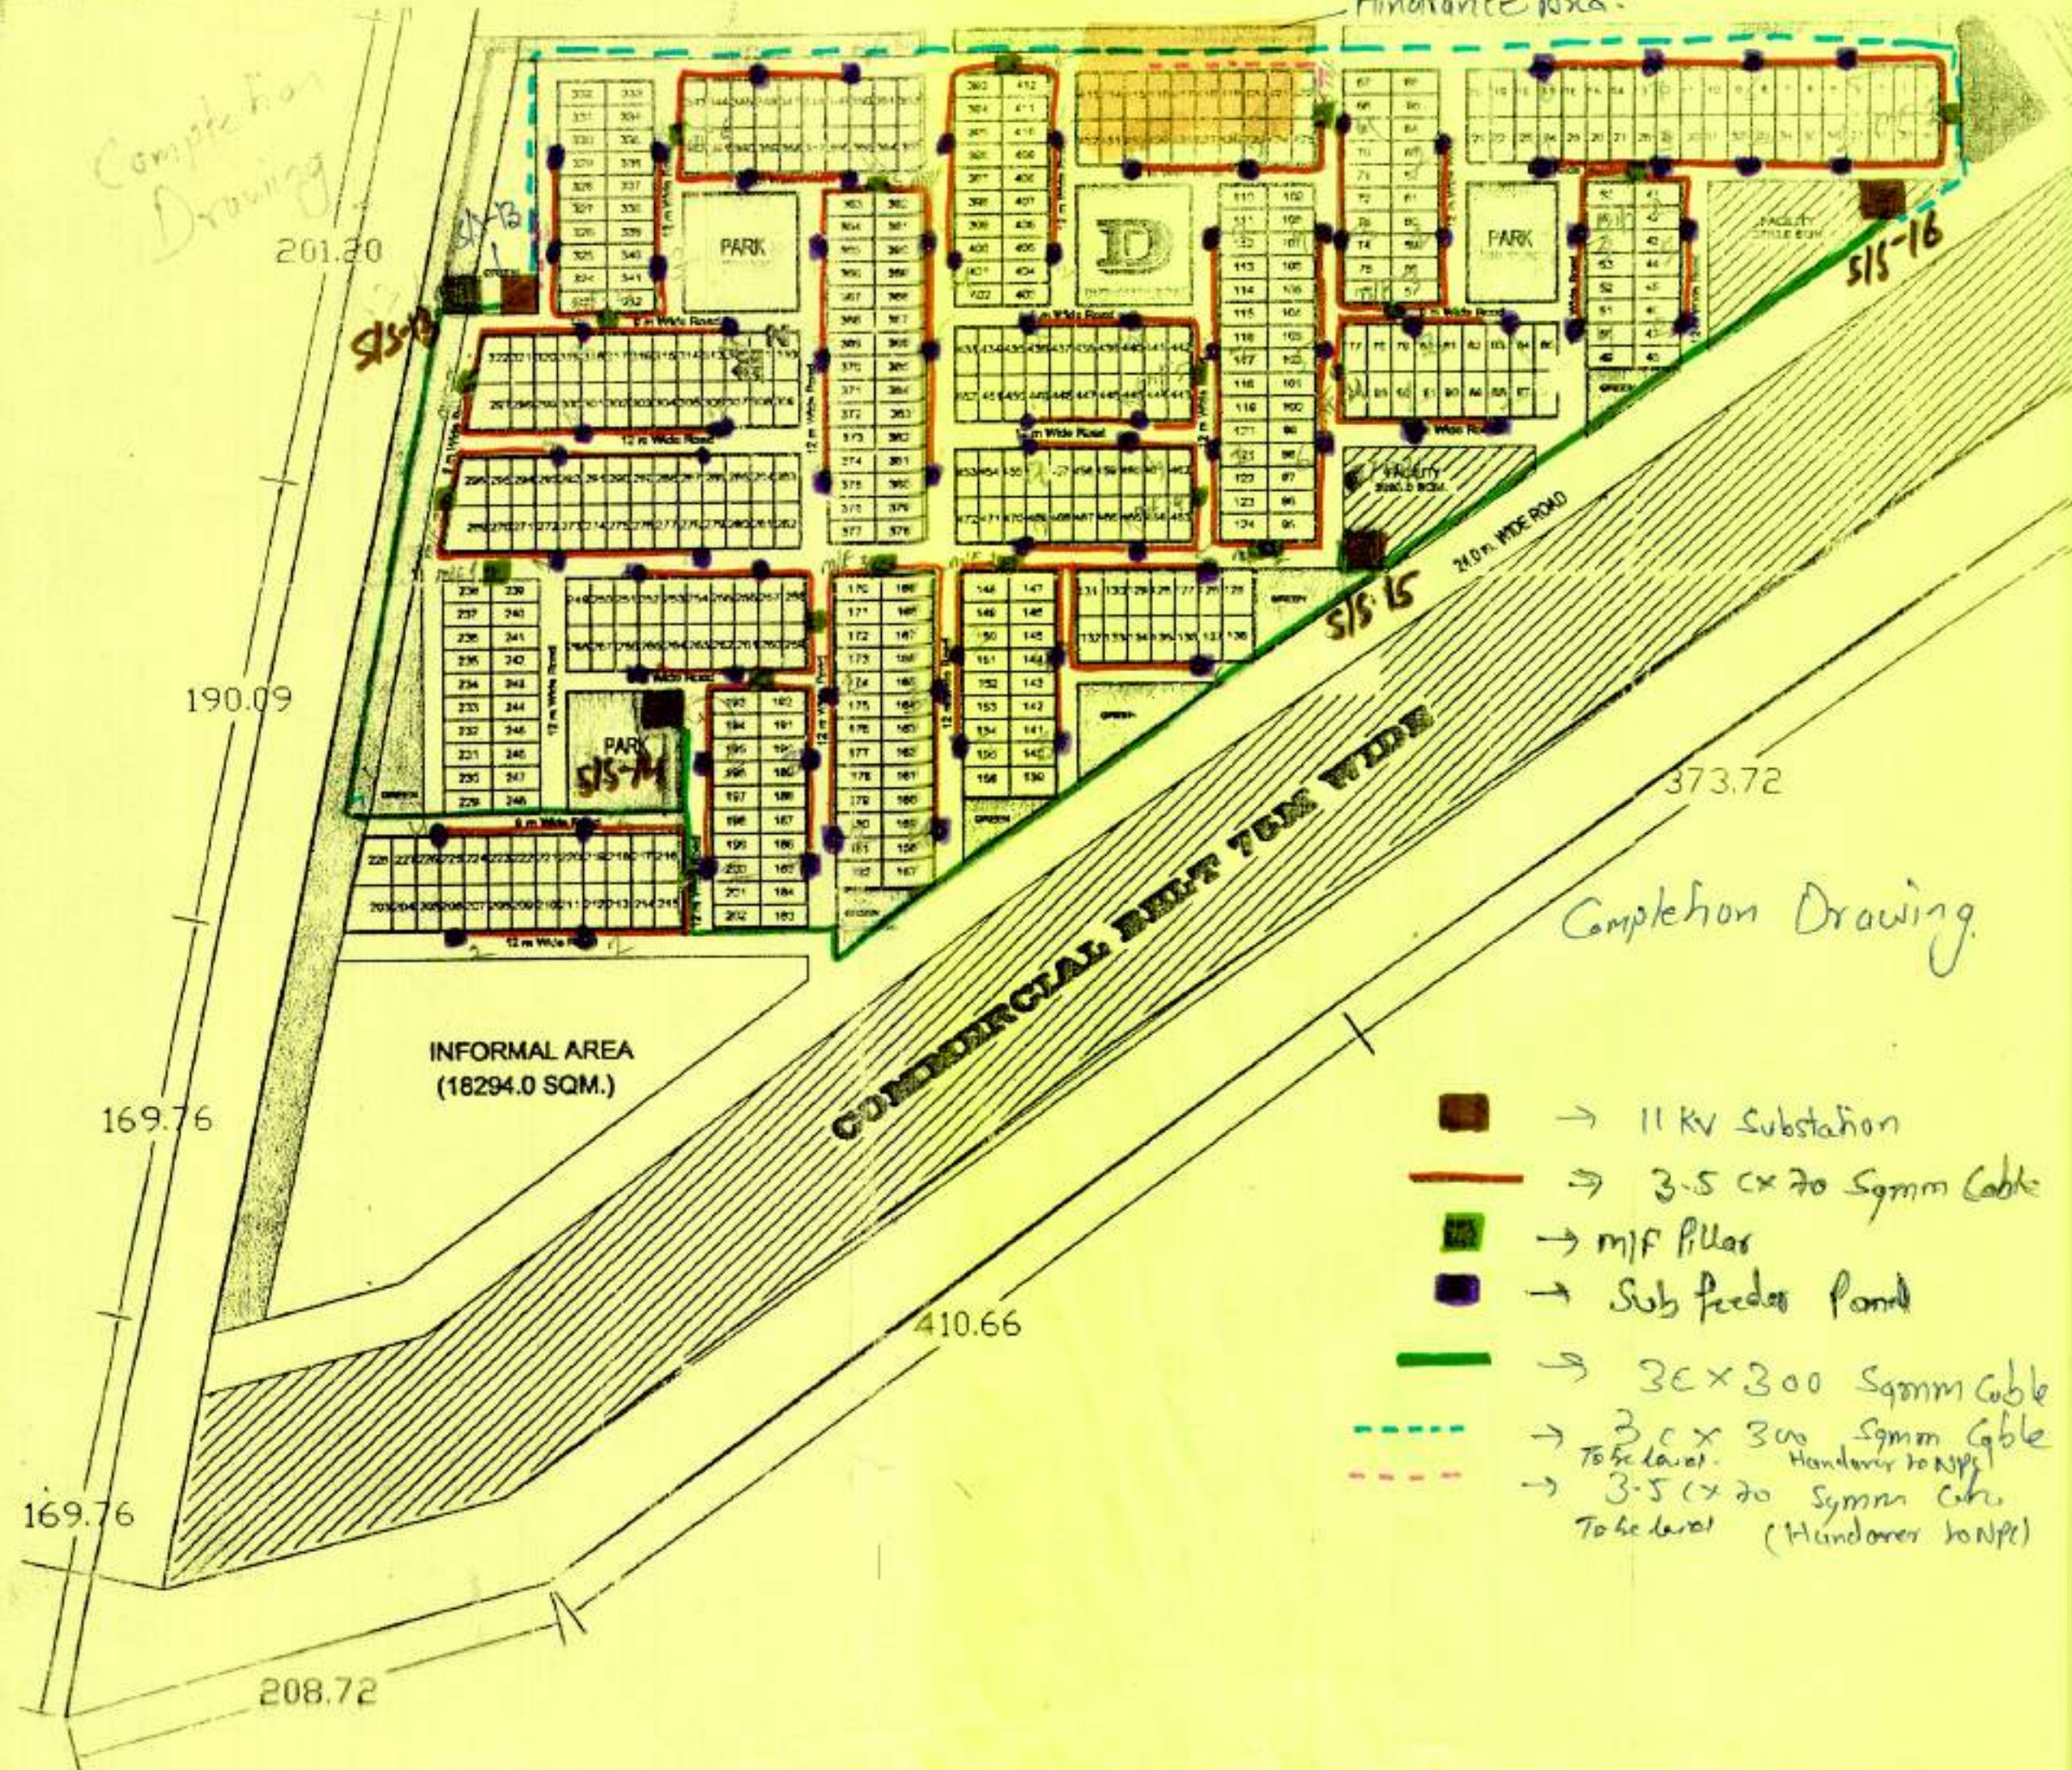

Completion Drawing

-  → 11 KV Substation
-  → 3-5 CX 70 Sgmm Cable
-  → M/F Pillar
-  → Sub feeder Point
-  → 3C x 300 Sgmm Cable
-  → 3C x 300 Sgmm Cable To be level
-  → 3-5 CX 70 Sgmm Cable To be level (Handover to NPE)