


DRG. NO.

FILE. NO.

NOTES:-

THIS IS WRONG IT CAN
NOT BE LIKE THIS

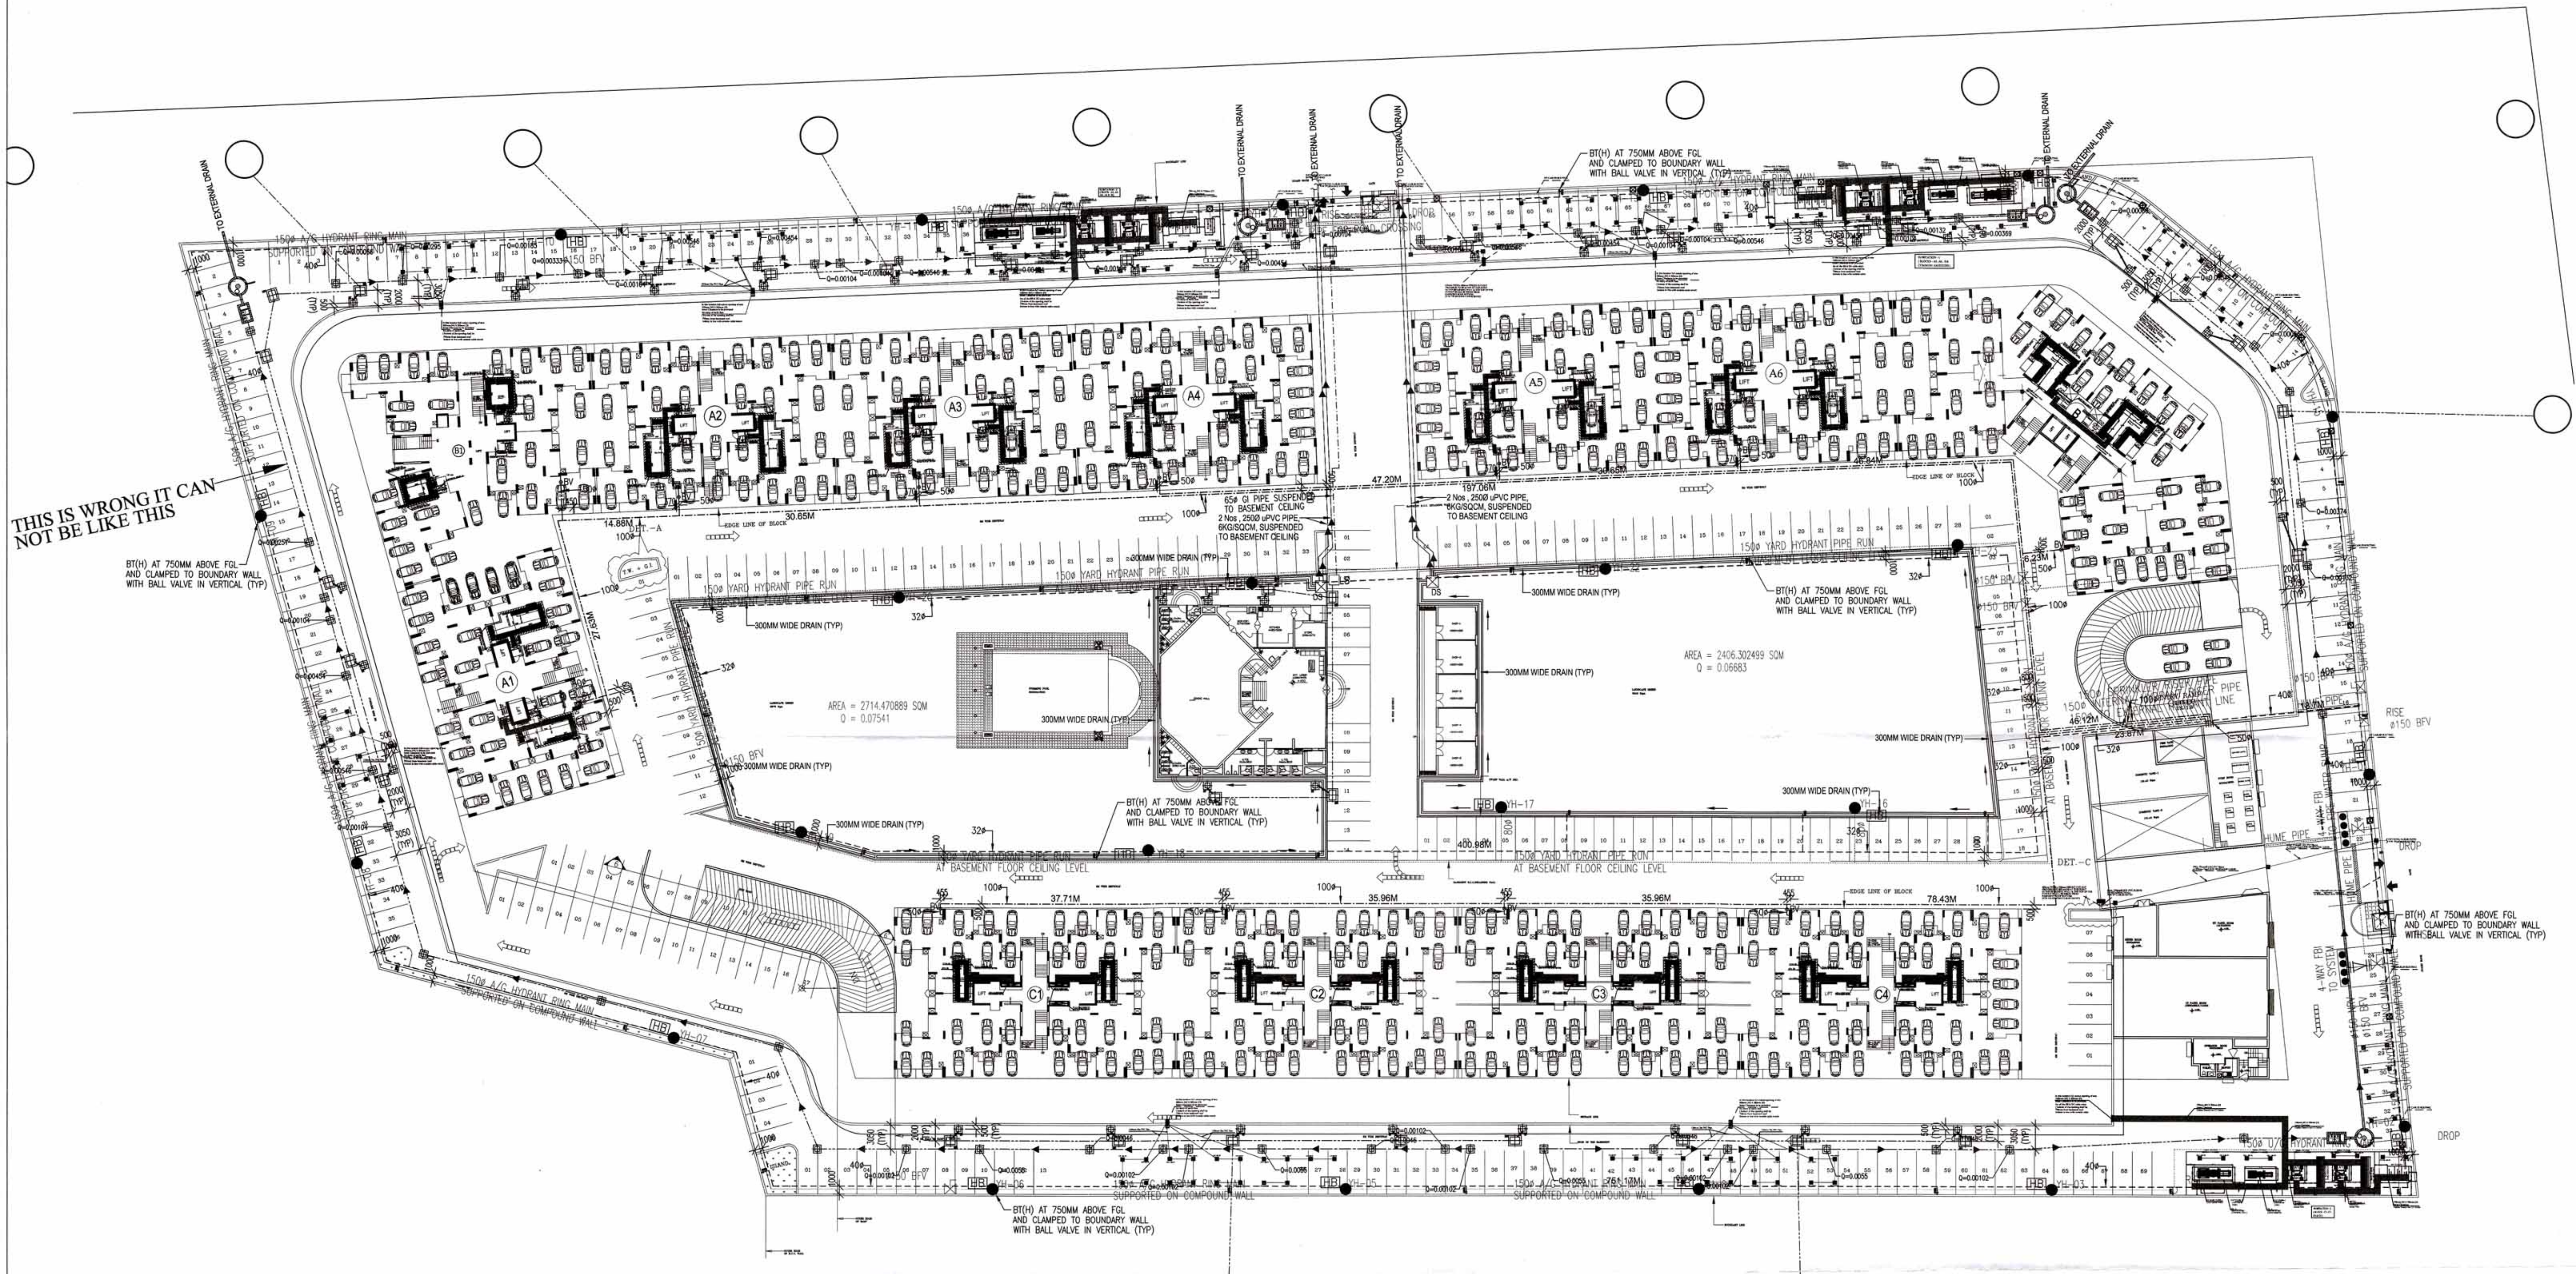

GOOD FOR EXECUTION
S.E. (P.C.)

LEGEND	
SYMBOL	DESCRIPTION
	100mm Dia PVC Pipe for Earthing
	75mm Dia PVC Pipe for Earthing
	Cable Trench
	BODY EARTH PIT
	NEUTRAL EARTH PIT

DATE NO ISSUED TO INITIAL

15.09.15 01 APPROVED

DATE REV. NO BRIEF RECORD INITIAL

REVISION

CONSULTANTS:
SAJAG CONSULTANTS
C-146 KILOKRI
NEAR MAHARANI BAGH CROSSING
NEW DELHI-110014
TELEPHONE-26343059,9868848054

DIVISION	DRAWN	CHECKED	UNIT
PL_FF	VIKRAM	VIVEK	M.M.

DRG. NO.: 193.5.3.00.01

SCHEME:
AWADH VIHAR YOJNA, LUCKNOW.

DRG. TITLE:
EXTERNAL CO-ORDINATION
LAYOUT

PROJECT:
GROUP HOUSING IN
MANDAKINI (SECT.- 2A)

SCALE:

DATE: 05.12.2013