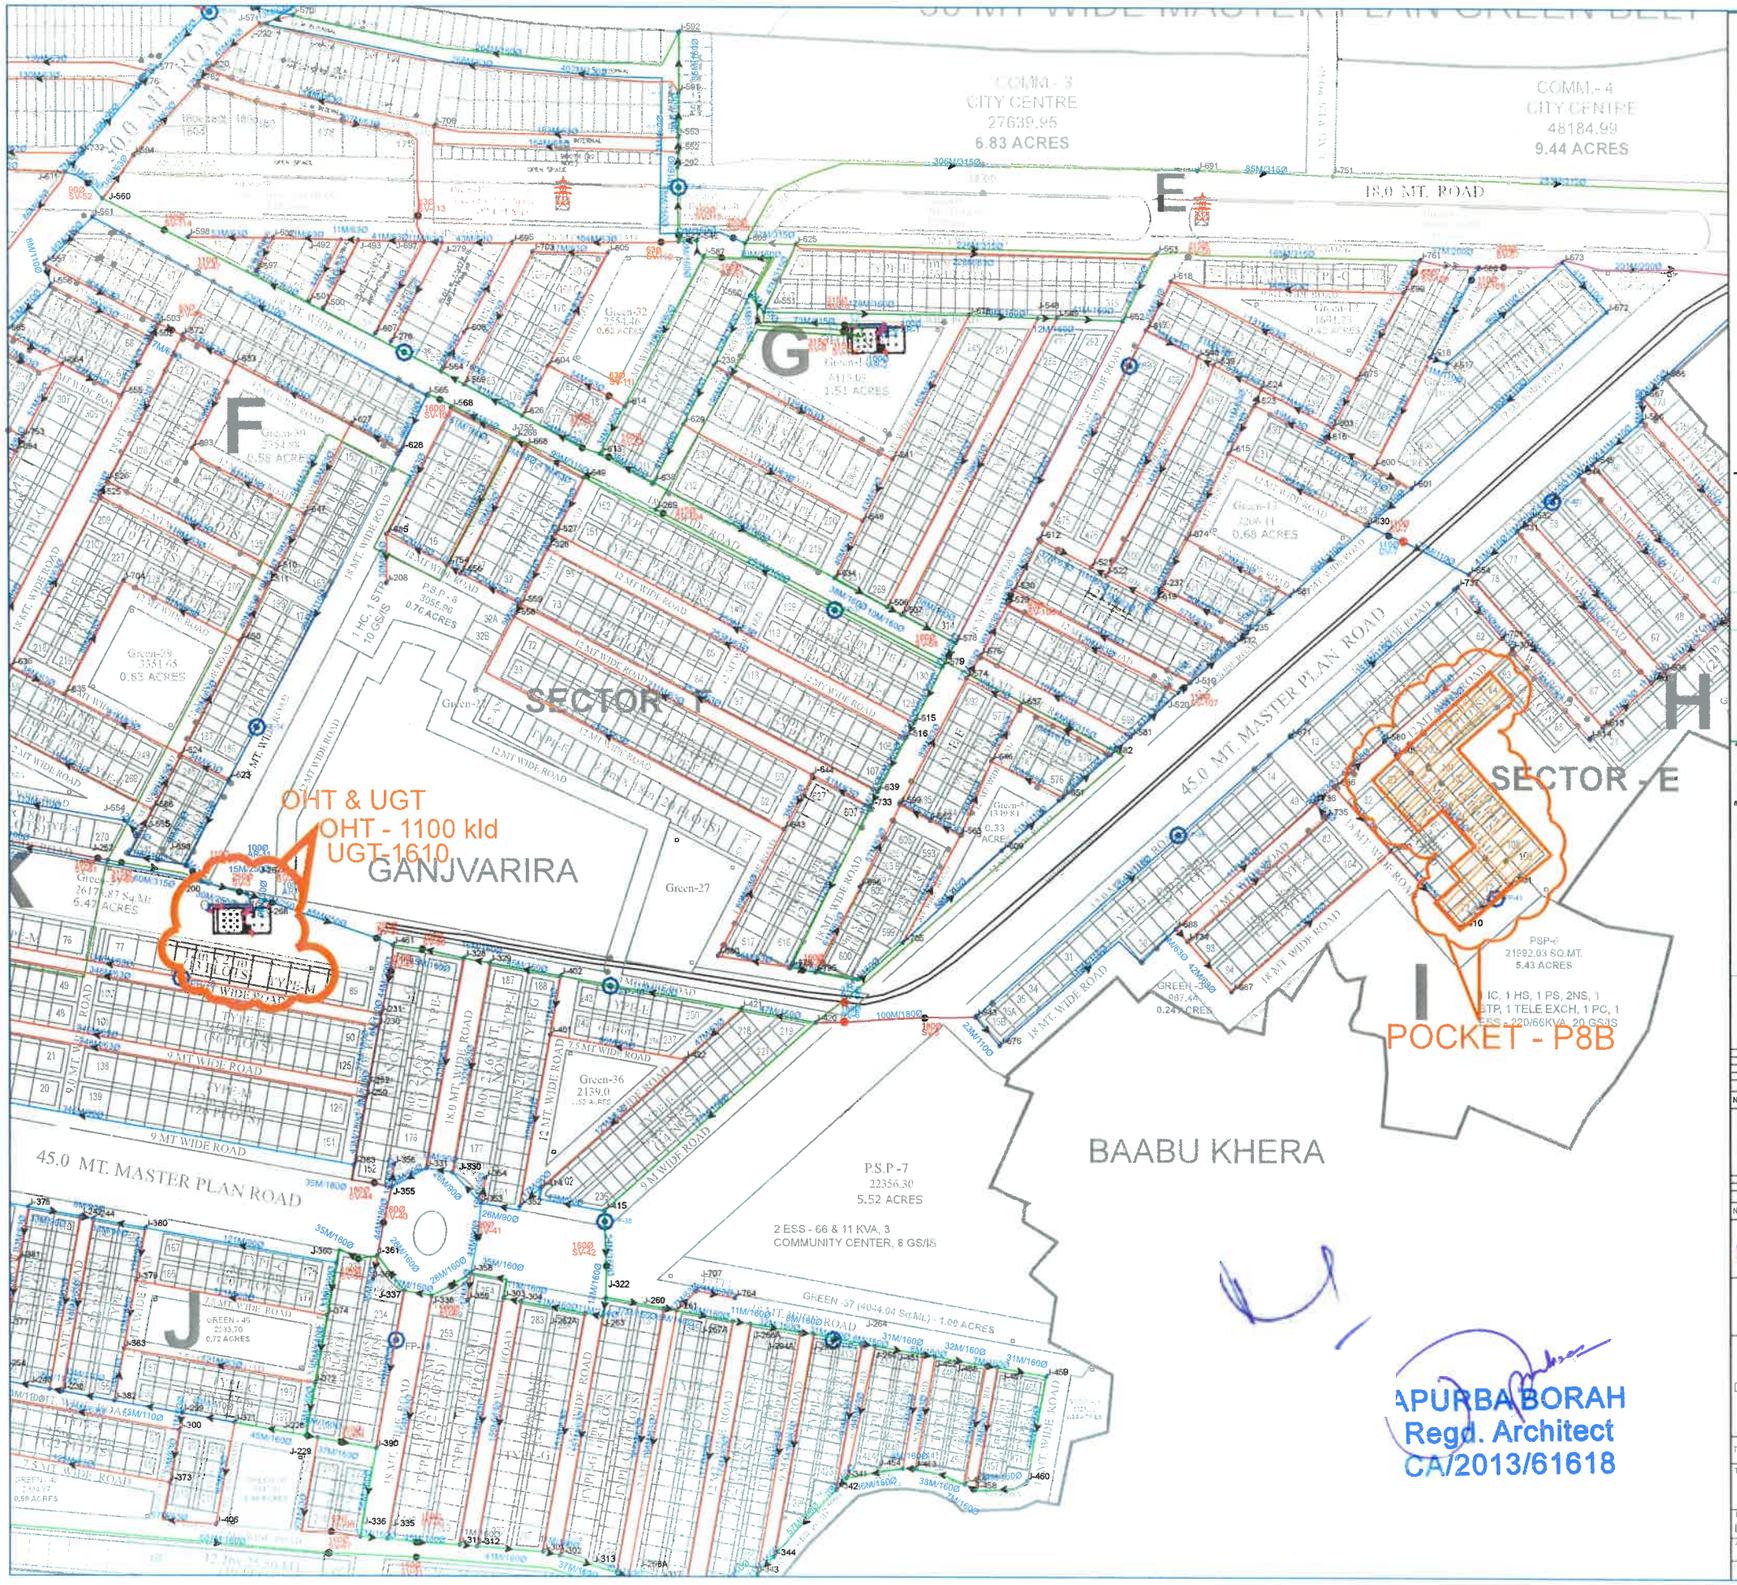

LEGEND

Junction Number	J-92
Length/Diameter of pipe	00
Overhead Tank	
Sluice valve	
Fire Hydrant	FP-2
Air Valve	
Drain Valve	
315Ø MDPE pipe	
250Ø MDPE pipe	
200Ø MDPE pipe	
180Ø MDPE pipe	
160Ø MDPE pipe	
110Ø MDPE pipe	
90Ø MDPE pipe	
63Ø MDPE pipe	

- 1.The site can use HDPE and the pressure rating of the pipes should be 6 Kg/CM^2
2.In crossing of Internal roads NP2/NP3 pipe will be laid as sleeve
3.In crossing of Master Plan road Ductile Iron pipe will be used in place of HDPE

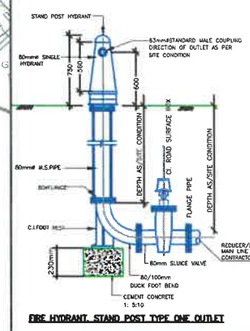

FIRE HYDRANT, STAND POST TYPE ONE OUTLET

NO	DATE OF ISSUE	MODE OF ISSUE
	07.05.24	By Email
	19.12.22	By Email
	26.10.22	By Email
	15.7.19	By Email
	29.9.016	By Email

NO	DATE	REVISIONS(DRAWING NO)	BY	CHKD	APPD	ENGG
	07.05.24	Layout Change	SA	JK	JK	JK
	26.10.22	Layout Change	SA	JK	JK	JK
	15.7.19	Layout Change	SA	JK	JK	JK

CLIENT
OMAXE
Omaxe Ltd
7, LSC, Kalkaji,
New Delhi – 110019 (India)
Telephone:+91-11- 41893106

OMAXE HI-TECH CITY
LUCKNOW

CONSULTANT
DESIGN COLLABORATIVE CONSULTING
ENGINEERS PLANNERS PROJECT MANAGERS
(An Integrated Food Park and Infrastructure Consultant)

TOWN LUCKNOW

TITLE POCKET-P8B OF
WATER SUPPLY NETWORK

DRAWING NO. DCC/P/OM/LUK/2016/D-17/17.2 REV

APPROVED	CHECKED	DESIGNED	DRAWN	NORTH
JK	JK	SA	MM	
SCALE	DATE			
NTS	18.10.2022			

APURBA BORAH
Regd. Architect
CA/2013/61618