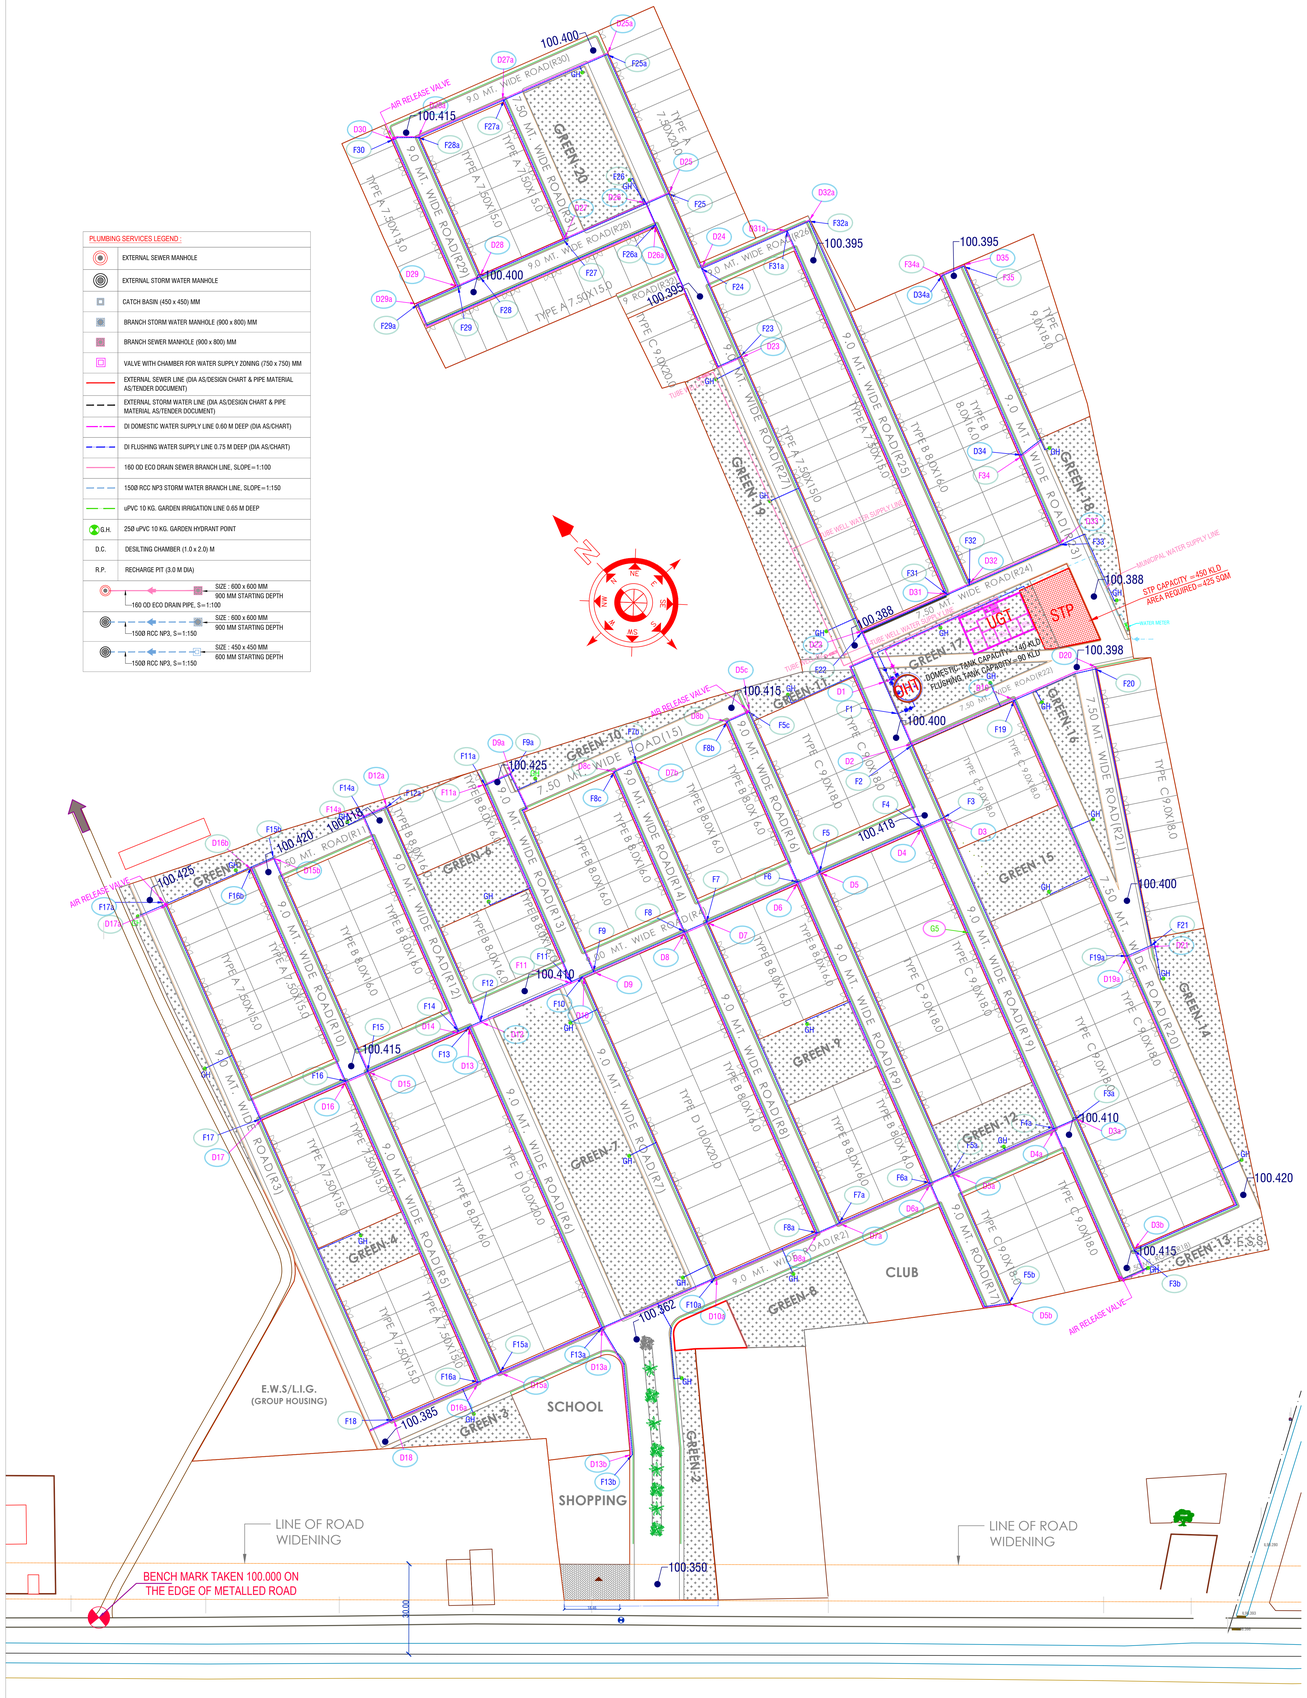

TITLE : DOMESTIC WATER SUPPLY CHART

S. No.	Line No From	Line No To	Length (Mtr.)	Pipe Dia (mm)
1	***UGT.***	***OHT.***	53.0	100
2.	***OHT.***	D1	5.0	100
3.	D1	D2	22.0	100
4.	D1	D4	68.0	100
5.	D2	D3	28.0	100
6.	D2	D19	36.0	100
7.	D19	D19a	94.0	100
8.	D19	D20	30.0	100
9.	D20	D21	95.0	100
10.	D19a	D21	9.0	100
11.	D19a	D3b	126.0	100
12.	D3	D3a	109.0	100
13.	D3	D4	9.0	100
14.	D4	D5	36.0	100
15.	D3a	D3b	47.0	100
16.	D3b	D4a	71.0	100
17.	D4	D4a	108.0	100
18.	D4a	D5a	36.0	100
19.	D5a	D5b	47.0	100
20.	D5b	D6a	45.0	100
21.	D5	D5a	105.0	100
22.	D5	D6	9.0	100
23.	D5	D5c	60.0	100
24.	D5c	D6b	9.0	100
25.	D6b	D6	61.0	100
26.	D5a	D6a	9.0	100
27.	D6a	D7a	32.0	100
28.	D6	D7	32.0	100
29.	D7	D7a	148.0	100
30.	D7a	D8a	9.0	100
31.	D7	D7b	59.0	100
32.	D7b	D8c	9.0	100

TITLE : DOMESTIC WATER SUPPLY CHART

S. No.	Line No From	Line No To	Length (Mtr.)	Pipe Dia (mm)
33.	D8c	D8	59.0	100
34.	D7	D8	9.0	100
35.	D8	D8a	148.0	100
36.	D8a	D10a	36.0	100
37.	D8	D9	32.0	100
38.	D9	D9a	75.0	100
39.	D9a	D11a	9.0	100
40.	D11a	D11	73.0	100
41.	D9	D10	5.0	100
42.	D10	D10a	109.0	100
43.	D10	D11	5.0	100
44.	D11	D12	32.0	100
45.	D12	D12a	79.0	100
46.	D12a	D14a	9.0	100
47.	D14a	D14	79.0	100
48.	D12	D13	5.0	100
49.	D13	D14	4.0	100
50.	D13	D13a	109.0	100
51.	D10a	D13a	42.0	100
52.	D13a	D13b	46.0	50
53.	D13a	D15a	36.0	100
54.	D14	D15	32.0	100
55.	D15	D16	9.0	100
56.	D15	D15a	109.0	100
57.	D15	D15b	78.0	100
58.	D15b	D16b	9.0	100
59.	D16b	D16	78.0	100
60.	D16	D17	30.0	100
61.	D16	D16a	109.0	100
62.	D15a	D16a	9.0	100
63.	D16a	D18	30.0	100
64.	D17	D18	109.0	100

TITLE : DOMESTIC WATER SUPPLY CHART

S. No.	Line No From	Line No To	Length (Mtr.)	Pipe Dia (mm)
65.	D17	D17a	78.0	65
66.	D1	D22	18.0	100
67.	D22	D23	99.0	100
68.	D23	D24	33.0	100
69.	D23	D26a	60.0	100
70.	D24	D31a	30.0	100
71.	D31a	D32a	9.0	100
72.	D22	D31	30.0	100
73.	D31	D31a	133.0	100
74.	D31	D32	9.0	100
75.	D32	D32a	133.0	100
76.	D32	D33	33.0	100
77.	D33	D34	32.0	100
78.	D34	D35	73.0	100
79.	D34	D34a	66.0	100
80.	D34a	D35	9.0	100
81.	D24	D25	27.0	100
82.	D25	D26	9.0	100
83.	D25	D25a	51.0	100
84.	D25a	D27a	38.0	100
85.	D26	D27	30.0	100
86.	D27	D27a	51.0	100
87.	D27a	D28a	31.0	100
88.	D28a	D30	10.0	100
89.	D27	D28	30.0	100
90.	D28	D29	9.0	100
91.	D29	D30	53.0	100
92.	D29	D29a	15.0	100
93.	D29a	D26a	91.0	100
94.	Tubewell - 01	T1	105.0	100
95.	Tubewell - 02	T1	5.0	100
96.	T1	**UGT.**	64	150
1	**MUNICIPAL**	**UGT.**	75.0	100

TITLE : DOMESTIC WATER SUPPLY CHART

S. No.	Line No From	Line No To	Length (Mtr.)	Pipe Dia (mm)
1	***STP.***	***OHT.***	72.0	100
2.	***OHT.***	F1	7.0	100
3.	F1	F2	22.0	100
4.	F1	F4	68.0	100
5.	F2	F3	28.0	100
6.	F2	F19	36.0	100
7.	F19	F19a	94.0	100
8.	F19	F20	30.0	100
9.	F20	F21	95.0	100
10.	F19a	F21	9.0	100
11.	F19a	F3b	126.0	100
12.	F3	F3a	109.0	100
13.	F3	F4	9.0	100
14.	F4	F5	36.0	100
15.	F3a	F3b	47.0	100
16.	F3b	F4a	71.0	100
17.	F4	F4a	108.0	100
18.	F4a	F5a	36.0	100
19.	F5a	F5b	47.0	100
20.	F5b	F6a	45.0	100
21.	F5	F5a	105.0	100
22.	F5	F6	9.0	100
23.	F5	F5c	60.0	100
24.	F5c	F6b	9.0	100
25.	F6b	F6	61.0	100
26.	F5a	F6a	9.0	100
27.	F6a	F7a	32.0	100
28.	F6	F7	32.0	100
29.	F7	F7a	148.0	100
30.	F7a	F8a	9.0	100
31.	F7	F7b	59.0	100
32.	F7b	F8c	9.0	100
33.	F8c	F8	59.0	100
34.	F7	F8	9.0	100
35.	F8	F8a	148.0	100
36.	F8a	F10a	36.0	100

TITLE : DOMESTIC WATER SUPPLY CHART

S. No.	Line No From	Line No To	Length (Mtr.)	Pipe Dia (mm)
37.	F8	F9	32.0	100
38.	F9	F9a	75.0	100
39.	F9a	F11a	9.0	100
40.	F11a	F11	73.0	100
41.	F9	F10	5.0	100
42.	F10	F10a	109.0	100
43.	F10	F11	5.0	100
44.	F11	F12	32.0	100
45.	F12	F12a	79.0	100
46.	F12a	F14a	9.0	100
47.	F14a	F14	79.0	100
48.	F12	F13	5.0	100
49.	F13	F14	4.0	100
50.	F13	F13a	109.0	100
51.	F10a	F13a	42.0	100
52.	F13a	F13b	46.0	40
53.	F13a	F15a	36.0	100
54.	F14	F15	32.0	100
55.	F15	F16	9.0	100
56.	F15	F15a	109.0	100
57.	F15	F15b	78.0	100
58.	F15b	F16b	9.0	100
59.	F16b	F16	78.0	100
60.	F16	F17	30.0	100
61.	F16	F16a	109.0	100
62.	F15a	F16a	9.0	100
63.	F16a	F18	30.0	100
64.	F17	F18	109.0	100
65.	F17	F17a	78.0	50
66.	F1	F22	18.0	100
67.	F22	F23	99.0	100
68.	F23	F24	33.0	100
69.	F23	F26a	60.0	100

TITLE : DOMESTIC WATER SUPPLY CHART

S. No.	Line No From	Line No To	Length (Mtr.)	Pipe Dia (mm)
70.	F24	F31a	30.0	100
71.	F31a	F32a	9.0	100
72.	F22	F31	30.0	100
73.	F31	F31a	133.0	100
74.	F31	F32	9.0	100
75.	F32	F32a	133.0	100
76.	F32	F33	33.0	100
77.	F33	F34	32.0	100
78.	F34	F35	73.0	100
79.	F34	F34a	66.0	100
80.	F34a	F35	9.0	100
81.	F24	F25	27.0	100
82.	F25	F26	9.0	100
83.	F25	F25a	51.0	100
84.	F25a	F27a	38.0	100
85.	F26	F27	30.0	100
86.	F27	F27a	51.0	100
87.	F27a	F28a	31.0	100
88.	F28a	F30	10.0	100
89.	F27	F28	30.0	100
90.	F28	F29	9.0	100
91.	F29	F30	53.0	100
92.	F29	F29a	15.0	100
93.	F29a	F26a	91.0	100

SPECIAL NOTES :

1. ALL DIMENSIONS ON THIS DRAWING ARE IN MTR.
2. ONLY WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS SHOULD NOT BE SCALED UNDER ANY CIRCUMSTANCES.
3. ALL MEASUREMENTS MUST BE CHECKED AND VERIFIED BY THE CONTRACTORS PRIOR TO EXECUTION OF WORK AT THE SITE.
4. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT STRUCTURAL, SERVICES & FACILITY PLANNING DRAWINGS.
5. ARCHITECTURAL DRAWINGS ARE TO BE FOLLOWED FOR THE LOCATION OF ALL STRUCTURAL MEMBERS & MASONRY WALLS. FOR SIZES & REINFORCEMENT DETAILS OF STRUCTURAL MEMBERS RELEVANT STRUCTURAL DRAWINGS ARE TO BE REFERRED.
6. ANY DISCREPANCIES BETWEEN ARCHITECTURAL, STRUCTURAL AND SERVICES DRAWINGS MUST BE BROUGHT TO THE NOTICE OF THE ARCHITECTS IMMEDIATELY & PRIOR TO EXECUTION AT SITE.
7. CO-ORDINATION WITH MEP SERVICES SUCH AS HVAC, PLUMBING, FIRE & ELECTRICAL ETC. IS THE RESPONSIBILITY OF THE CONTRACTORS.
8. ALL MASONRY WALLS SHOULD BE ALIGNED WITH THE COLUMNS AS INDICATED ON THE PLAN IRRESPECTIVE OF THE POSITION AS CALCULATED WITH THE DIMENSIONING.
9. CONTRACTOR WILL BE TAKEN THE APPROVAL OF SHOP DRAWING & ALL THE NECESSARY DOCUMENT FROM THE CONSULTANT.
10. CONTRACTOR WILL BE WORKOUT THE QUANTITY AS/APPROVED DRAWING & WILL BE TAKE THE NECESSARY APPROVAL BEFORE ORDER THE MATERIAL IF ANY EXTRA ITEM COMES.
11. FOR DETAILS, REFER RELEVANT LARGE SCALE DETAIL DRGS. AS INDICATED.

ISSUES

NO.	DATE	BY	DESCRIPTION	PRINTS

NO.	DATE	DESCRIPTION

REVISIONS

DEVELOPER/PROMOTER:

LJK CONSTRUCTION INDIA PVT. LTD.

PROJECT :

PROPOSED MINI TOWNSHIP FOR LJK CONSTRUCTION INDIA PVT. LTD. AT MAKHDOOMPUR KAITHI, LUCKNOW

ARCHITECTS :

espaces
Ar.Sanjay Kr. Gupta

SERVICES CONSULTANTS:

PARADISE CONSULTANTS
PLOT NO. 96, BASEMENT,
NEAR LIVING STYLE MALL, JASOLA VIHAR
LANDLINE +91-11-29943601, 26943216
NEW DELHI - 110025
E-mail: paradiseconsultants@gmail.com
website: www.paradiseconsultants.com

DRAWING TITLE :

MASTER PLAN
WATER LAYOUT

scale :	1:1000 (A1)	drawn by :	T.S.RAWAT
date :	01/06/2022	checked by:	ANIL
project no :	----------	approved by :	NAFEES

drawing no :

PL-PC-MK-WATER-103

REVISION R0