


STILT FLOOR PLAN

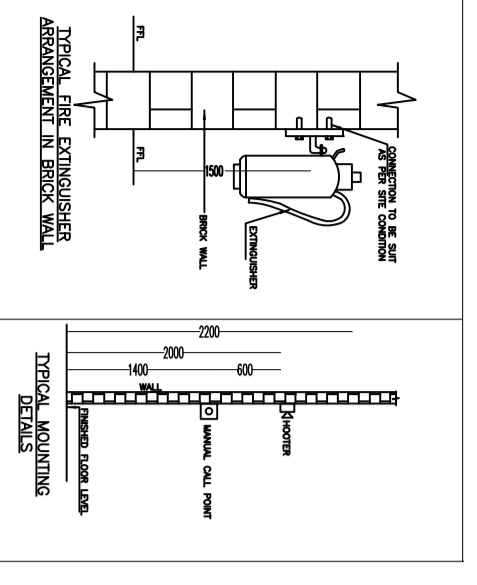

- GENERAL NOTES:-**
1. FIRE ALARM CONTROL CABLE SHALL BE 2CX1.5 SQ.MM UNARMORED FRLS OUTER SHEATHED, PVC INSULATED COPPER CONDUCTOR CABLE LAID IN CONCEALED MEDIUM CLASS PVC CONDUIT.
  2. PUBLIC ADDRESS CONTROL CABLE SHALL BE 2CX1.0 SQ.MM UNARMORED FRLS OUTER SHEATHED, PVC INSULATED COPPER CONDUCTOR CABLE LAID IN CONCEALED MEDIUM CLASS PVC CONDUIT.
  3. 20MM Ø MEDIUM CLASS PVC CONDUIT SHALL BE CONCEALED IN SLAB/WALL, FOR FIRE ALARM & PA CABLING IN CONCEALED CONDUIT TYPE. PVC CONDUIT SHALL BE USED WHERE IN FIRE SHAFT VERTICAL RISER AND EXPOSED BELOW CEILING.
  4. THE FIRE ALARM SYSTEM DESIGNED AS PER IS: 2189 - 1999.


**ELECTRICAL LEGEND :-**

1	<b>FAS</b>	FIRE ALARM SYSTEM
2	<b>MCP</b>	MANUAL CALL POINT
3	<b>B</b>	BUZZER

PLOT NO -C4

PROPOSED GROUP HOUSING AT PLOT NO. C4, SECTOR -O,  
MANSAROVAR YOJNA, KANPUR ROAD ,LDA, LUCKNOW

**BUILDING MEP CONSULTANT**  
TRIVENI CONSULTING ENGINEERS  
FLAT NO.-D, GF, AVON RESIDENCY  
A/1/8, SEC-H,ALIDAHU,  
KANPUR  
E-MAIL:triveniconsultants\_ks@gmail.com  
PH:5224108651, 09794991799

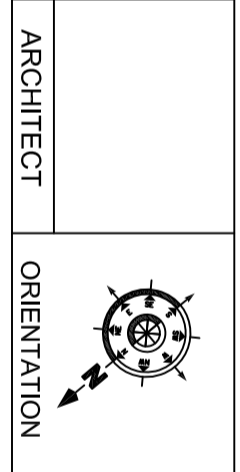

architects  
**m u r a l i a g e**  
interior decorators & muralists  
B-1/29, sector - a, allganj, lucknow  
no. : 2321590, 2320715

Sheet No  
**14**  
Ref No - L-81 AF-979(3)  
Date - November'16

SERVICES DRAWING  
STILT FLOOR FIRE ALARM LAYOUT  
SCALE - 1:300