

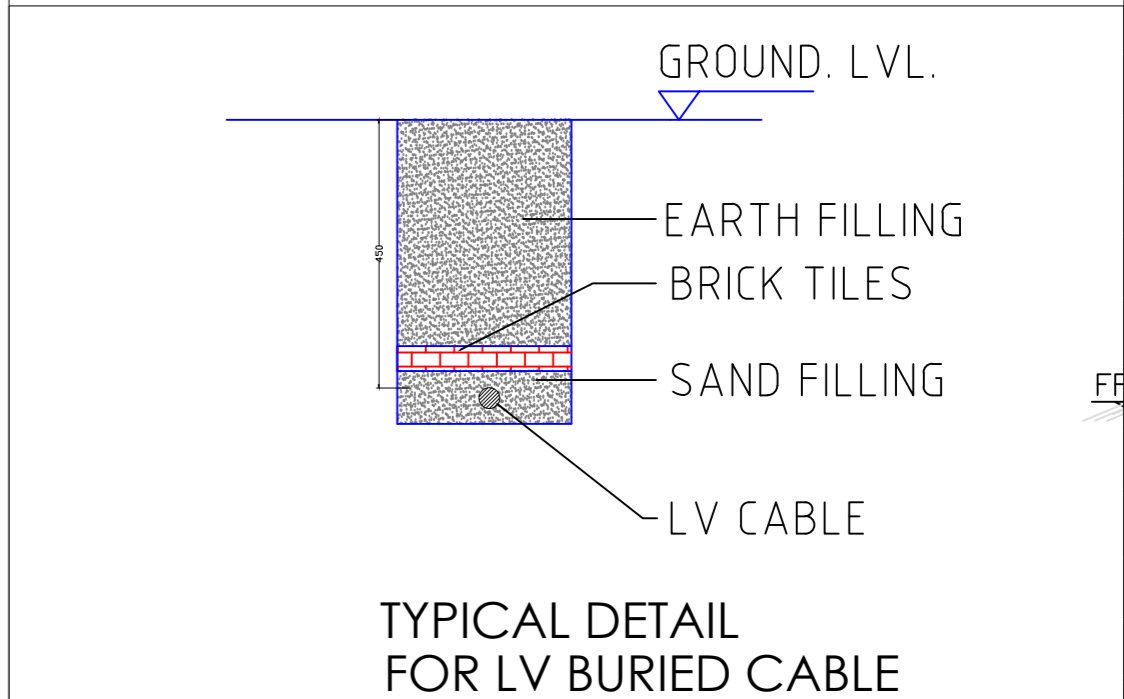


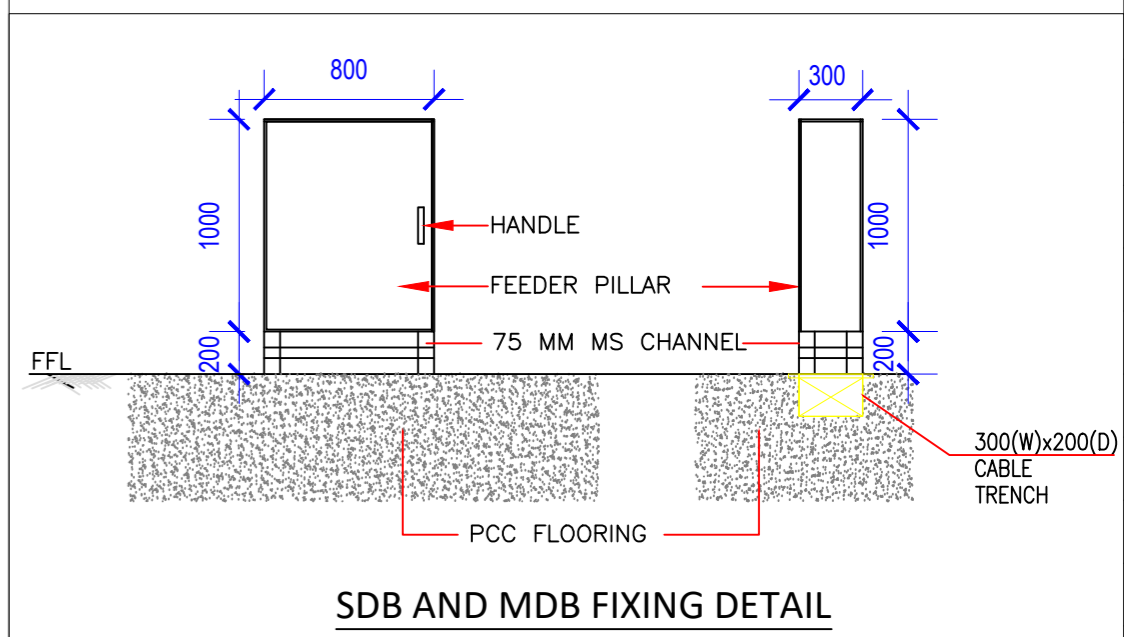

LEGENDS:-

SYMBOL	DESCRIPTION
	150Ø RCC HUME PIPE NP2 FOR H.T CABLE BELOW 1000mm FROM GROUND LEVEL
	200Ø RCC HUME PIPE NP2 FOR L.T CABLE BELOW 600mm FROM GROUND LEVEL FROM CSS/PSS TO METER BOARD
	200Ø RCC HUME PIPE NP2 FOR L.T CABLE BELOW 600mm FROM GROUND LEVEL FROM METER BOARD TO PLOTS
	900X900X1200D MANHOLE FOR H.T CABLES
	600X600X800D MANHOLE FOR L.T CABLES
	50Ø PVC PIPE FOR CABLE ENTRY IN PLOT
	METER BOARD
	GI EARTHING EARTH ELECTRODE (FOR BODY)
	CU CHEMICAL EARTH ELECTRODE(FOR NEUTRAL)

NOTE:-FOR FEEDER PILLAR TO METER BOARD TO PLOT FOR CABLE SIZE REFER TO SLD

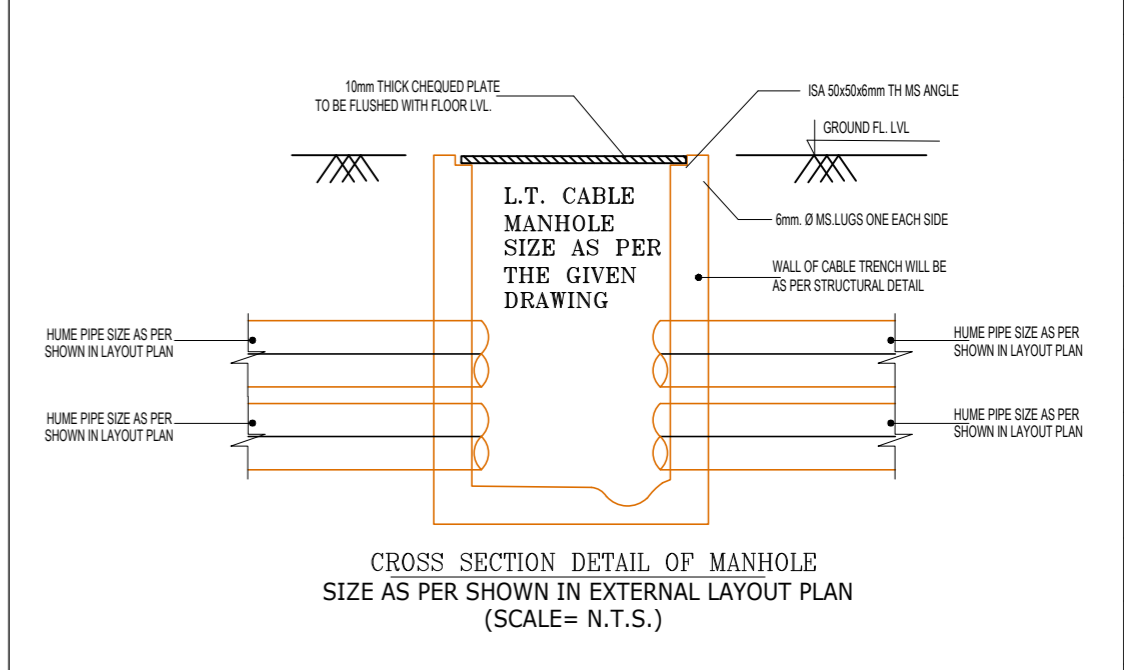

EARTH PIT SCHEDULE

PIT NO.	EQUIPMENT NAME	MATERIAL	QTY.
EP.1&4	TWO POLE STRUCTURE-1TO-2	GI CHEMICAL	2
EP.1&2	TRANSFORMER-1 (250 KVA) NEUTRAL	COPPER CHEMICAL	2
EP.3&4	TRANSFORMER-1 (250 KVA) BODY	GI CHEMICAL	2
EP.5&6	TRANSFORMER-2 (250 KVA) NEUTRAL	COPPER CHEMICAL	2
EP.7&8	TRANSFORMER-2 (250 KVA) BODY	GI CHEMICAL	2
EP.9&10	DG SET-1 (62.5 KVA) NEUTRAL	COPPER CHEMICAL	2
EP.11&12	DG SET-1 (62.5 KVA) BODY	GI CHEMICAL	2
EP.13TO16	METER BOARD-1TO-4	GI CHEMICAL	4
EP.17	EXTERNAL LIGHT & EXTERNAL LIGHT FEEDER	GI CHEMICAL	1

OWNER'S NAME - SRI RAJ KUMAR
SRI SANT LAL

Sri Kumar

ELECTRICITY SUPPLY PLAN

PROJECT NAME:- ARDAS HOMES
SITE AT- VILLAGE. MANOHARPUR BESIDES KPS SCHOOL, DISTRICT AND TEHSIL MORADABAD GATA NO:- 827,829, 831,832,834,842,843,844,845,866.
AUTHORITY APPROVAL NO. MBDA/LD/24-25/0540

SINGH & ASSOCIATES
OPP.POLICE CLUB,COURT COMPOUND,MORADABAD 244001
PH. - 9412581267,9720776969

ARCHITECT:-
AR. DHARA THAKUR
ENGINEER:-
STR.ER. RUDRA PRATAP SINGH

Dr. Dhara Thakur
CA/2011/54261, LM/CAT-1/A-4389
Wealth tax-10/2022-23
9827729977, 8395057279