


DOMESTIC WATER SUPPLY LEGENDS		
S.NO.	SYMBOL	DESCRIPTION
1		63 OD PE-100 FLUSHING WATER SUPPLY
2		90OD PE-100 FLUSHING WATER SUPPLY
3		VALVE CHAMBER 600X800X750 MM

NOTES:
 1. FLUSHING SHALL BE PROVIDED IN EACH MANHOLE WHICH IS DEEPER THAN 800 M.M.
 2. FOR ANY DISCREPANCY/COMMISSION THE MATTER SHOULD REFER TO THE CONSULTANT BEFORE EXECUTION
 3. THE STRUCTURE DESIGN OF CHAMBER/PIPE BEDDING AS FILLED UP SOIL/BLACK COTTON SOIL/HIGH SUB-SOIL CONDITION
 4. CHAMBER COVER SHOULD BE FINISHED FORMATION LEVEL AS PER LANDSCAPE DRAWING.
 5. MATERIAL OF PIPE
 DOMESTIC WATER SUPPLY
 (a) PE-100

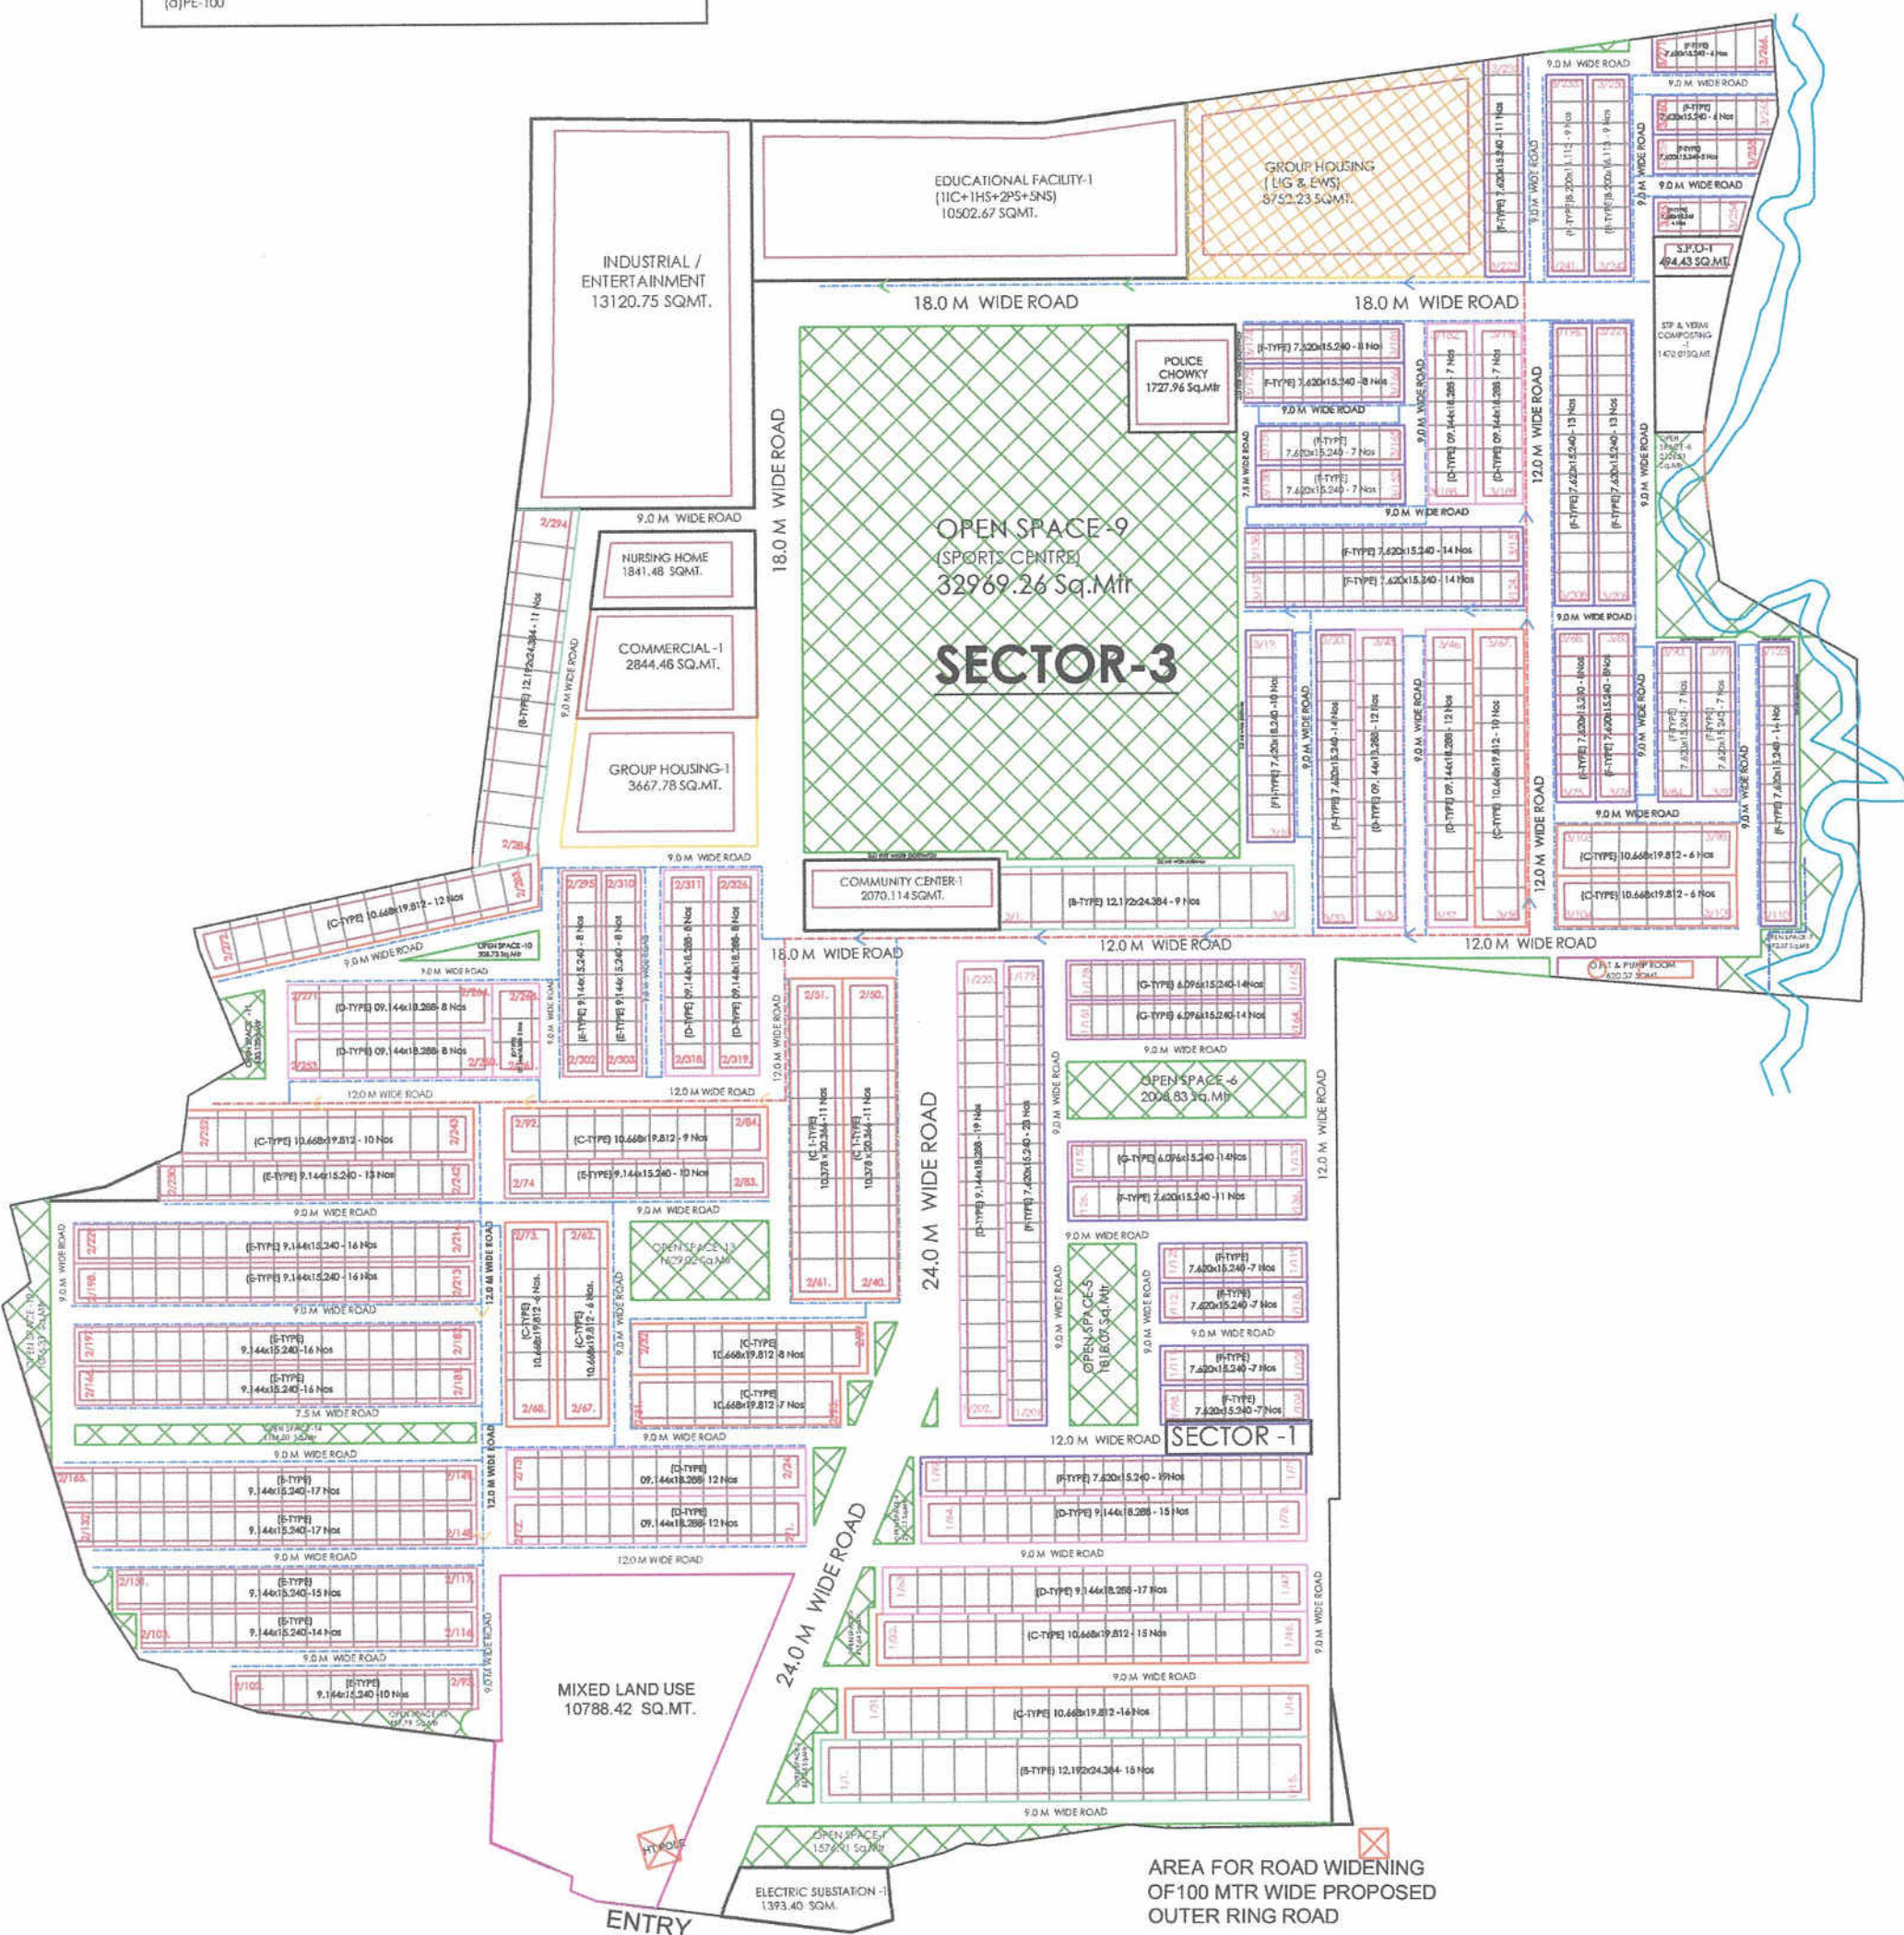

FLUSHING WATER SUPPLY

SIGNATURE PARK

AN INTEGRATED TOWNSHIP AT SULTANPUR ROAD, LUCKNOW.

NORTH:-

DATE:-
JANUARY 2022

SCALE:-
N.T.S.

ARCHITECT PLANNER

AR. MAYANK GUPTA


CLIENT:-
M/S SWASTIK MULTITRADE PVT LTD
(A UNIT OF SSG GROUP OF COMPANIES)

Registered Office:-
101, WINDY ROAD,
GOMTI NAGAR,
LUCKNOW, 226010

CONSULTANT:-

COMPASS DESIGN
Architects
LUCKNOW
13/1/2022

DOMESTIC WATER SUPPLY LEGENDS		
S.NO.	SYMBOL	DESCRIPTION
1		SEWER MAN HOLE
2		SEWER MANHOLE 800X900 MM
3		[DWG SN-8] SEWER PIPE
4		NOODS
5		SEWERAGE TREATMENT PLANT

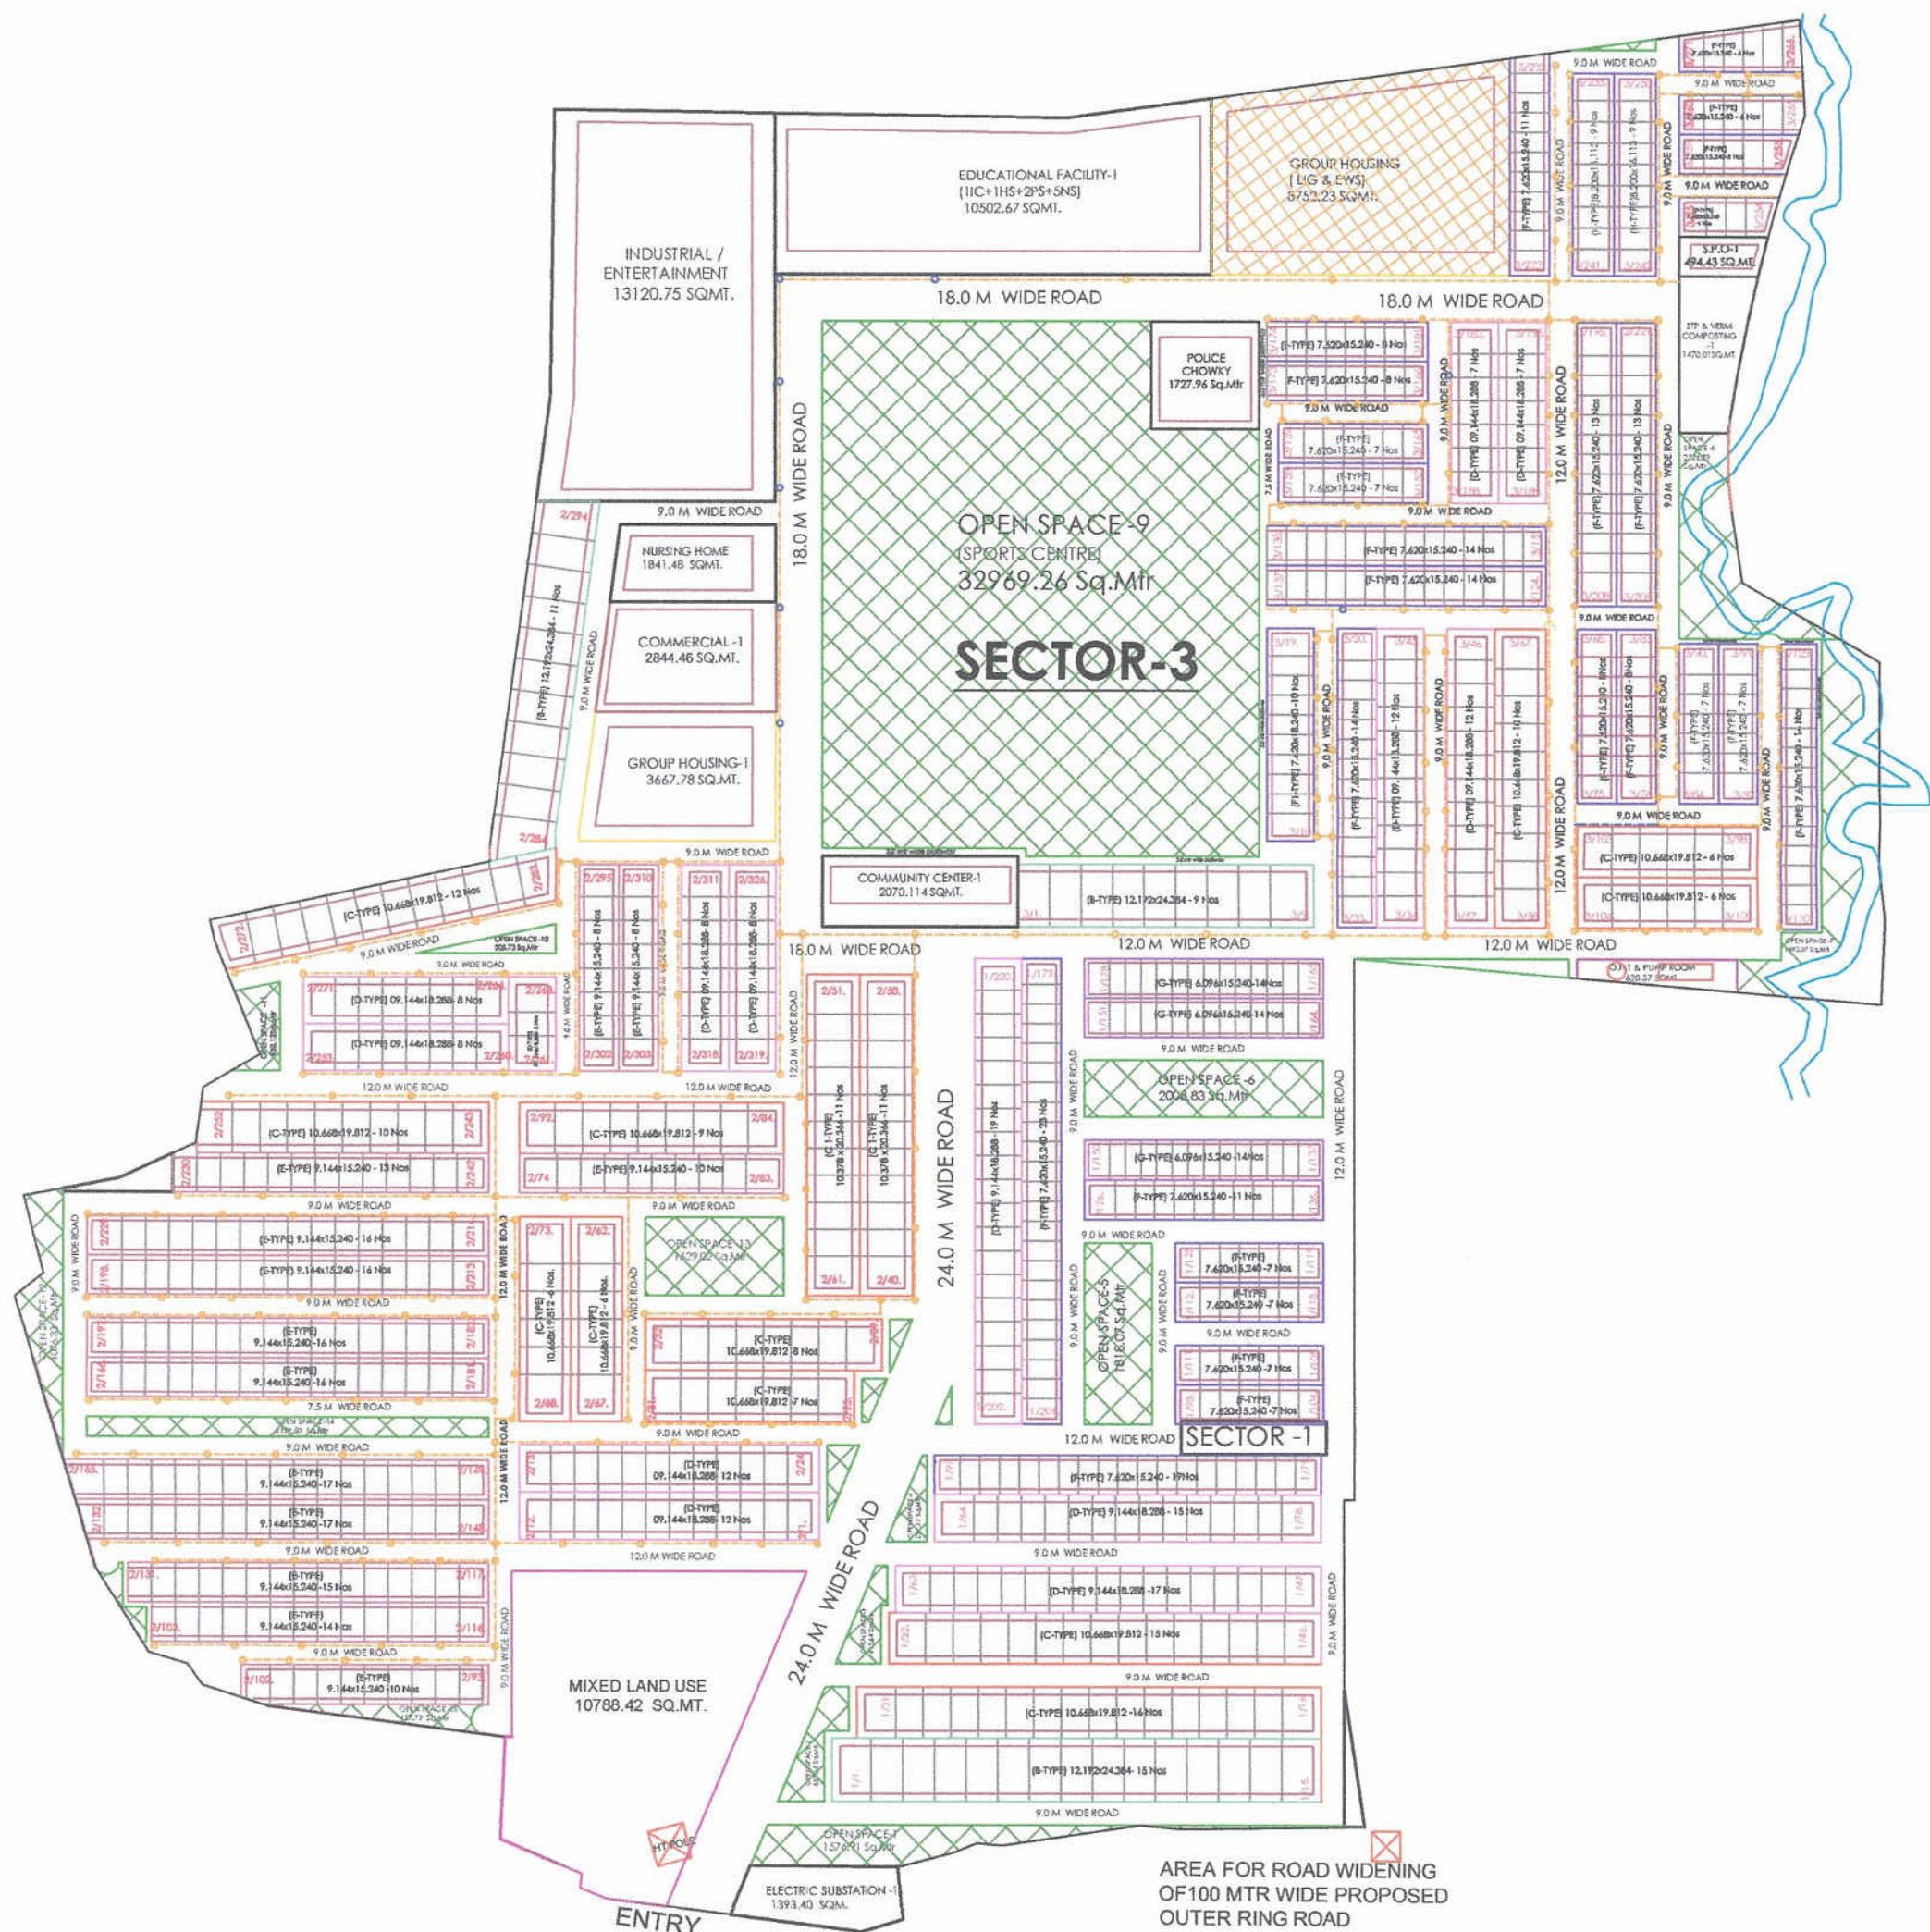

SEWERAGE SYSTEM

SIGNATURE PARK

AN INTEGRATED TOWNSHIP AT SULTANPUR ROAD, LUCKNOW.

NORTH:-

DATE:-

JANUARY 2022

SCALE:-

N.T.S.

ARCHITECT PLANNER

AR. MAYANK GUPTA

CLIENT:-

M/S SWASTIK MULTITRADE PVT LTD

(A Unit of 100 group of Companies)

Registered Office:-

1/51, VIKAS NAGAR

GOMTI NAGAR

LUCKNOW, 226010

CONSULTANT:-



DOMESTIC WATER SUPPLY LEGENDS		
S.NO.	SYMBOL	DESCRIPTION
1		SEWER MAN HOLE
2		SEWER MANHOLE 800X900 MM
3		(DWG SN-8) SEWER PIPE
4		NOODS
5		RAIN WATER HARVESTING PIT



STORM WATER AND DRAINAGE SYSTEM

SIGNATURE PARK

AN INTEGRATED TOWNSHIP AT SULTANPUR ROAD, LUCKNOW.

NORTH:-

DATE:-
JANUARY 2022

SCALE:-
N.T.S.

ARCHITECT PLANNER

AR. MAYANK GUPTA

CLIENT:-

M/S SWASTIK MULTITRADE PVT LTD
(A Unit of 90 group of Companies)
Registered Office:
1/51, WIDER ROAD
GOMTI NAGAR
LUCKNOW, 226010

CONSULTANT:-


COMPASS DESIGN



DOMESTIC WATER SUPPLY LEGENDS		
S.NO.	SYMBOL	DESCRIPTION
1		90 OD PE-100 DOMESTIC WATER SUPPLY
2		110 OD PE-100 DOMESTIC WATER SUPPLY
		160 OD PE-100 DOMESTIC WATER SUPPLY
3		VALVE CHAMBER 600X800X750 MM

NOTES:

1. FLUSHING SHALL BE PROVIDED IN EACH MANHOLE WHICH IS DEEPER THAN 800 M.M.
2. FOR ANY DISCREPANCY/COMMISSION THE MATTER SHOULD REFER TO THE CONSULTANT BEFORE EXECUTION
3. THE STRUCTURE DESIGN OF CHAMBER/PIPE BEDDING AS FILLED UP SOIL/BLACK COTTON SOIL/HIGH SUB SOIL CONDITION
4. CHAMBER COVER SHOULD BE FINISHED FORMATION LEVEL AS PER LAND SCAPE DRAWING.
5. MATERIAL OF PIPE
DOMESTIC WATER SUPPLY
(a) PE-100

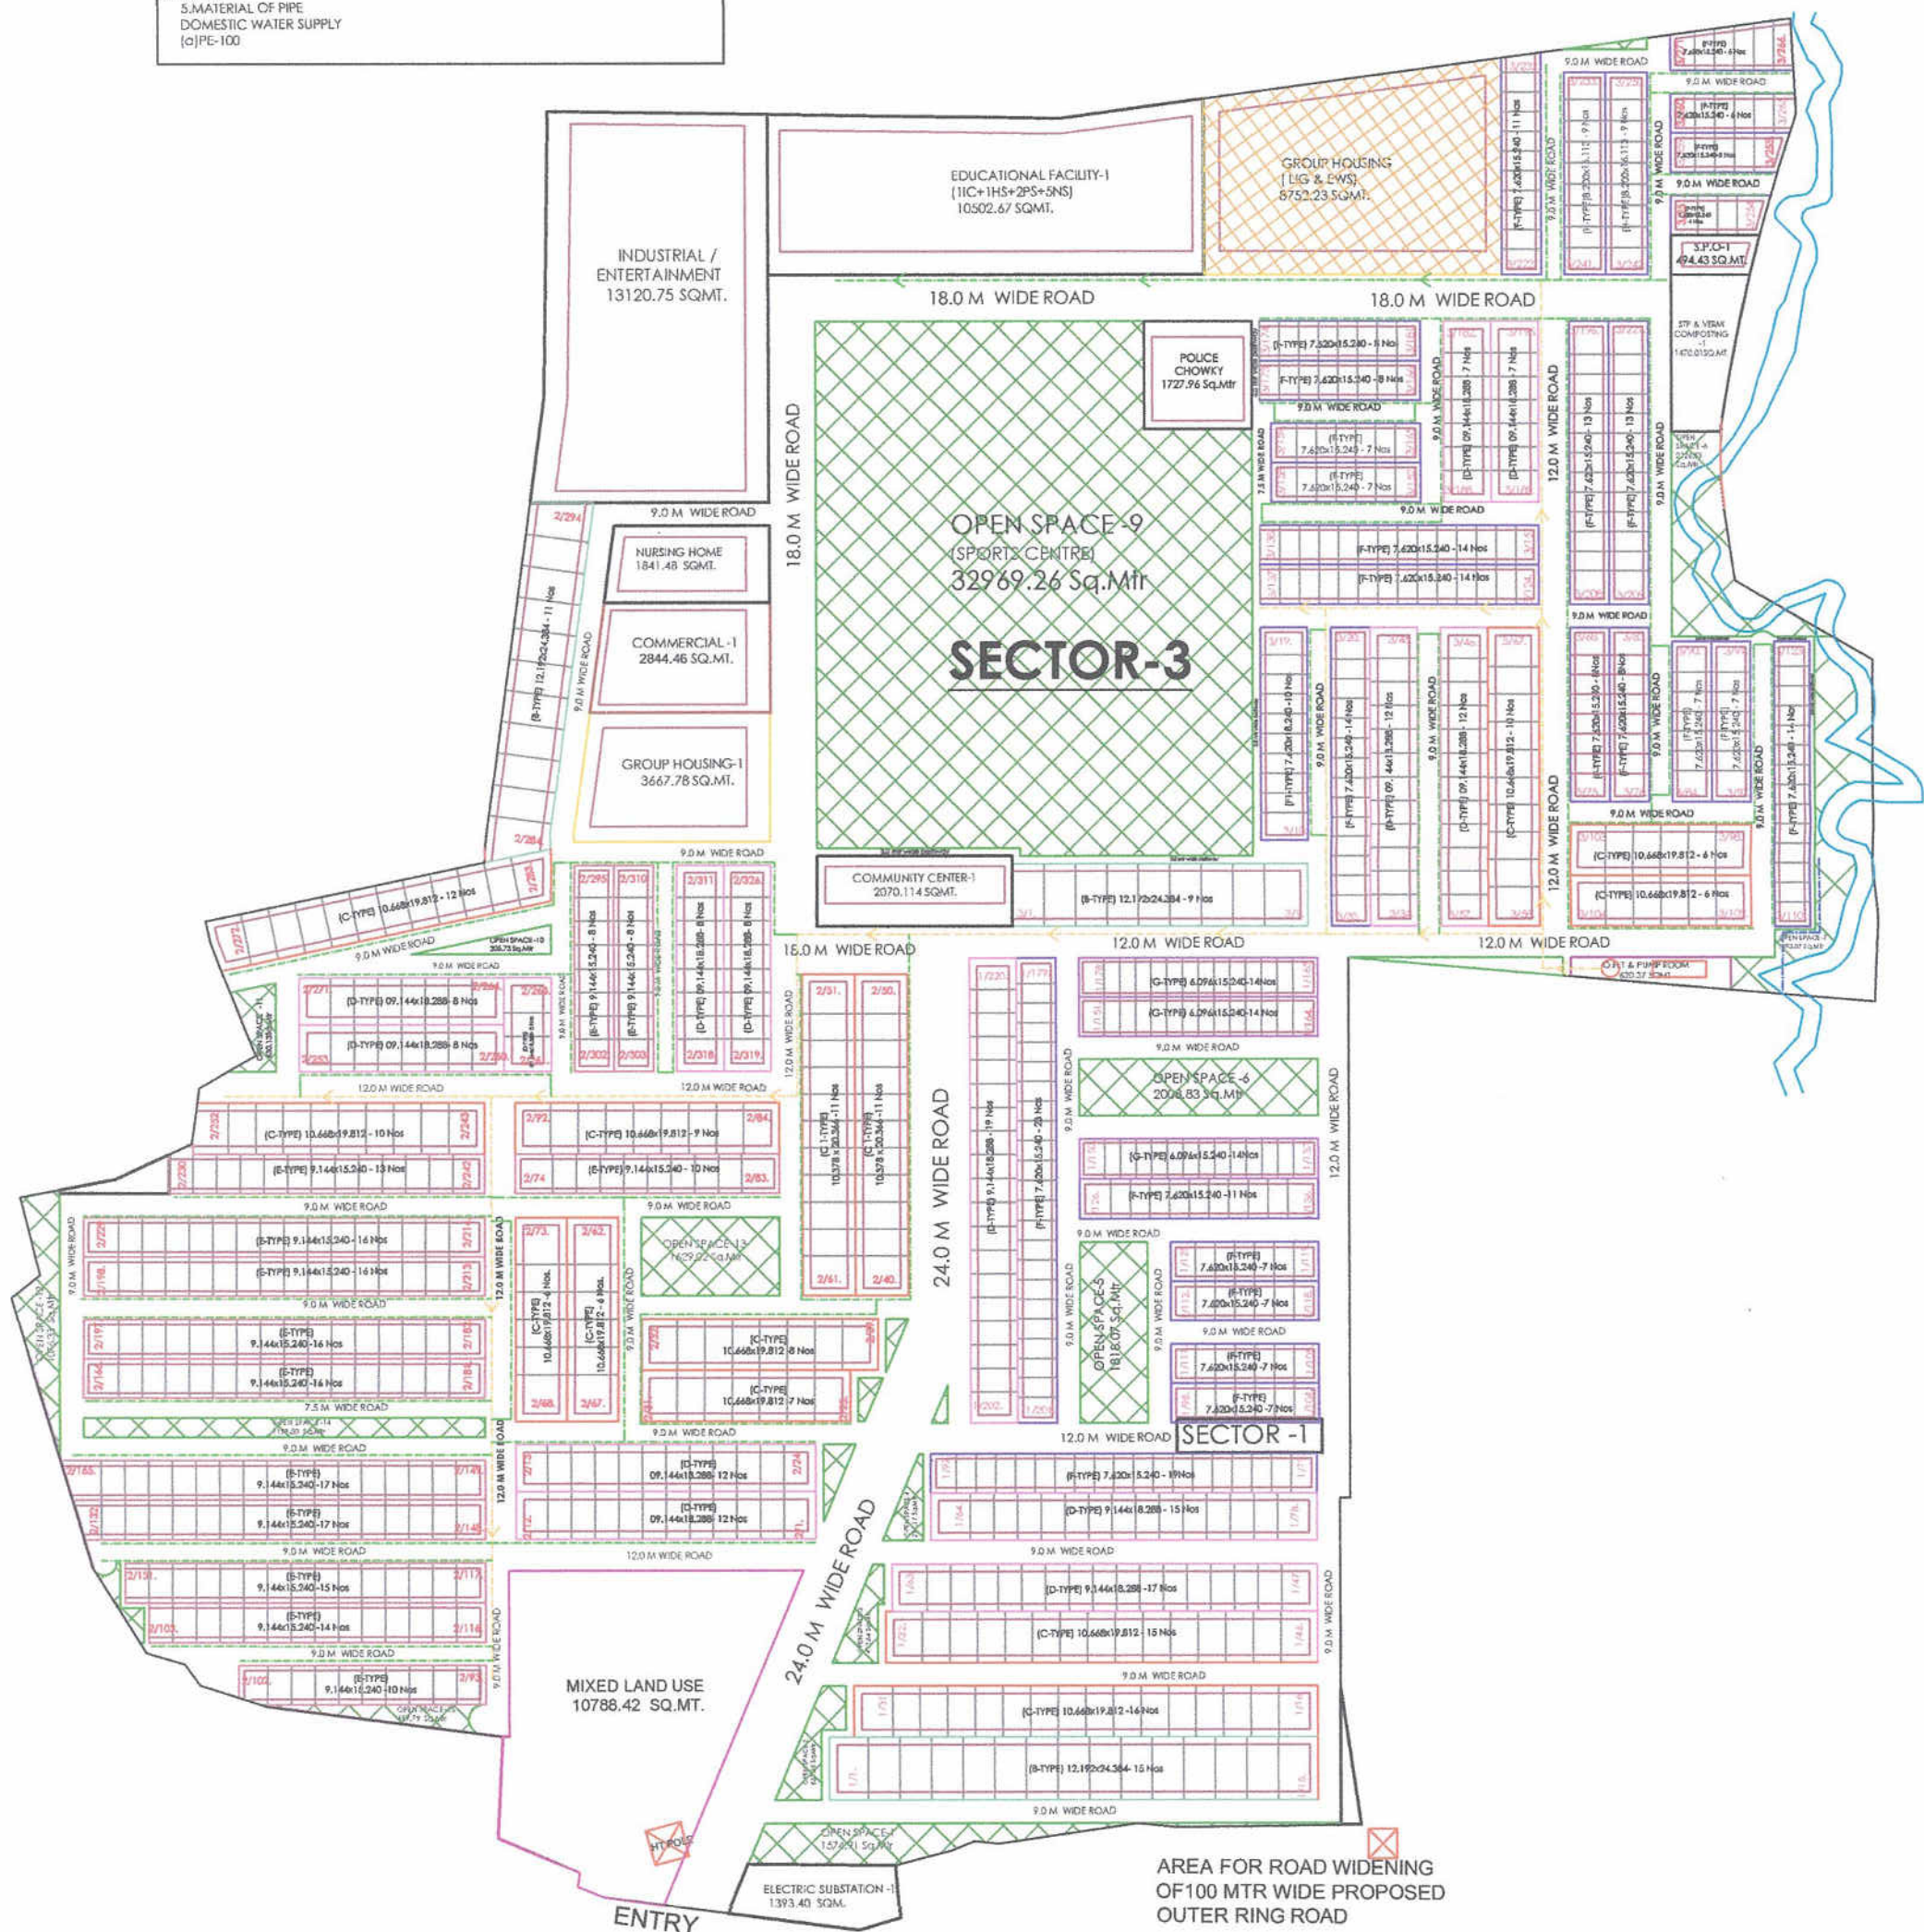

DOMESTIC AND WATER SUPPLY

SIGNATURE PARK

AN INTEGRATED TOWNSHIP AT SULTANPUR ROAD, LUCKNOW.

NORTH:-

DATE:-
JANUARY 2022

SCALE:-
N.T.S.

ARCHITECT PLANNER
AR. MAYANK GUPTA


CLIENT:-
M/S SWASTIK MULTITRADE PVT LTD
(A UNIT OF 100 GROUPS OF COMPANIES)

CONSULTANT:-



DOMESTIC WATER SUPPLY LEGENDS		
S.NO.	SYMBOL	DESCRIPTION
1	---	63 OD PE-100 IRRIGATION WATER SUPPLY
2	---	90 OD PE-100 IRRIGATION WATER SUPPLY
3	---	90 OD PE-100 TUBE WELL WATER SUPPLY
4	---	110 OD PE-100 TUBE WELL WATER SUPPLY
5	□	VALVE CHAMBER 600X800X750 MM

NOTES:
 1. FLUSHING SHALL BE PROVIDED IN EACH MANHOLE WHICH IS DEEPER THAN 800 M.M.
 2. FOR ANY DISCREPANCY/COMMISSION THE MATTER SHOULD REFER TO THE CONSULTANT BEFORE EXECUTION
 3. THE STRUCTURE DESIGN OF CHAMBER/PIPE BEDDING AS FILLED UP SOIL/BLACK COTTON SOIL/HIGH SUB SOIL CONDITION
 4. CHAMBER COVER SHOULD BE FINISHED FORMATION LEVEL AS PER LAND SCAPE DRAWING.
 5. MATERIAL OF PIPE
 DOMESTIC WATER SUPPLY
 (a) PE-100

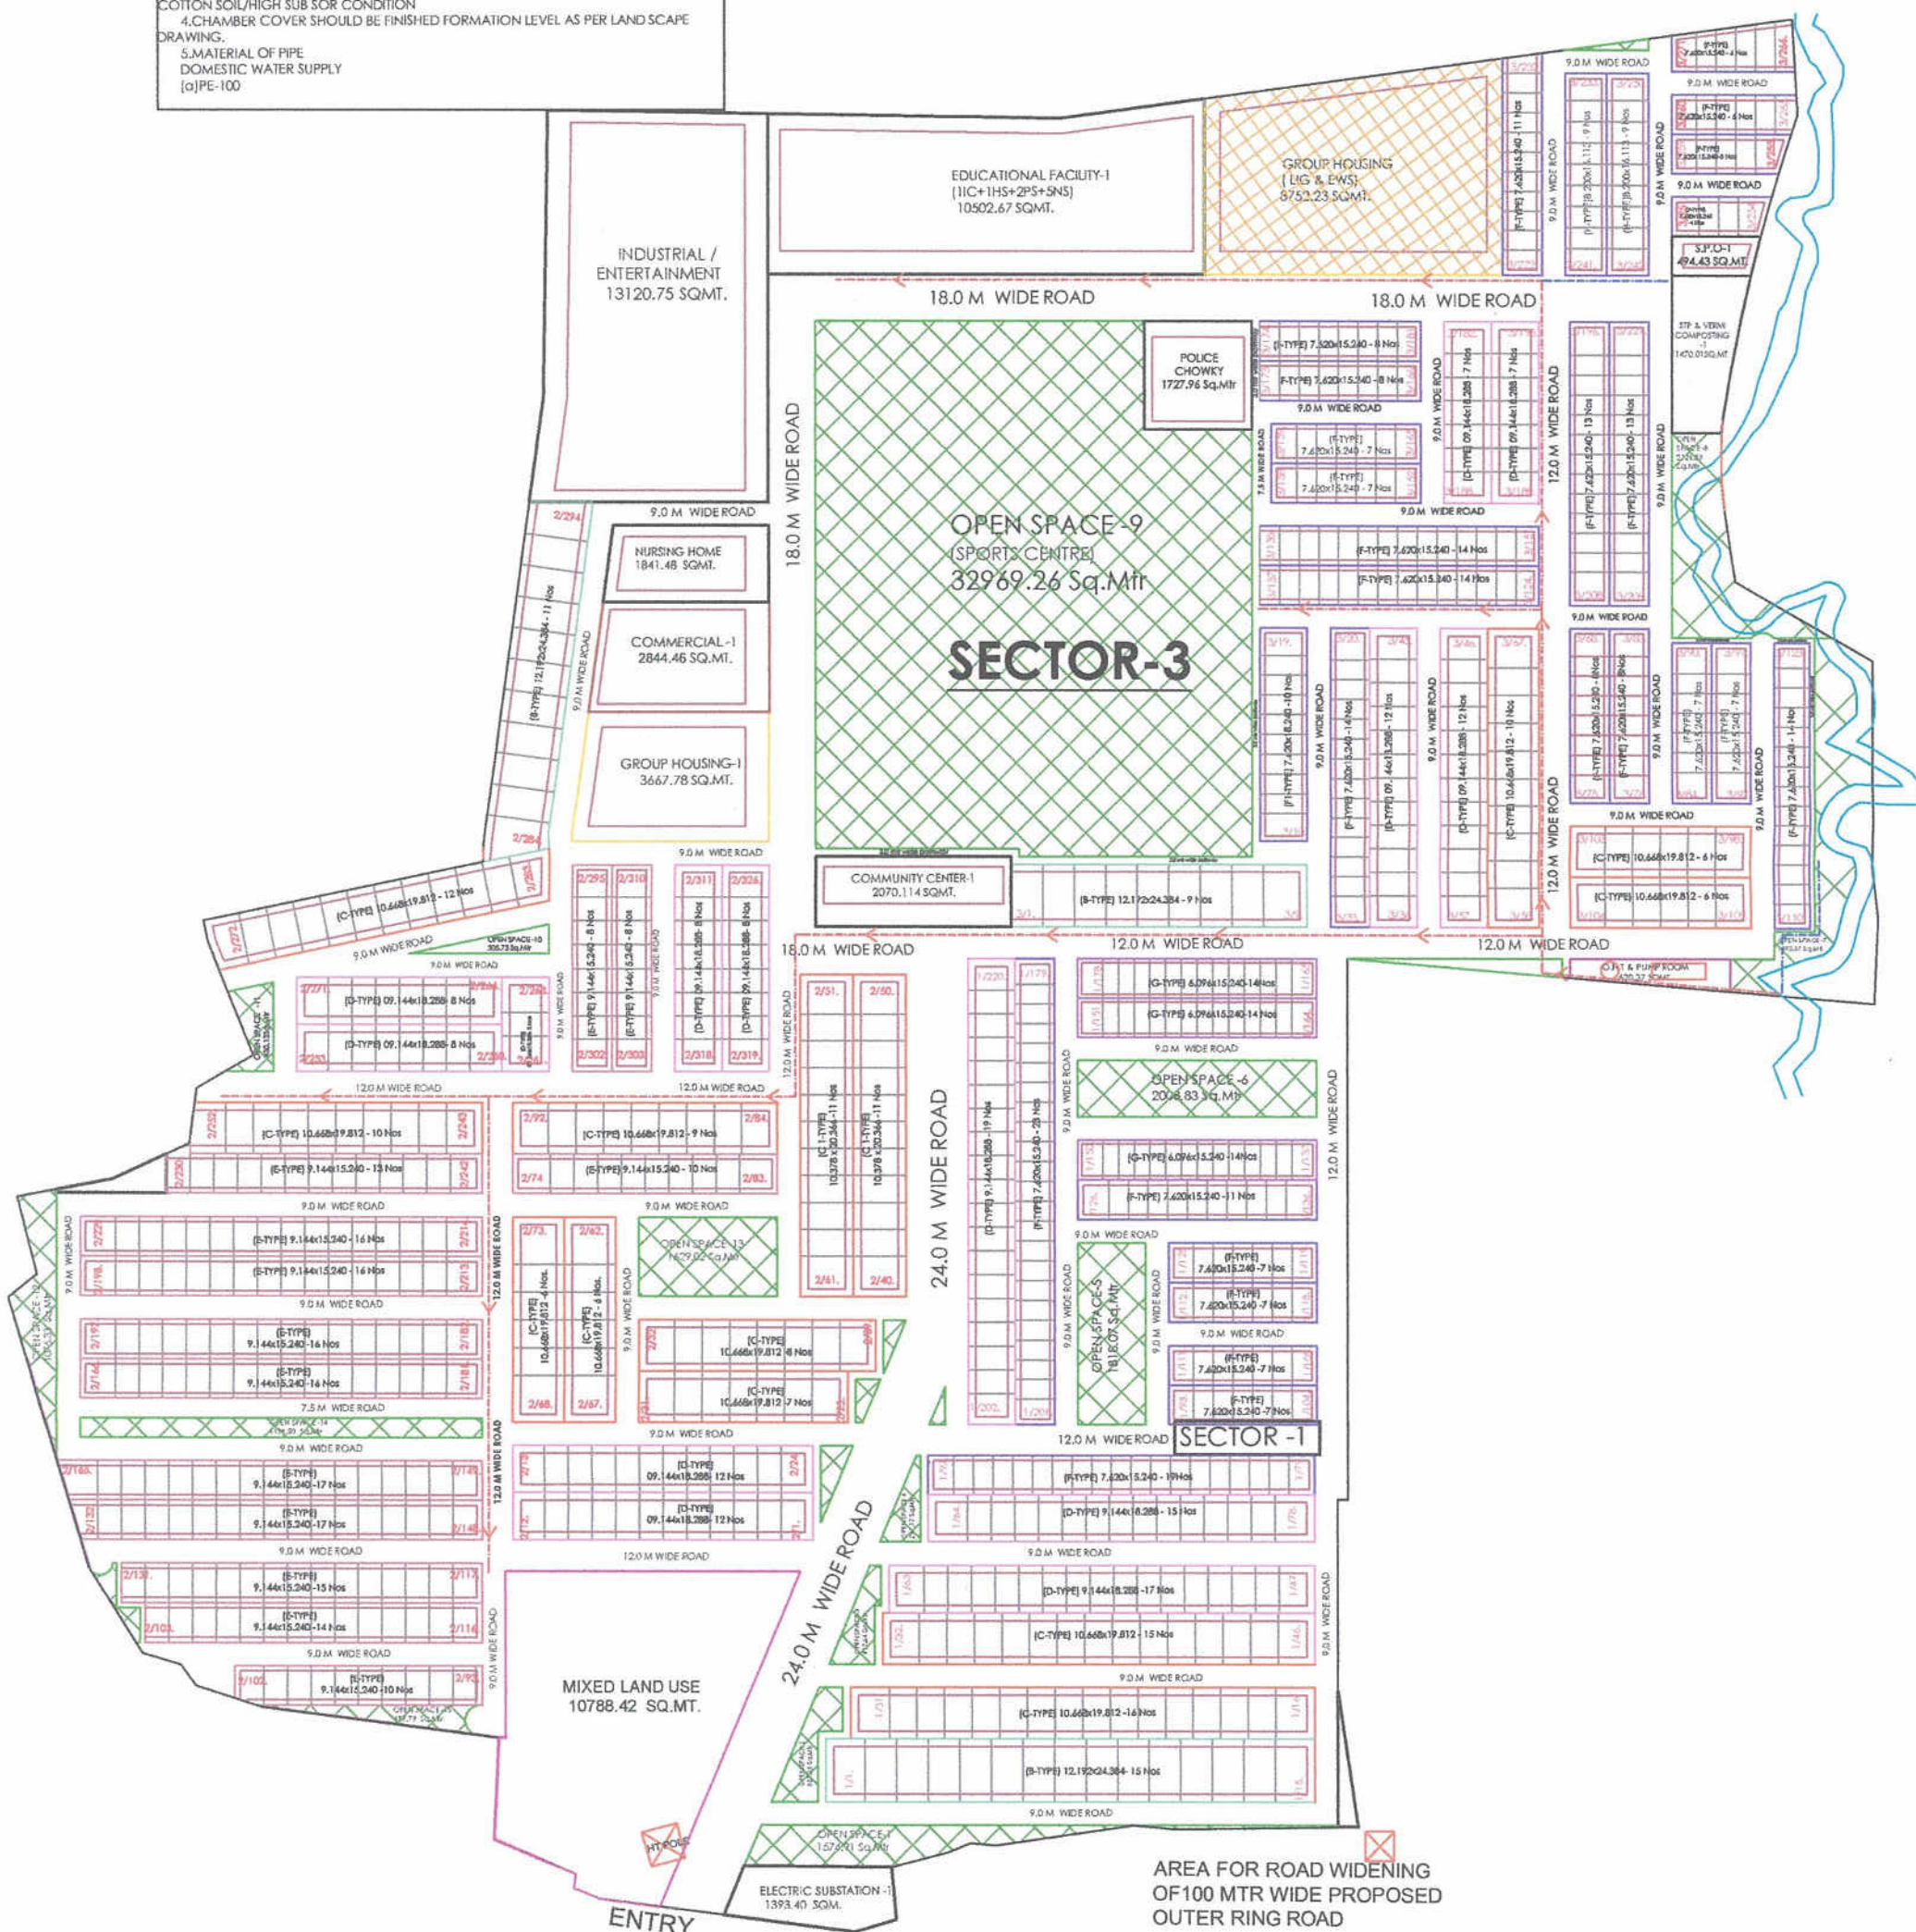

IRRIGATION AND TUBE WELL WATER SUPPLY WORK

SIGNATURE PARK

AN INTEGRATED TOWNSHIP AT SULTANPUR ROAD, LUCKNOW.

NORTH:-

DATE:-

SCALE:-

N.T.S.

ARCHITECT PLANNER

AR. MAYANK GUPTA

CLIENT:-

M/S SWASTIK MULTITRADE PVT LTD

(A Unit of 90 group of Companies)

CONSULTANT:-

COMPASS DESIGN
Architects
LUCKNOW

13/1/2022