


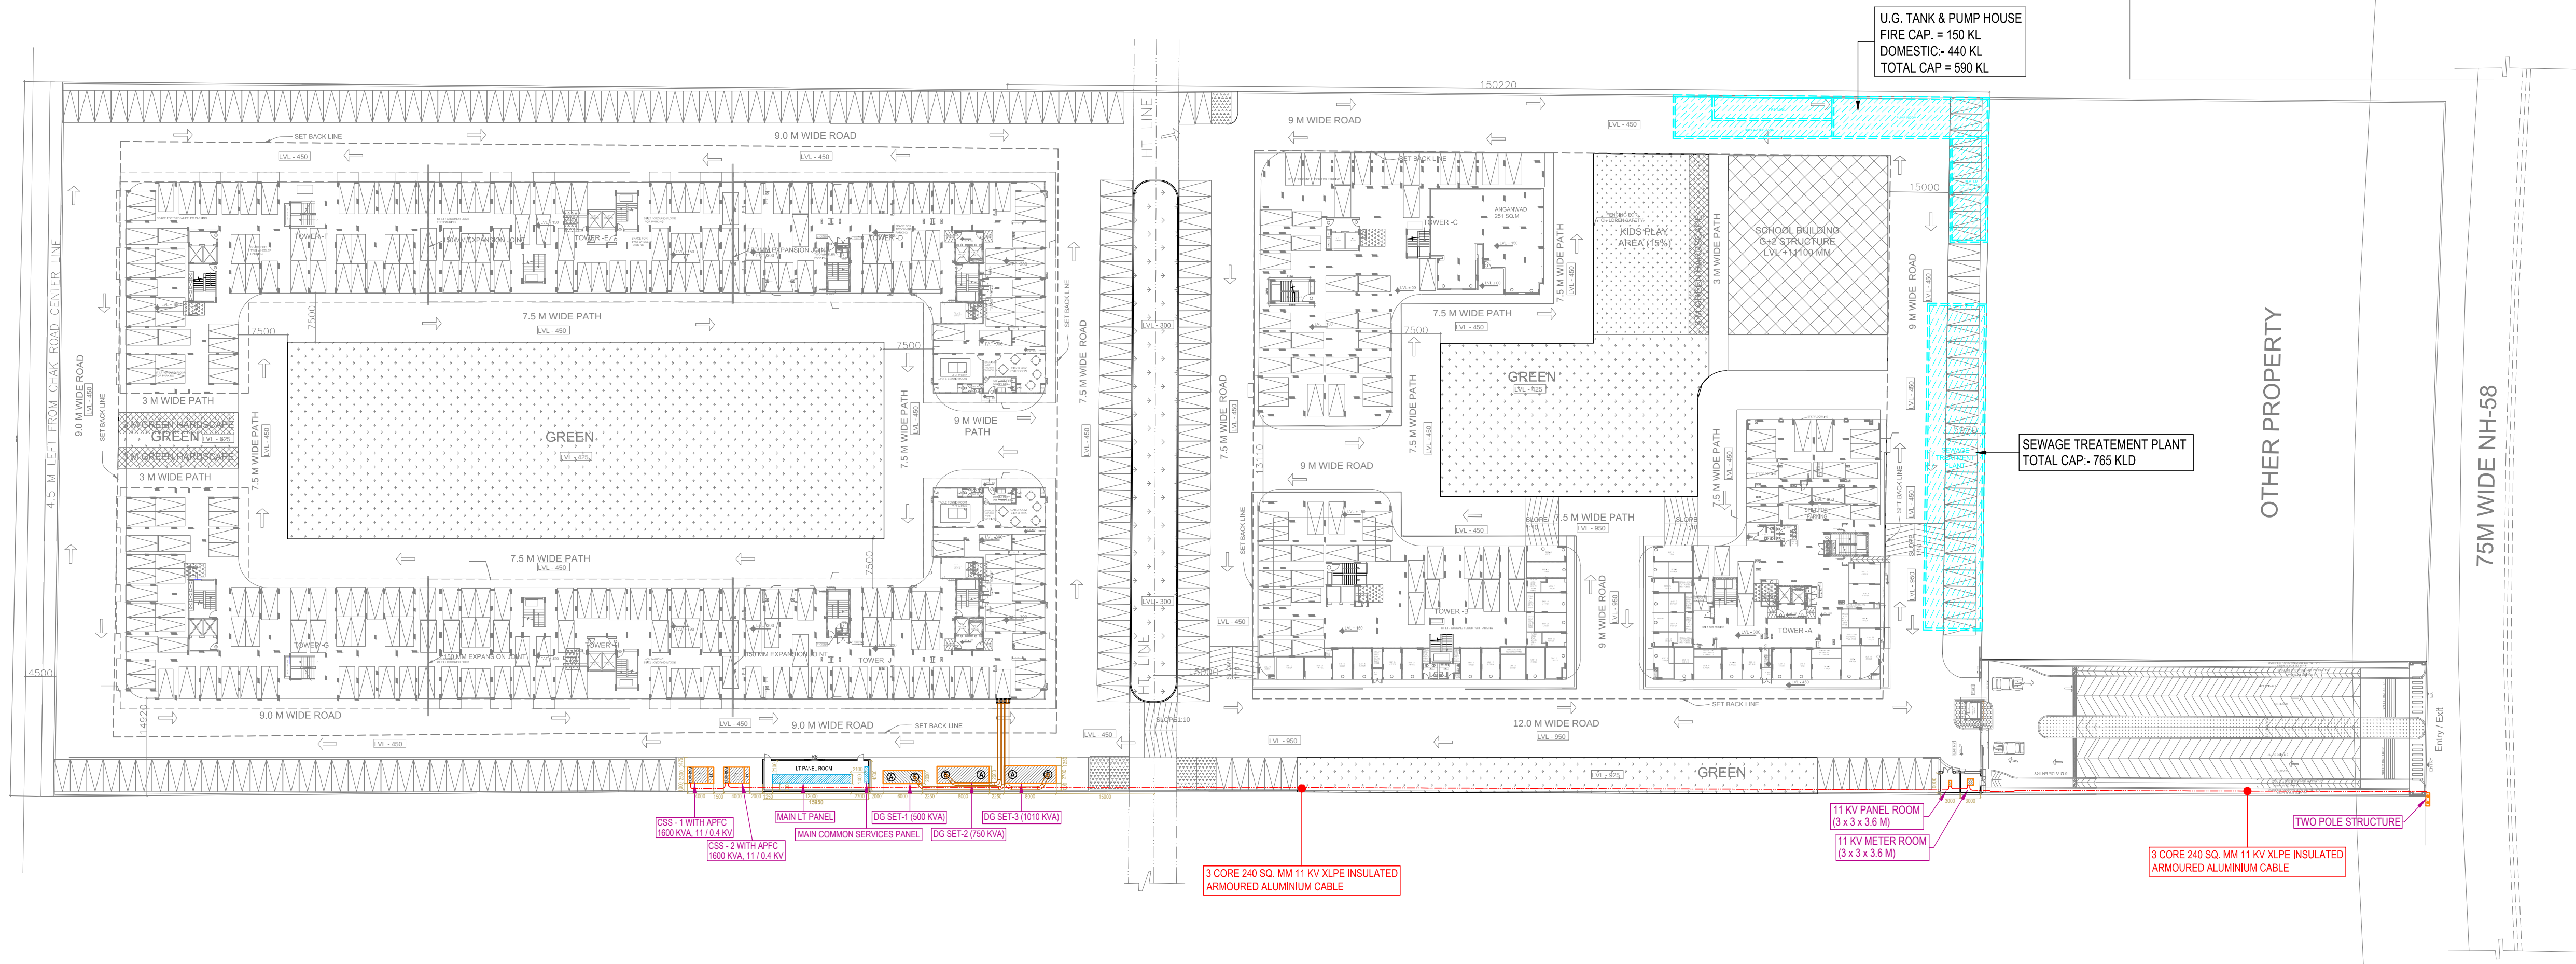

- NOTES : ( ELECTRICAL SYSTEM )**
- CLEAR HEIGHT OF 11 KV PANEL ROOM & LT PANEL ROOM SHALL BE MINIMUM 3.6 MTR.
  - FLOOR LEVEL OF 11 KV PANEL ROOM & LT PANEL ROOM SHALL BE 450 MM ABOVE FINAL FINISHED GROUND LEVEL OF INTERNAL ROAD

| Rev. No. | Date | Revision |
|----------|------|----------|
| ..       | ..   | ..       |

Project :  
**LANDCRAFT METRO HOMES**  
UNDER SAMAJWADI AFFORDABLE GROUP  
HOUSING SCHEME AT KHASRA NOS. - 613M, 614M,  
615 VILLAGE BASANTPUR TEHNSIL  
MODINAGAR, GAZIABAD,UTTAR PRADESH

Title :  
**LAYOUT PLAN**

SubTitle :  
**EXTERNAL ELECTRICAL SYSTEM**

Drawing Released For :  
☐ APPROVAL ☒ SUBMISSION  
☐ ADVANCE COPY ☐ CONSTRUCTION

Drg. No : LCMH / EE -01

Scale : 1 : 600 Drawn By : Mandeep

Date : July 2017 Design By : M. Sadiq

Ckd By : Anand Havela

Architects :  
**National Architect & Engineers**  
195 RAM VIHAR,NEW DELHI-110092  
PHONE / FAX :- 42518322,22371102 , E mail :- info@nae.co.in

Services Consultant :  
**Consummate Engineering Services (P) Ltd.**  
Noida Office : B - 67, Sector - 67, Noida - 201 301  
Tel : (0120) 6943500 ( 24 Lines )  
Lko. Office : R 006, Rohas Plumeria, Gomti Nagar, Lucknow  
e mail : mail@cespl.in, website : www.cespl.in