



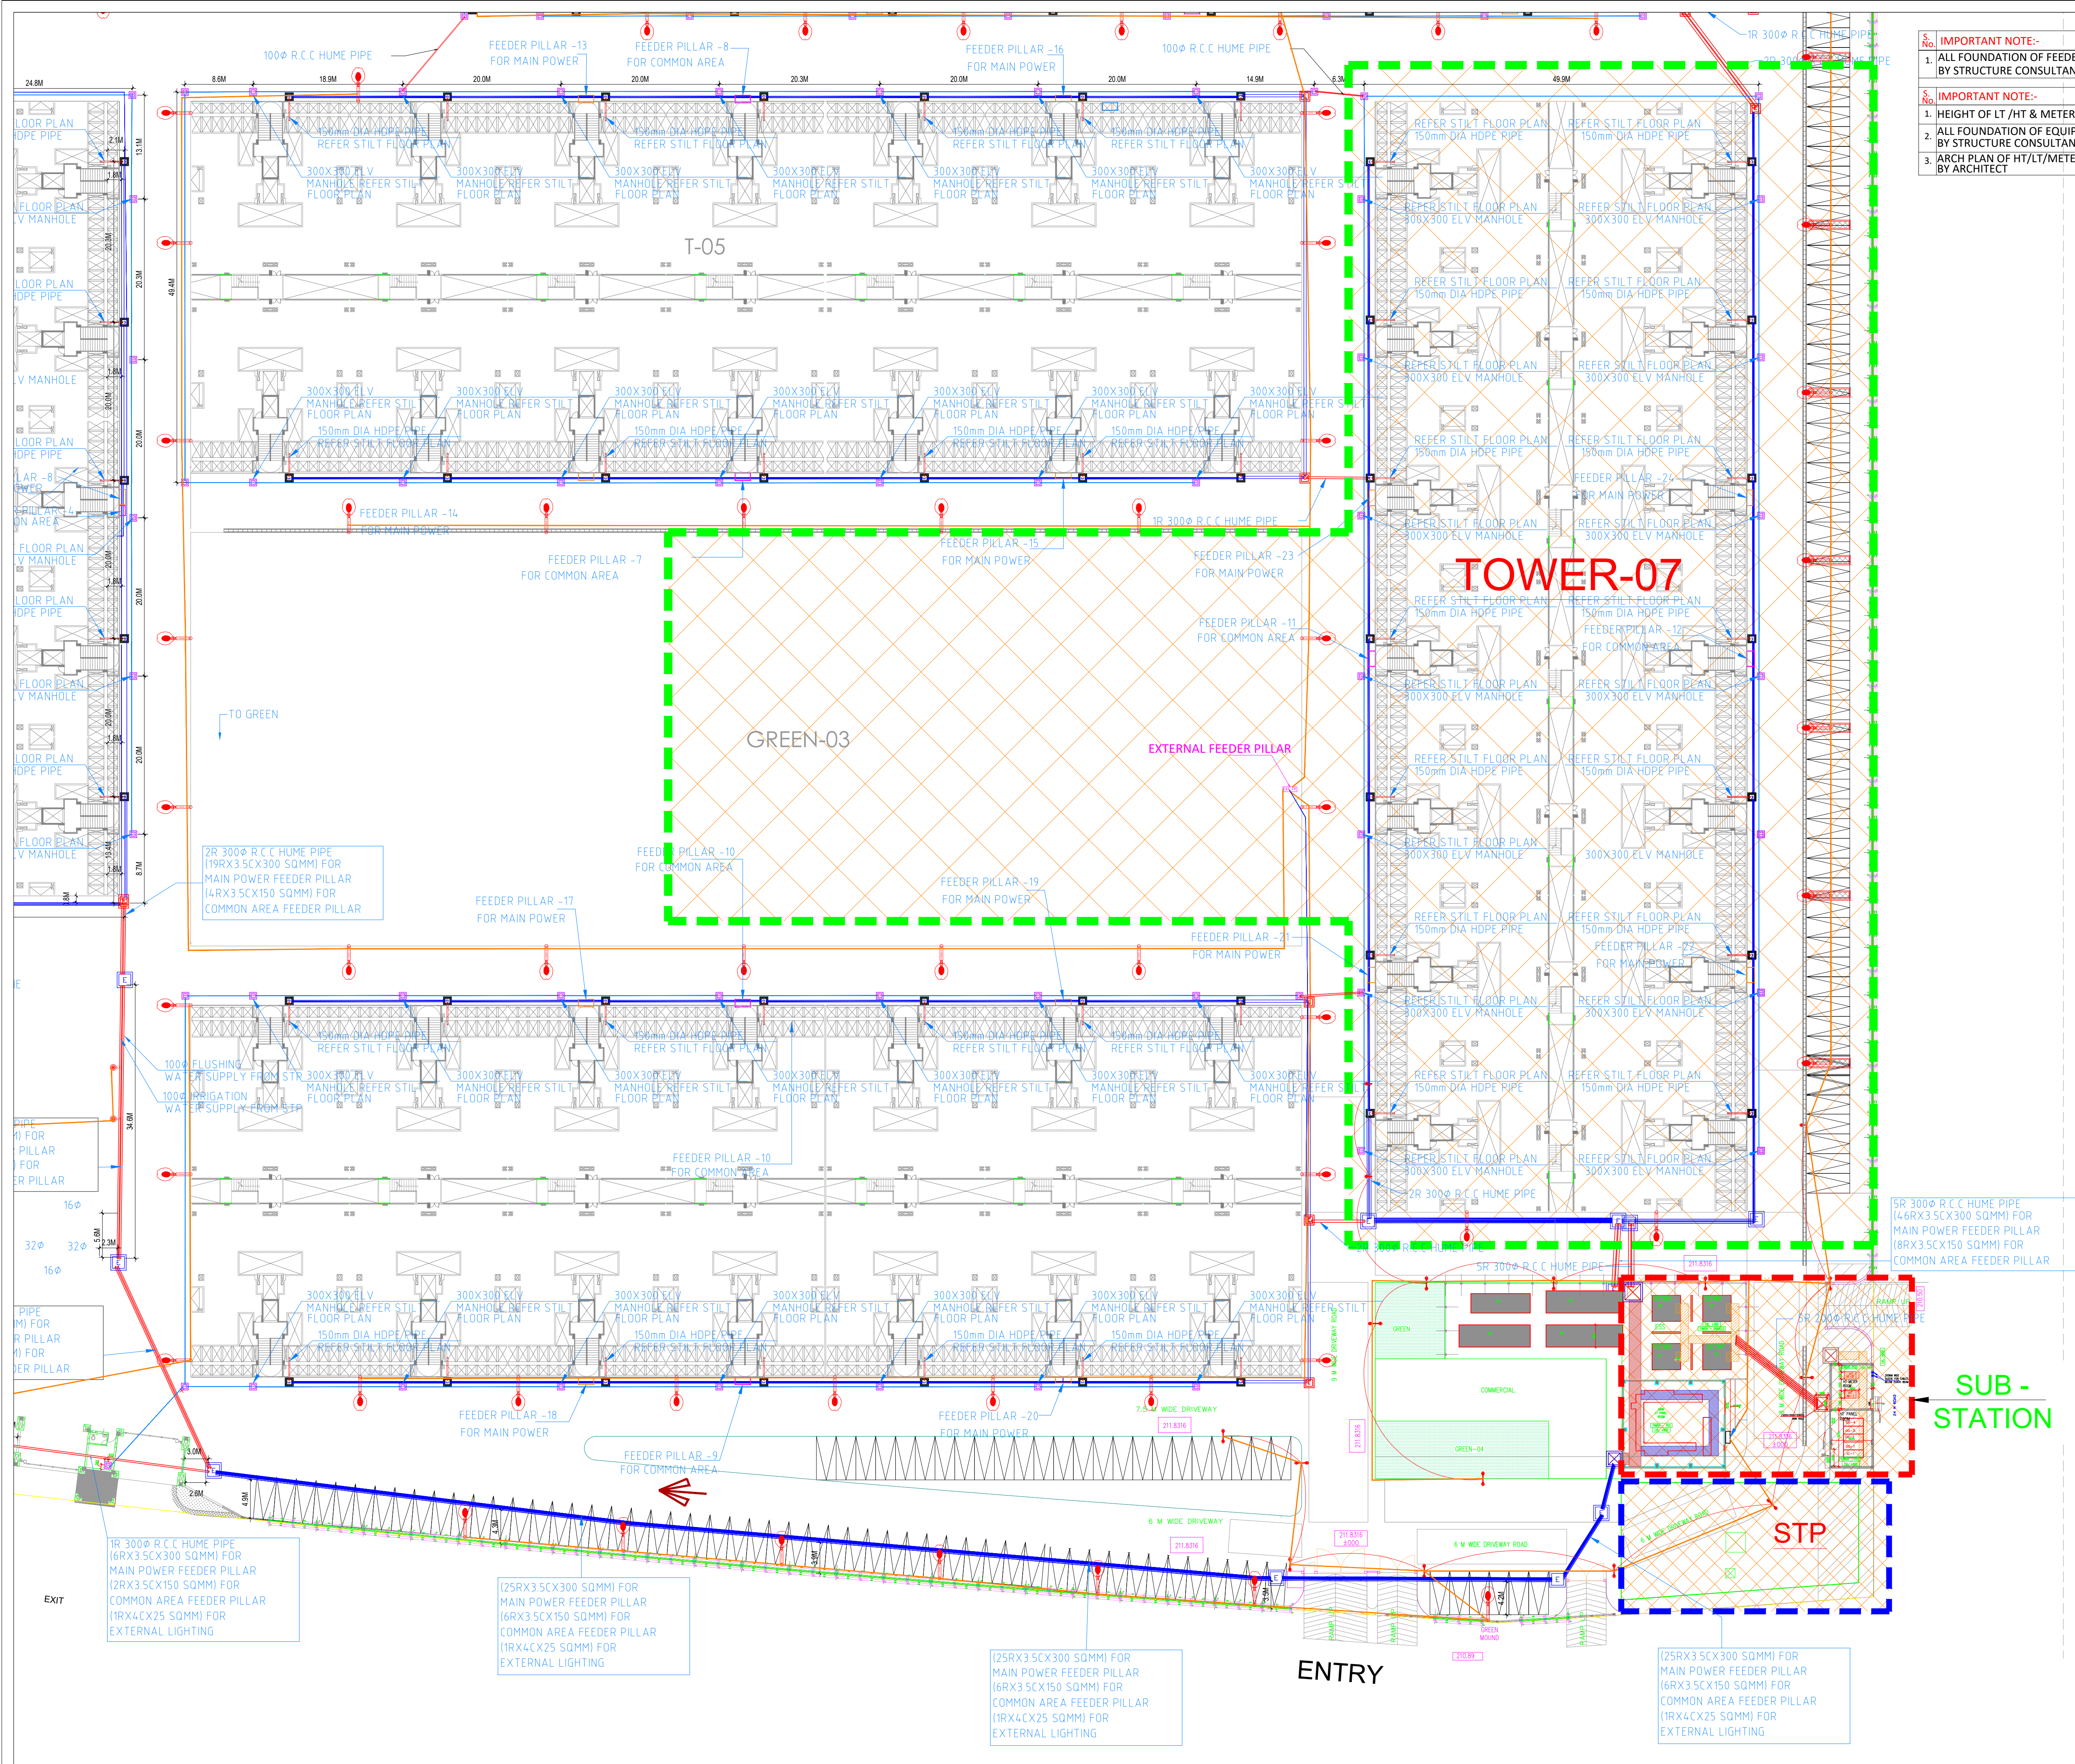

S.No. IMPORTANT NOTE:-
1. ALL FOUNDATION OF FEEDER PILLAR SHALL BE DESIGNED BY STRUCTURE CONSULTANT AS/VENDOR INPUT

S.No. IMPORTANT NOTE:-
1. HEIGHT OF LT /HT & METER PANEL ROOM SHALL BE 4.0 M
2. ALL FOUNDATION OF EQUIPMENT SHALL BE DESIGNED BY STRUCTURE CONSULTANT AS/VENDOR INPUT
3. ARCH PLAN OF HT/LT/METER ROOM SHALL BE ISSUED BY ARCHITECT

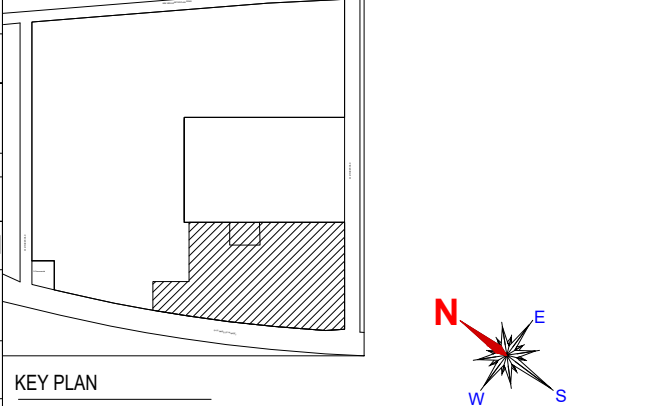

- NOTES & Code Reference**
- 1-ALL DIMENSION ARE IN MM UNLESS OTHERWISE SPECIFIED.
 - 2-MINOR MODIFICATIONS CAN BE DONE IN PIPE ROUTING TO SUIT SITE CONDITION.
 - 3-ALL THE INSTALLATIONS SHALL BE DONE AS PER APPROVED & RECOMMENDED COMMENTS
 - 4-MATERIAL SPECIFICATION OF PIPES AND FITTINGS AS PER APPROVED DATA SHEET
 - 5-ALL SEWER AND DRAIN LINE SHALL BE LAID ON PCC BED.
 - 6-ALL BURIED PIPES SHALL BE TESTED FOR LEAKAGES AND STRAIGHTNESS AS PER SPECIFICATION.
 - 7-TRENCH SHALL BE REFILLED ONLY AFTER PIPE TESTING.
 - 8-ALL DRAIN LINE SHALL BE LAID IN S & S RCC (NP2) PIPE CONFORMING TO IS : 458
 - 9-ALL EXTERNAL SEWER LINE (MANHOLE TO MANHOLE CONNECTION) SHALL BE LAID IN Class-SN4 DWC PIPE (PIPES AND FITTINGS AS PER IS : 16058)

LEGEND :-		
S.No.	SYMBOL	DESCRIPTION
1.		LT CABLE BURIED IN GROUND @-1.2M TO -1.5M DEEP AS PER SITE CONITION
2.		LV CABLE (OPTICAL FIBER) OR 40MM DIA HDPE PIPE BURIED IN GROUND @-0.75M TO -1.0M DEEP AS PER SITE CONITION
3.		EXTERNAL LIGHT CABLE / HDPE PIPE
4.		600X600 ELECTRICAL MANHOLE
5.		1000X1000 ELECTRICAL MANHOLE
6.		1500X1500 ELECTRICAL MANHOLE
7.		300X300 LV MANHOLE
8.		R.C.C. HUME PIPE
9.		SEWAGE MANHOLE
10.		DRAINAGE MANHOLE
11.		DRAINAGE & SEWAGE LINE

- NOTE:**
- PLEASE CONSIDER CABLE ROUTE LAYOUT FOR TOWER NOS. 1,2 & 3
 - DISTANCE OF CABLE 1.8M FROM BUILDING LINE

REV.NO.	DATE	DESCRIPTION

CLIENT:
WAVE INFRATECH PVT. LTD.

PROJECT:
VERIDIA AT OAKWOOD ENCLAVE WAVE CITY

Architect :
Wave Infratech Pvt. Ltd.
C-1, Sector-3
Noida, U.P. 201301
TEL: +91 120 4180500

Structure Consultant
Consulting Structural Engineers
 G-70, 2nd FLOOR, JASWANT PLAZA, NEAR KALINDI KUNJ, OKHLA, NEW DELHI-110025
PHONE NO. :- +91-11-26940734/5/6/7/8
FAX: 26940738
E-Mail : nnc_consultants@hotmail.com
Web : www.nncdesigninternational.com

MEP CONSULTANT
 PKV Consulting Engineers (P) Ltd.
C-815, DDA Flats, Loni Road, Delhi -110093
TELEFAX :- 011-22816297
E-mail:- pramod@pkv.co.in
info@pkv.co.in

DRAWING TITLE:-			
VERIDIA TOWER-7 SUB STATION & CABLE ROUTE LAYOUT			
STATUS	SHOP DRAWING	NORTH	REV NO.
DATE :	13-07-2022		R0
DEALT BY :	AMIR		
CHKD BY :	A.K.JHA	DRAWING NO.	
SCALE :	1:325 @ A-0	SSA-EL-EXT-01	