

**SUBSTATION - 02**

- 3 VCB PANEL
- 33 / 0.415 KV  
1 no. 1600 KVA T/F
- 33 / 0.415 KV  
1 no. 1600 KVA T/F
- 1 No. 600 KVA DG SET

DG EXHAUST PIPE SHALL RUN FROM FIRST FLOOR ROOF LEVEL

ALL DG EXHAUST PIPE RUN UP TO THE TERRACE WITH CLAMPING SUPPORT OVER WALL

4 no. DG Exhaust pipe of 300 mm Ø (ID) 450 mm Ø (OD) with 75 mm Insulation all around.

**SUBSTATION - 01**

- 1 No. 600 KVA DG SET
- 33 / 0.415 KV  
1 no. 1600 KVA T/F
- 33 / 0.415 KV  
1 no. 1600 KVA T/F
- 4 VCB PANEL
- 33 KV HT METER

DG EXHAUST PIPE SHALL RUN FROM FIRST FLOOR ROOF LEVEL

ALL DG EXHAUST PIPE RUN UP TO THE TERRACE WITH CLAMPING SUPPORT OVER WALL

4 no. DG Exhaust pipe of 300 mm Ø (ID) 450 mm Ø (OD) with 75 mm Insulation all around.

FFL OF ROOM SHOULD BE MINIMUM +450 FROM SURROUNDING LEVELS.

LT PANEL LOCATED AT GROUND LEVEL


CAPACITOR PANEL - 01

CAPACITOR PANEL - 02

COMMERCIAL G+2

SEWAGE TREATMENT PLANT CAP - 780 KLD

U.G. TANK & PUMP HOUSE TOTAL CAP - 750 KL FIRE - 500 KL DOMESTIC - 450 KL

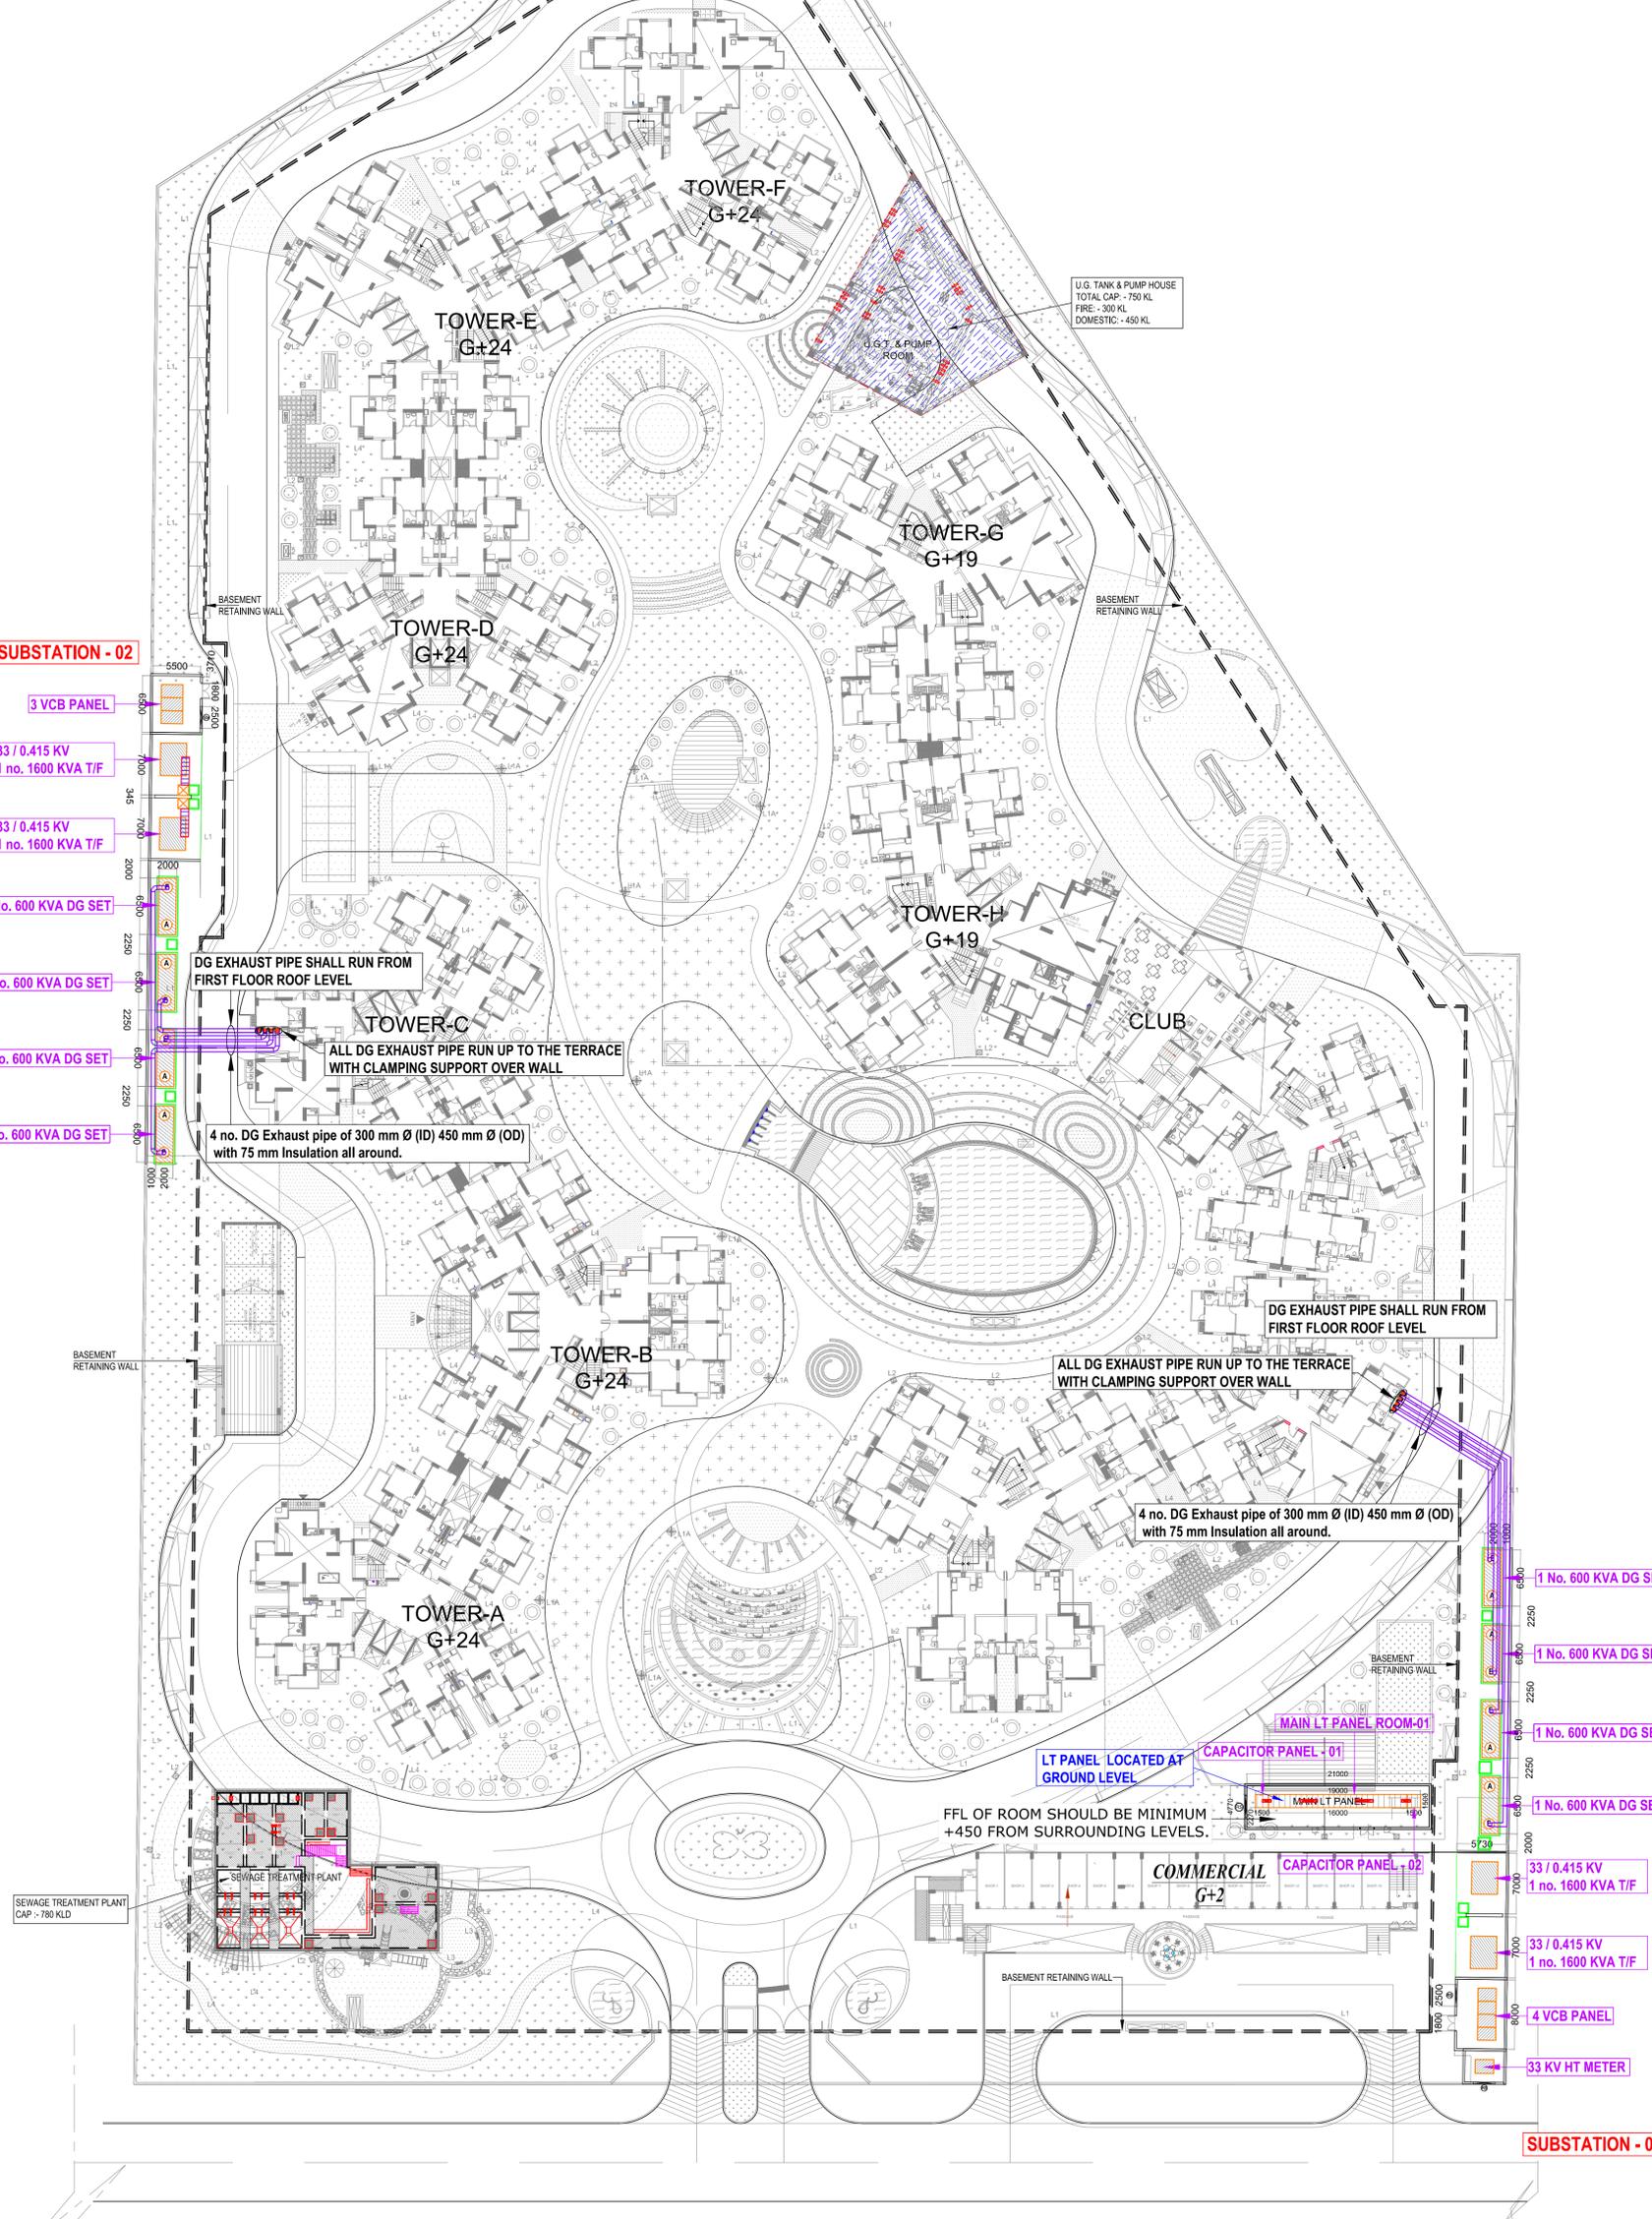

rev. no.	date	revision

project  
**PLOT NO - GH - 09C, D.V. TECH ZONE-4 GREATER NOIDA ( U.P)**

title  
**LAYOUT PLAN**

subtitle  
**ELECTRICAL SETTING OUT PLAN**

drawing released for

- APPROVAL
- ADVANCE COPY
- SUBMISSION
- CONSTRUCTION

drg. no.  
**JMF / 13B17 / ES - 05**

scale  
**1 : 400**

date  
**26.06.2018**

drawn by  
**Prem Saini**

designed by  
**Badri Vishal**

checked by  
**Anand Havelia**

architects  
**Space Designers International**  
B-34, Sector-67, NOIDA-201301  
PH: 91-9711633717, 18, 19, 20  
e-mail : spacesdi@gmail.com, www.spacesdi.com

services consultant  
**Consummate Engineering Services (P) Ltd.**  
Noida Office : B - 67, Sector - 67, Noida - 201 301  
Lko. Office : R 006, Rohtas Plumeria, Gomti Nagar, Lucknow  
Tel : (0120) 6613500 ( 32 Lines )  
e mail : mail@cespl.in, website : www.cespl.in