
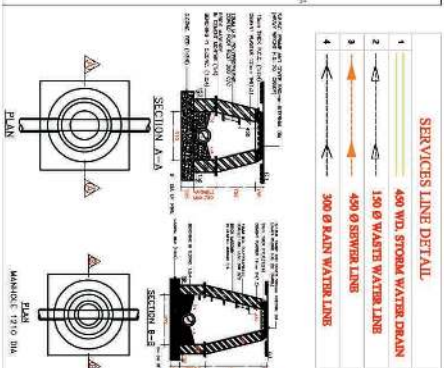
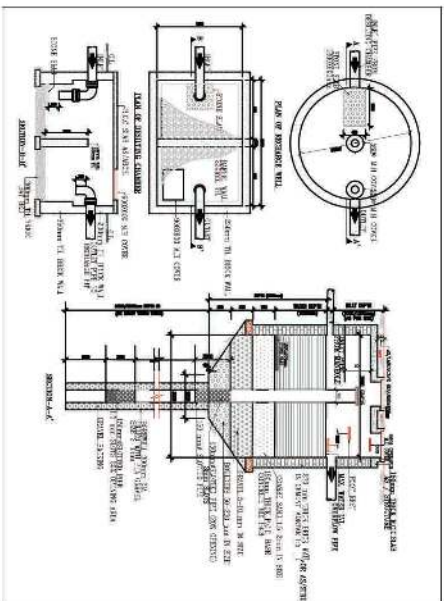


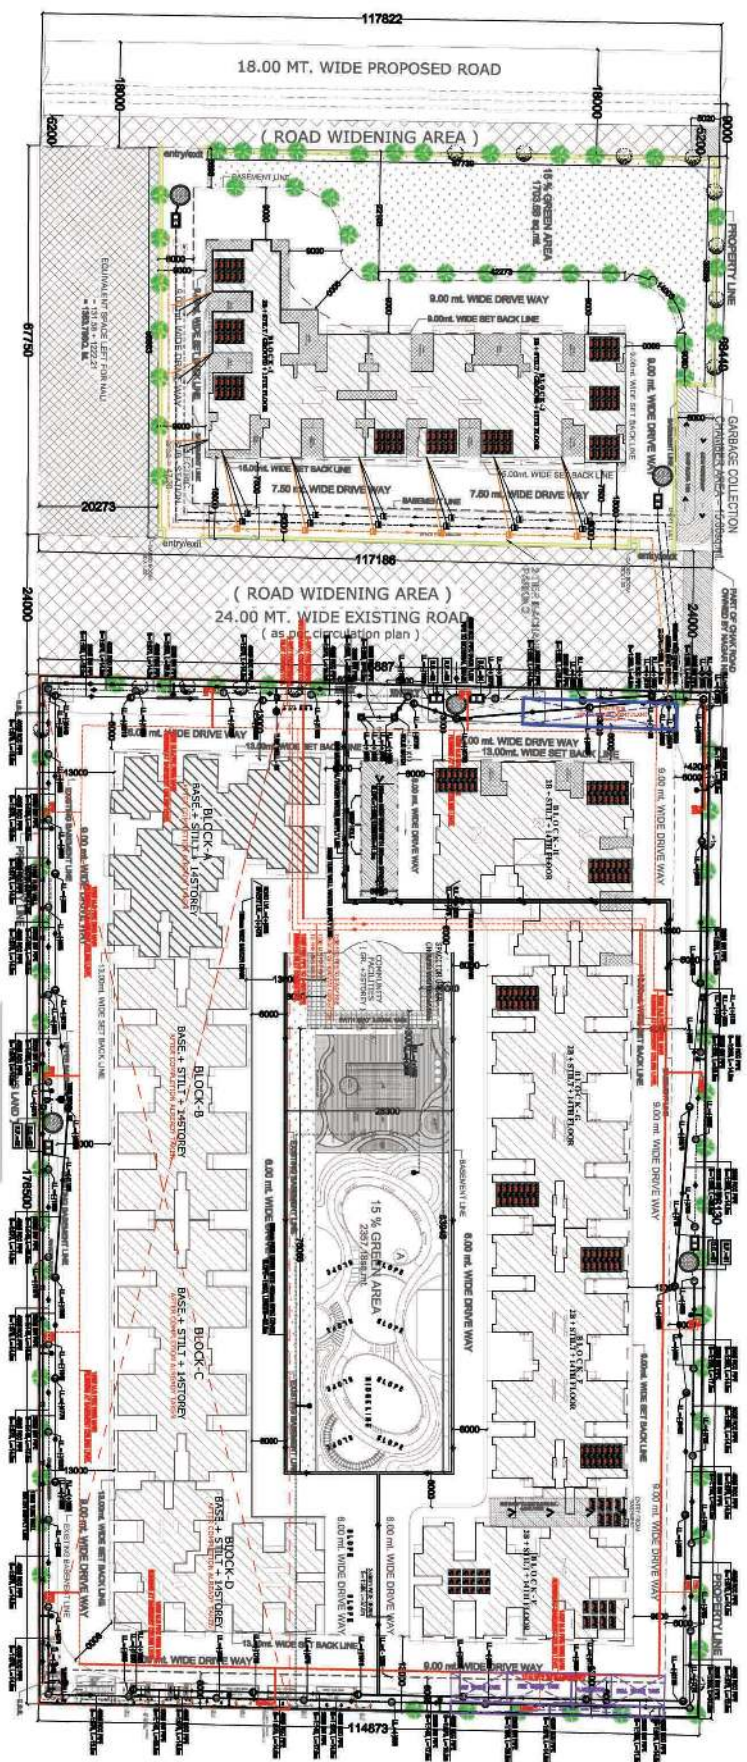

PLANNING ENERGY	
_____	EXTERNAL STORM WATER LINE
_____	DOMESTIC WATER SUPPLY / RILLING LINE
_____	FROM MUNICIPAL / RANKER LINE
_____	REGULATED WATER SUPPLY LINE
_____	TIE- IN WELL WATER SUPPLY LINE
_____	EXTERNAL FIRE HYDRANT LINE
_____	R.P.
_____	RECOVERING P.T. (2000 MM DIA)
_____	D.C.
_____	DEEP DRAIN CHAMBER (1500 X 2000 MM DIA)
_____	VALVE WITH CHAMBER
_____	NON RETURN VALVE WITH CHAMBER

PUMPING LEGEND:	
	SEWER MANHOLE WITH 6000 MANHOLE COVER
	RAIN WATER HARVESTING
	STORM WATER CATCH BASIN SIZE = Ø600x600MM
	STORM WATER MANHOLE WITH 6000 PREPARED MANHOLE COVER
(1) (II) (III)	910 DIA MANHOLE 1.070 LFT IN DEPTH 1220 DIA MANHOLE 1.250 M DEPTH 1500 DIA MANHOLE ABOVE 2.28 M DEPTH
	EXTERNAL FIRE HYDRANT
	GARDEN IRRIGATION
	GROUND LEVEL
	INVERT LEVEL
	CONNECTION LEVEL

[illegible]