
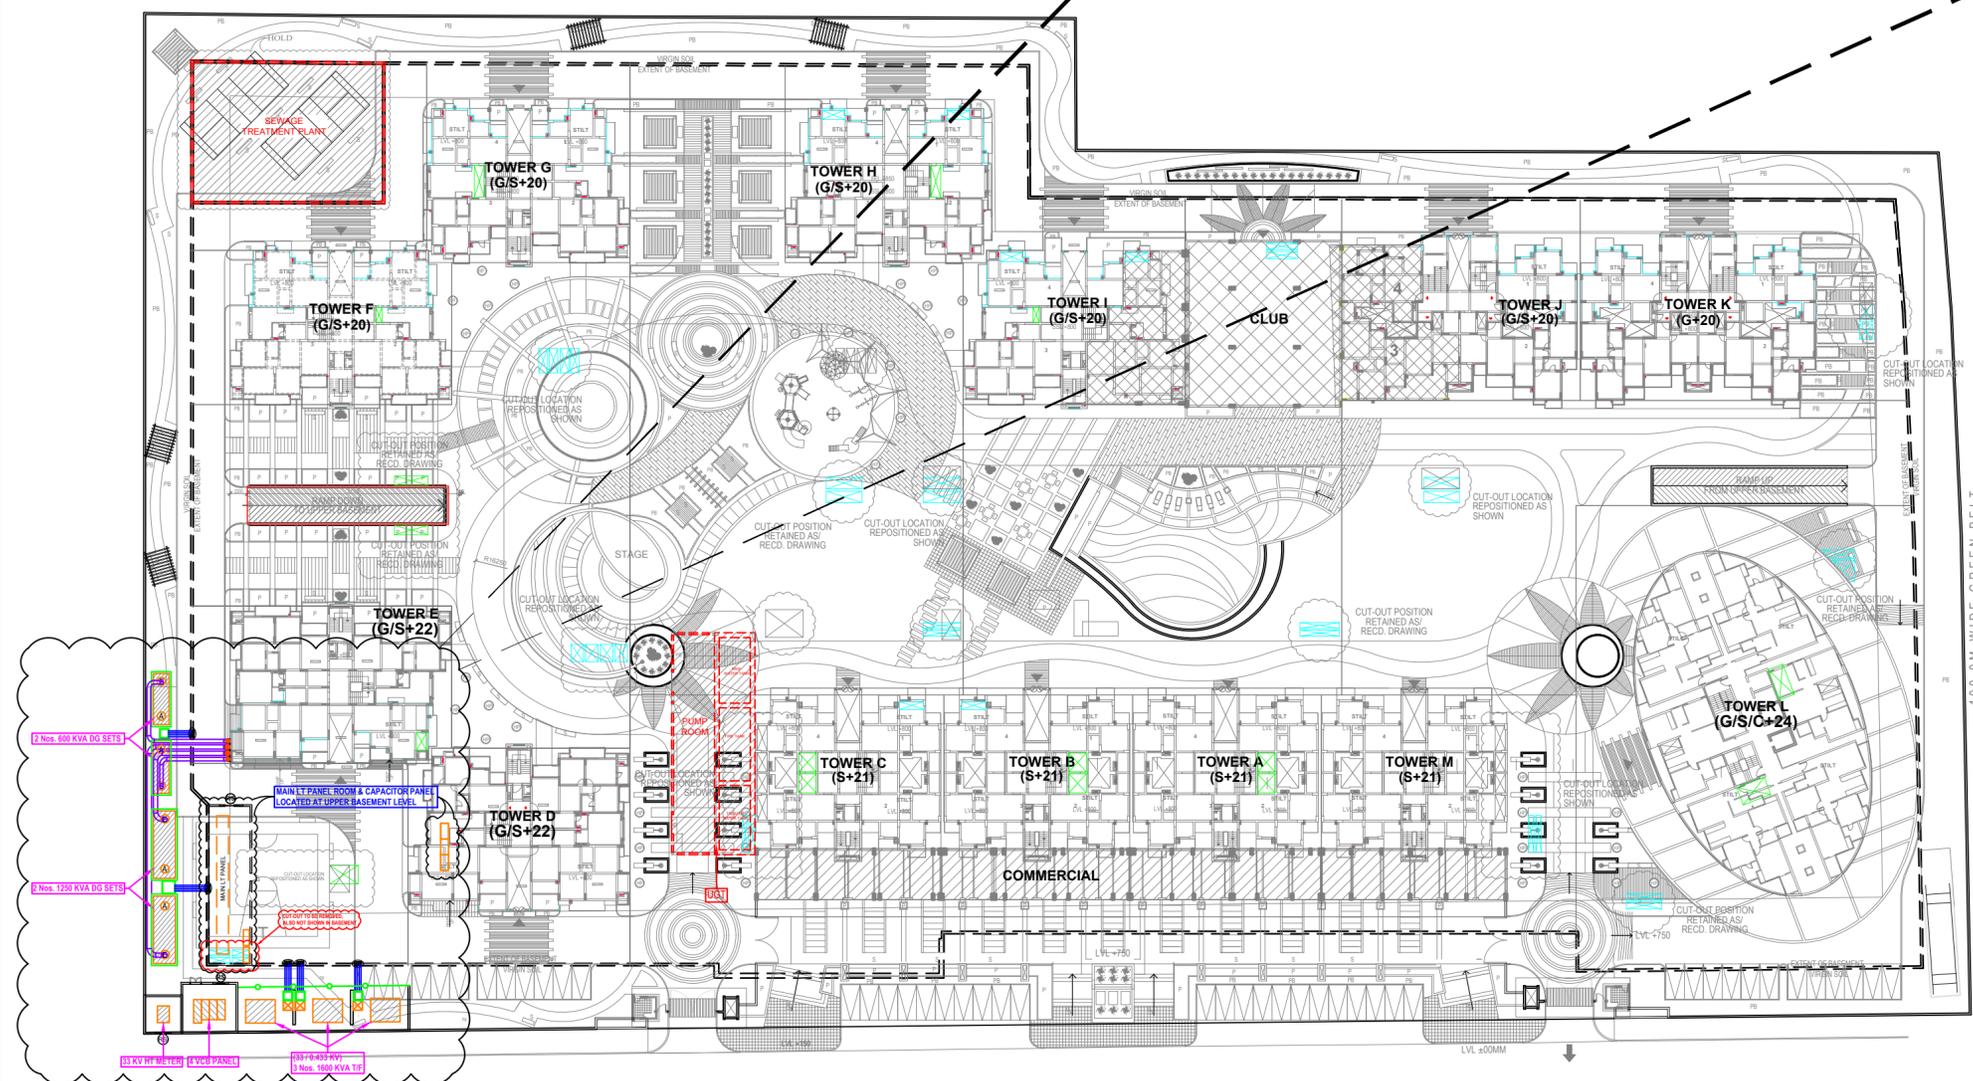
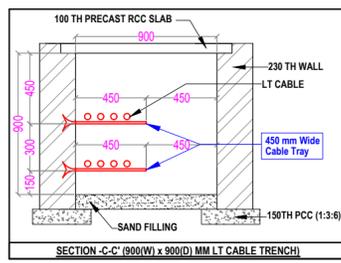


- IMPORTANT NOTES :**
1. TRANSFORMER & DG SETS FOUNDATION SHALL BE GIVEN BY VENDOR.
  2. VCB PANEL SIZE SHALL BE GOT APPROVED FROM CONSULTANT BEFORE PLACEMENT OF ORDER.
  3. EXACT LOCATION OF CABLE TRENCH SHALL BE FINALIZE AFTER GETTING THE DETAIL OF GLAND PLATE IN HT PANEL.

**NOTE :** - CLEAR HEIGHT OF ROLLING SHUTTER = 3000 MM (MIN) FROM FFL.

**NOTES : FOR HT, LT & VCB ROOM**

- 1) Clear height of 33 KV Meter room shall be minimum 3.2 mtr. below clear beam.
- 2) Plinth Level of Meter room & VCB room shall be 450 mm above final finished ground level.
- 3) Trench detail shall be finalized after receiving foundation detail of HT Meter Panel & 33 KV VCB Panel.
- 4) Ventilation is to be planned as per architecture surrounding level.

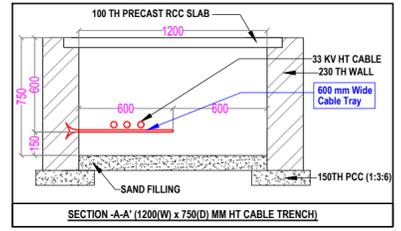

project  
**SAMRIDHI**  
AT PLOT NO-GH-09D, SECTOR- TECHZONE-IV,  
GREATER NOIDA.

title  
**ELECTRICAL DRAWING**

subtitle  
**SETTING-OUT LAYOUT  
AT SITE PLAN**

drawing released for  
 APPROVAL  RERA SUBMISSION  
 ADVANCE COPY  CONSTRUCTION

drg. no. SAM / ELEC / EXT. - 01 drawn by M. Firoz

scale 1:450 @ A1 designed by Ateeq Ur Rehman

date Apr. 2016 checked by Anand Havella

architects  
**DEEPAK MEHTA & ASSOCIATES**  
ARCHITECTS, PLANNERS, VALUERS, LANDSCAPE & INTERIORS  
PLOT NO. 16 ABHISHEK PLAZA L.S.C. MAYUR VIHAR PH II DELHI 91  
PH: 85272189. TEL/FAX: 22770189

services consultant  
**Consummate Engineering Services (P) Ltd.**

**cespi**  
Noida Office : B - 67, Sector - 67, Noida - 201 301  
Tel. : (0120) 6943500 / 24 Lines  
Lko. Office : R 906, Rohas Purnima, Gomti Nagar, Lucknow  
e mail : mail@cespi.in, website : www.cespi.in