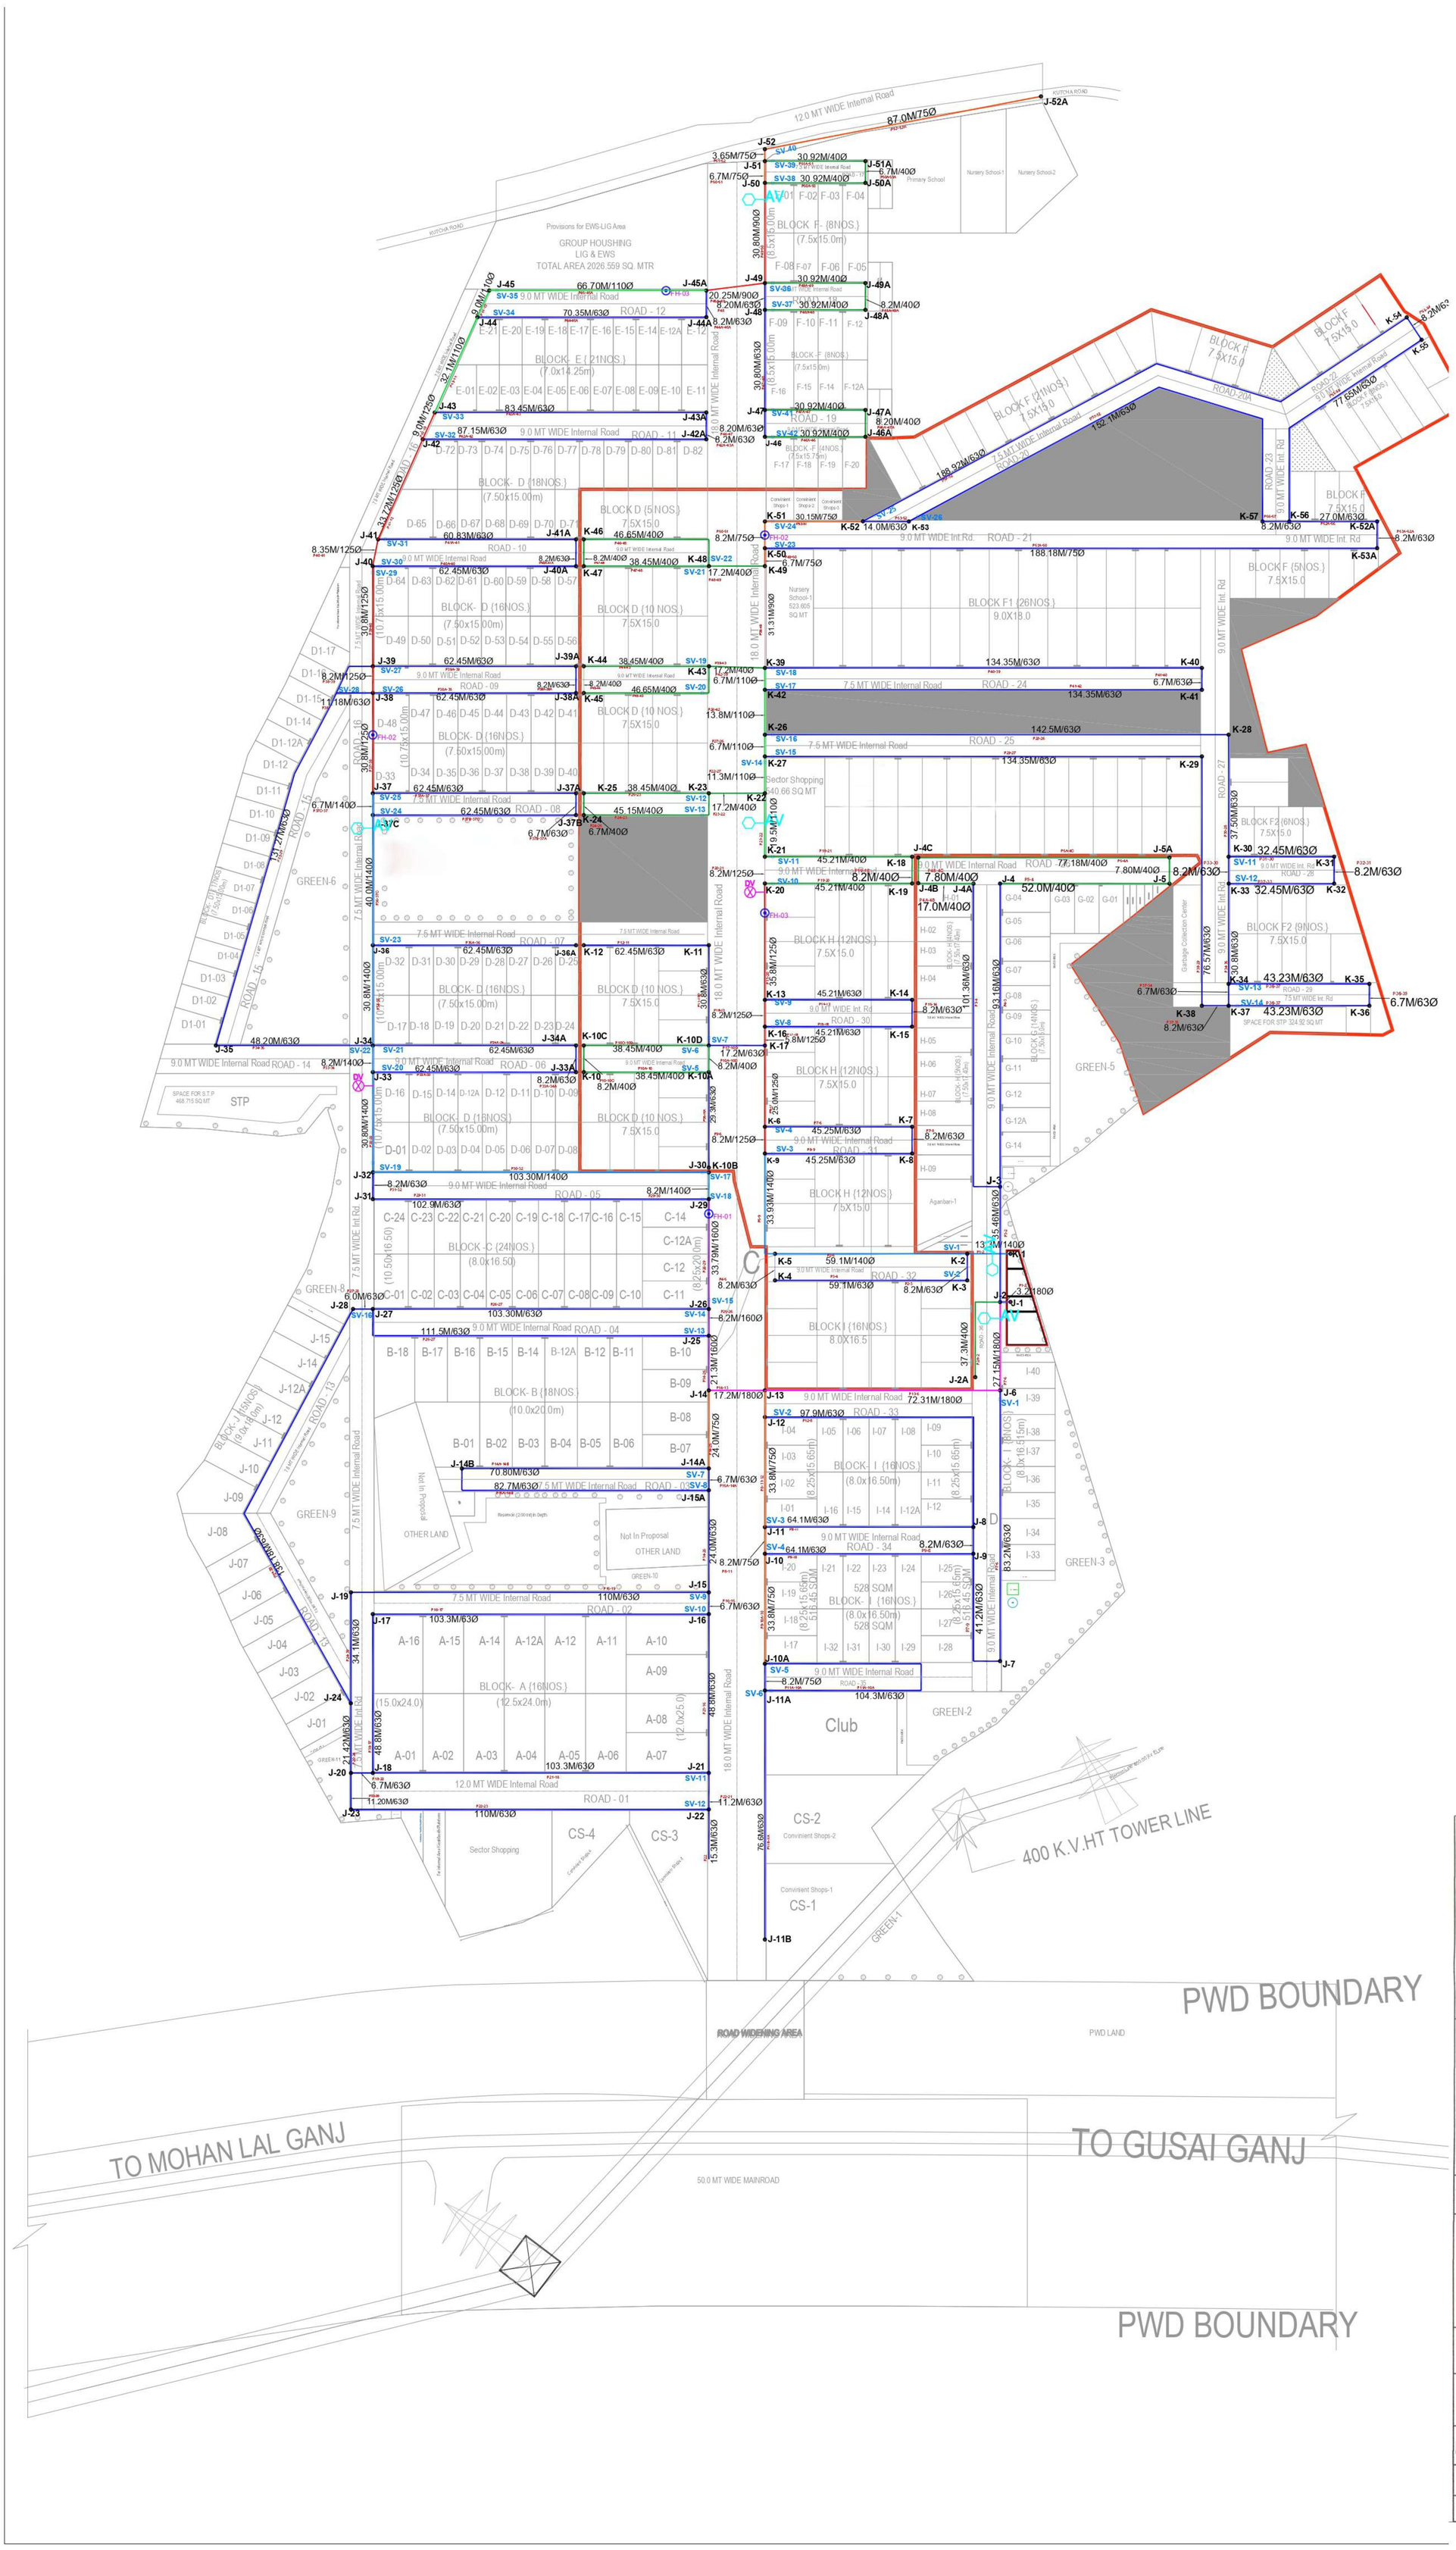

LEGEND:-

1. SLUICE VALVE. — SV
2. AIR RELEASE VALVE — AV
3. FIRE HYDRANT — FH
4. DRAIN /SLUICE VALVE — DV
5. 40 Ø HDPE PIPE
6. 63Ø HDPE PIPE
7. 75 Ø HDPE PIPE
8. 90 Ø HDPE PIPE
9. 110 Ø HDPE PIPE
10. 125 Ø HDPE PIPE
11. 140 Ø HDPE PIPE
12. 160 Ø HDPE PIPE
13. 180 Ø HDPE PIPE
14. NODE — K-32

GOOD FOR CONSTRUCTION

21 MAR 2025

CONSULTANT

DESIGN COLLABORATIVE CONSULTING

DESIGN COLLABORATIVE CONSULTING
ENGINEERS. ARCHITECTS. PLANNERS. PROJECT MANAGERS
(An Integrated Real Estate an Infrastructure Consultant)
201,H-159,Business Park Sector-63, Noida,
G.B.Nagar Uttar Pradesh -201301, Tel : 0120-4129586
EMAIL:designcollaborativeconsulting@gmail.com

CLIENT : M/ S AGRASHEEL INFRATECH PRIVATE LIMITED
Unit No. 1008-B, Corporate Park Tower A/1 Plot No.7A/1, SECTOR 142, NOIDA, GAUTAM BUDDHA NAGAR, UTTAR PRADESH, 201301

PROJECT : AASHRAYAM, VILLAGE -BELI, NEAR MOHANLAL GANJ - GOSAI GANJ at LUCKNOW

TOWN: LUCKNOW

TITLE: DOMESTIC WATER SUPPLY NETWORK (P-01 & P-02)

DRAWING NO.	REV
DCC/P/SER/ASH/LUK/2025/D-06	0

APPROVED	CHECKED	DESIGNED	DRAWN
JK	JK	JK	DEV

SCALE	DATE	STATUS
NTS	03.03.25	GFC