



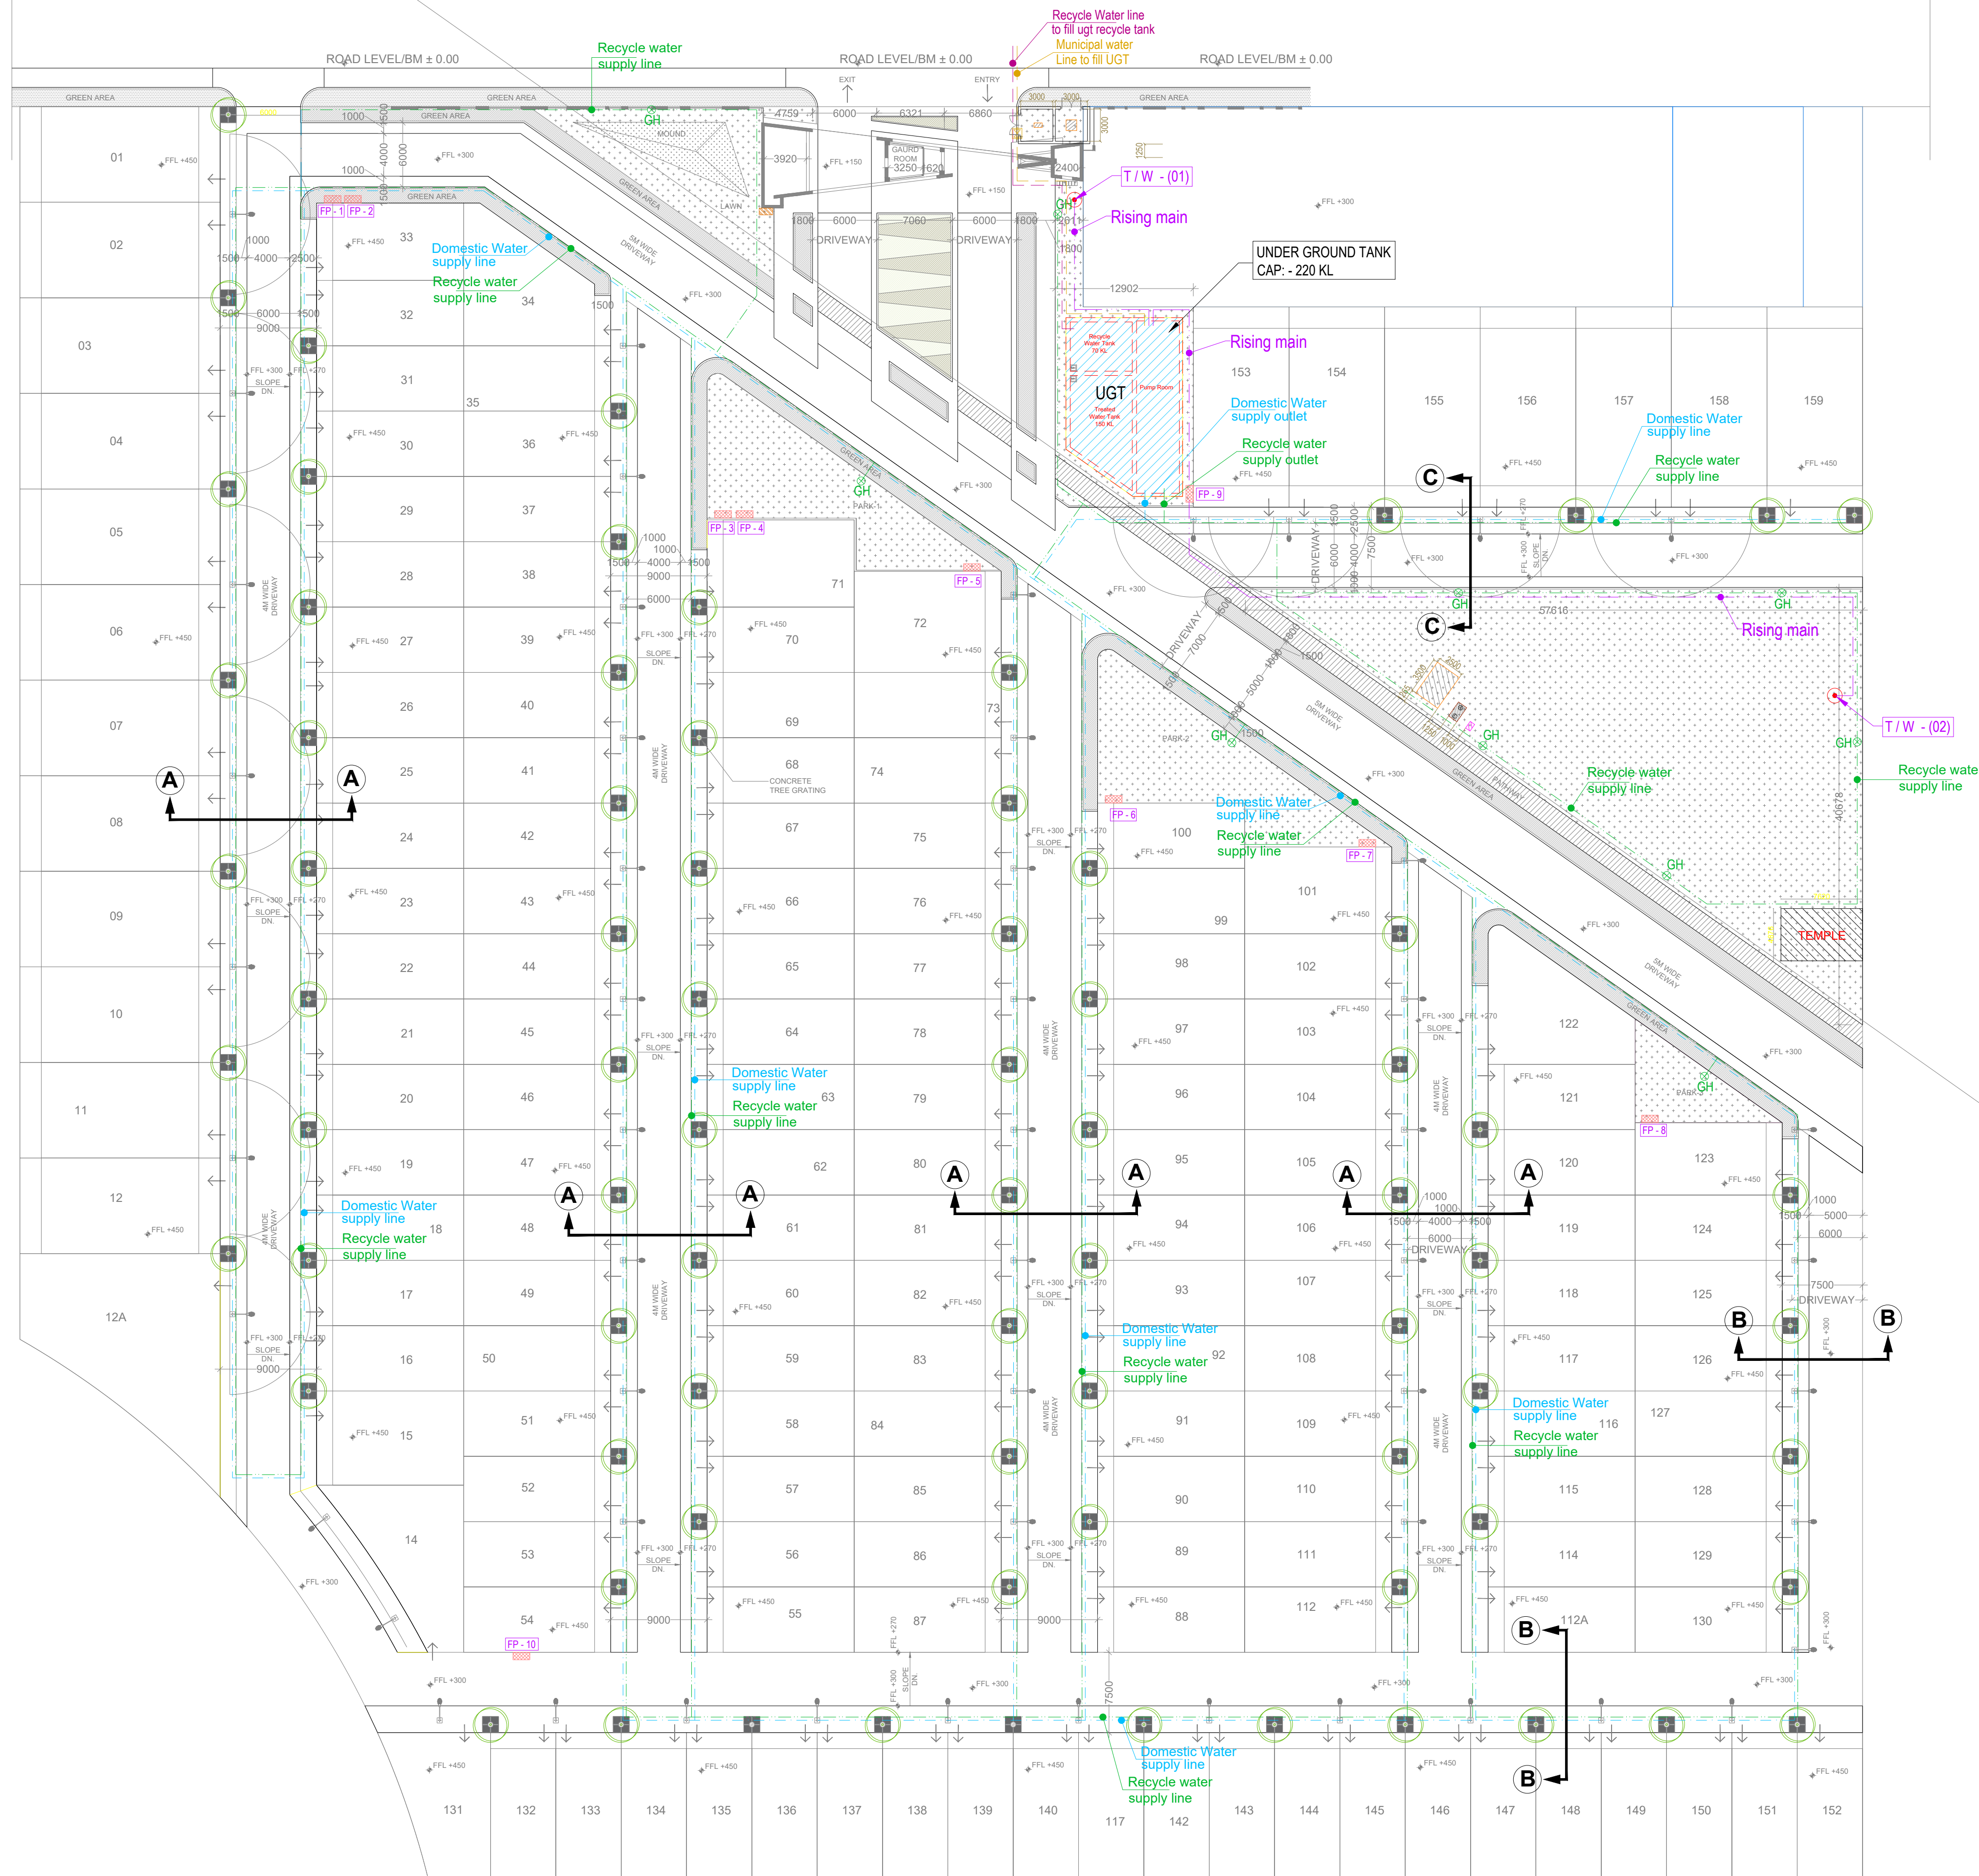

LEGEND :		
S. No.	SYMBOL	DESCRIPTION
1.		DOMESTIC WATER SUPPLY LINE
2.		RECYCLE WATER SUPPLY LINE
3.		GH
4.		MUNICIPAL WATER SUPPLY LINE
5.		RISING MAIN LINE (FROM TW TO U.G.T.)
6.		PROPOSED TUBE WELL
7.		
8.		
9.		
10.		

NOTES : WATER SUPPLY

- The depth of domestic water supply main shall be -900 mm
- The depth of horticulture water supply main shall be -1000 mm
- The depth of municipal line & rising main shall be -1000 mm
- Pipe material for external water supply - Domestic / tube well rising main / municipal line shall be : HDPE (PE 100) PN8
- Pipe material for external water supply - Recycle Water line for horticulture shall be : UPVC-6Kg/cm

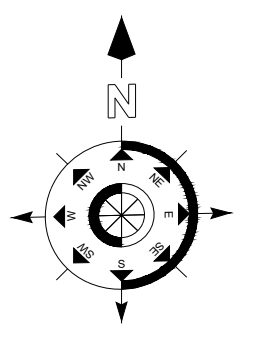

rev. no.	date	revision
..	..	..

project
ASSOTECH CANOPY CROSSING REPUBLIC
AT GHAZIABAD , UP

title
LAYOUT PLAN

subtitle
EXTERNAL WATER SUPPLY

drawing released for
☒ APPROVAL ☐ SUBMISSION
☐ ADVANCE COPY ☐ CONSTRUCTION

drg. no. A.C.C.R. / ES-03 drawn by Amit kumar

scale 1 : 350@A1 designed by Tariq Salam Ansari

date 15-07-2021 checked by Anand Havelia

Client :
ASSOTECH LIMITED
A-354, SECTOR-19, NOIDA, U.P.

services consultant
Consummate Engineering Services (P) Ltd.
 Noida Office : B - 67, Sector - 67, Noida - 201 301
Tel : (0120) 2303500 (30 Lines)
Lko. Office : R 006, Rohitas Pinneria, Gomti Nagar, Lucknow
e mail : mail@cespl.in, website : www.cespl.in