



FIRE HYDRANT, STAND POST TYPE ONE OUTLET

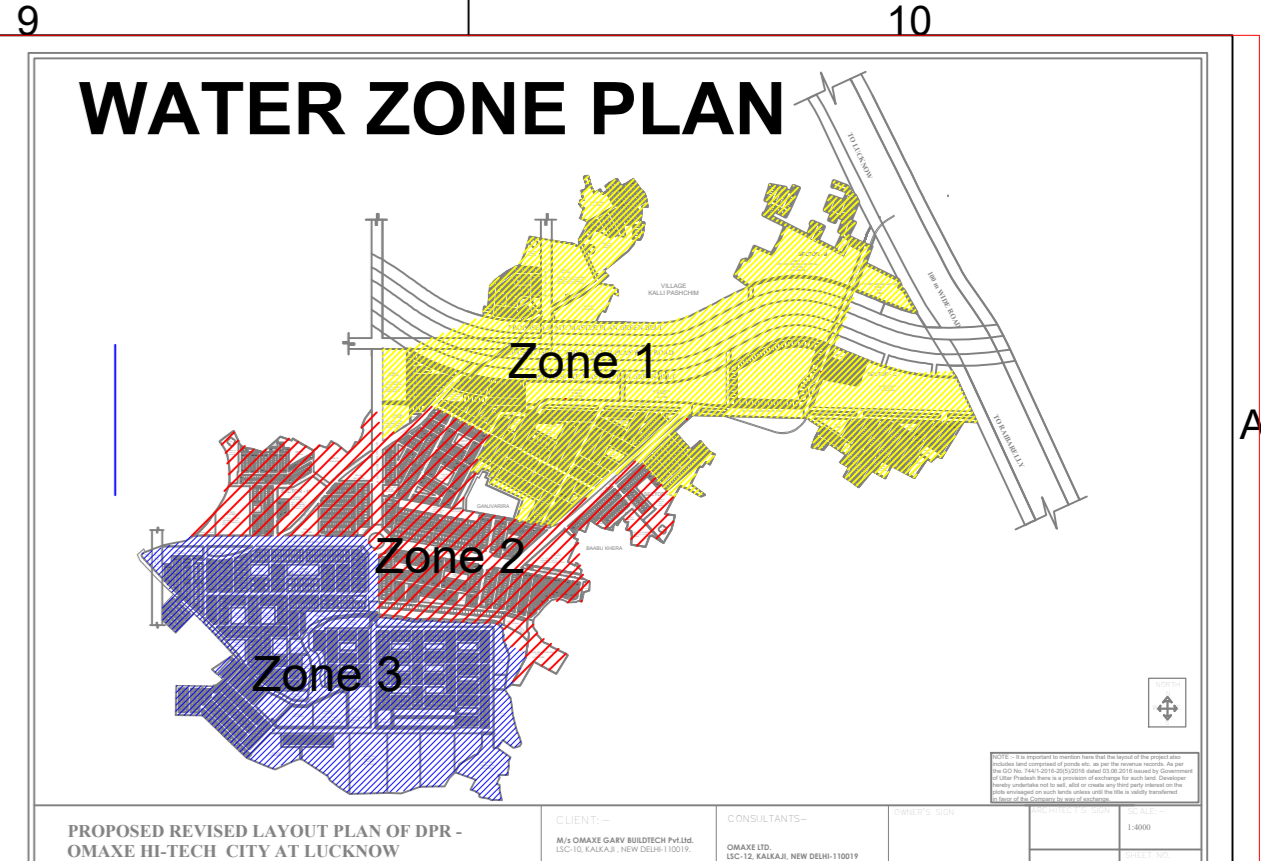


NOTE:- In this water supply system Commercial plots greater than 500 sqm have not been considered, PSP Plots greater than 1.5 acres have not been considered. Industrial plots & Group housing plots have not been considered

- LEGEND**
- Junction Number
  - Length/Diameter of pipe
  - Overhead Tank
  - Sluice valve
  - Fire Hydrant
  - Air Valve
  - Drain Valve
  - 315Ø MDPE pipe
  - 250Ø MDPE pipe
  - 200Ø MDPE pipe
  - 180Ø MDPE pipe
  - 160Ø MDPE pipe
  - 110Ø MDPE pipe
  - 90Ø MDPE pipe
  - 63Ø MDPE pipe

NOTE - The site can use HDPE and the pressure rating of the pipe should be 6 Kg/CM<sup>2</sup>

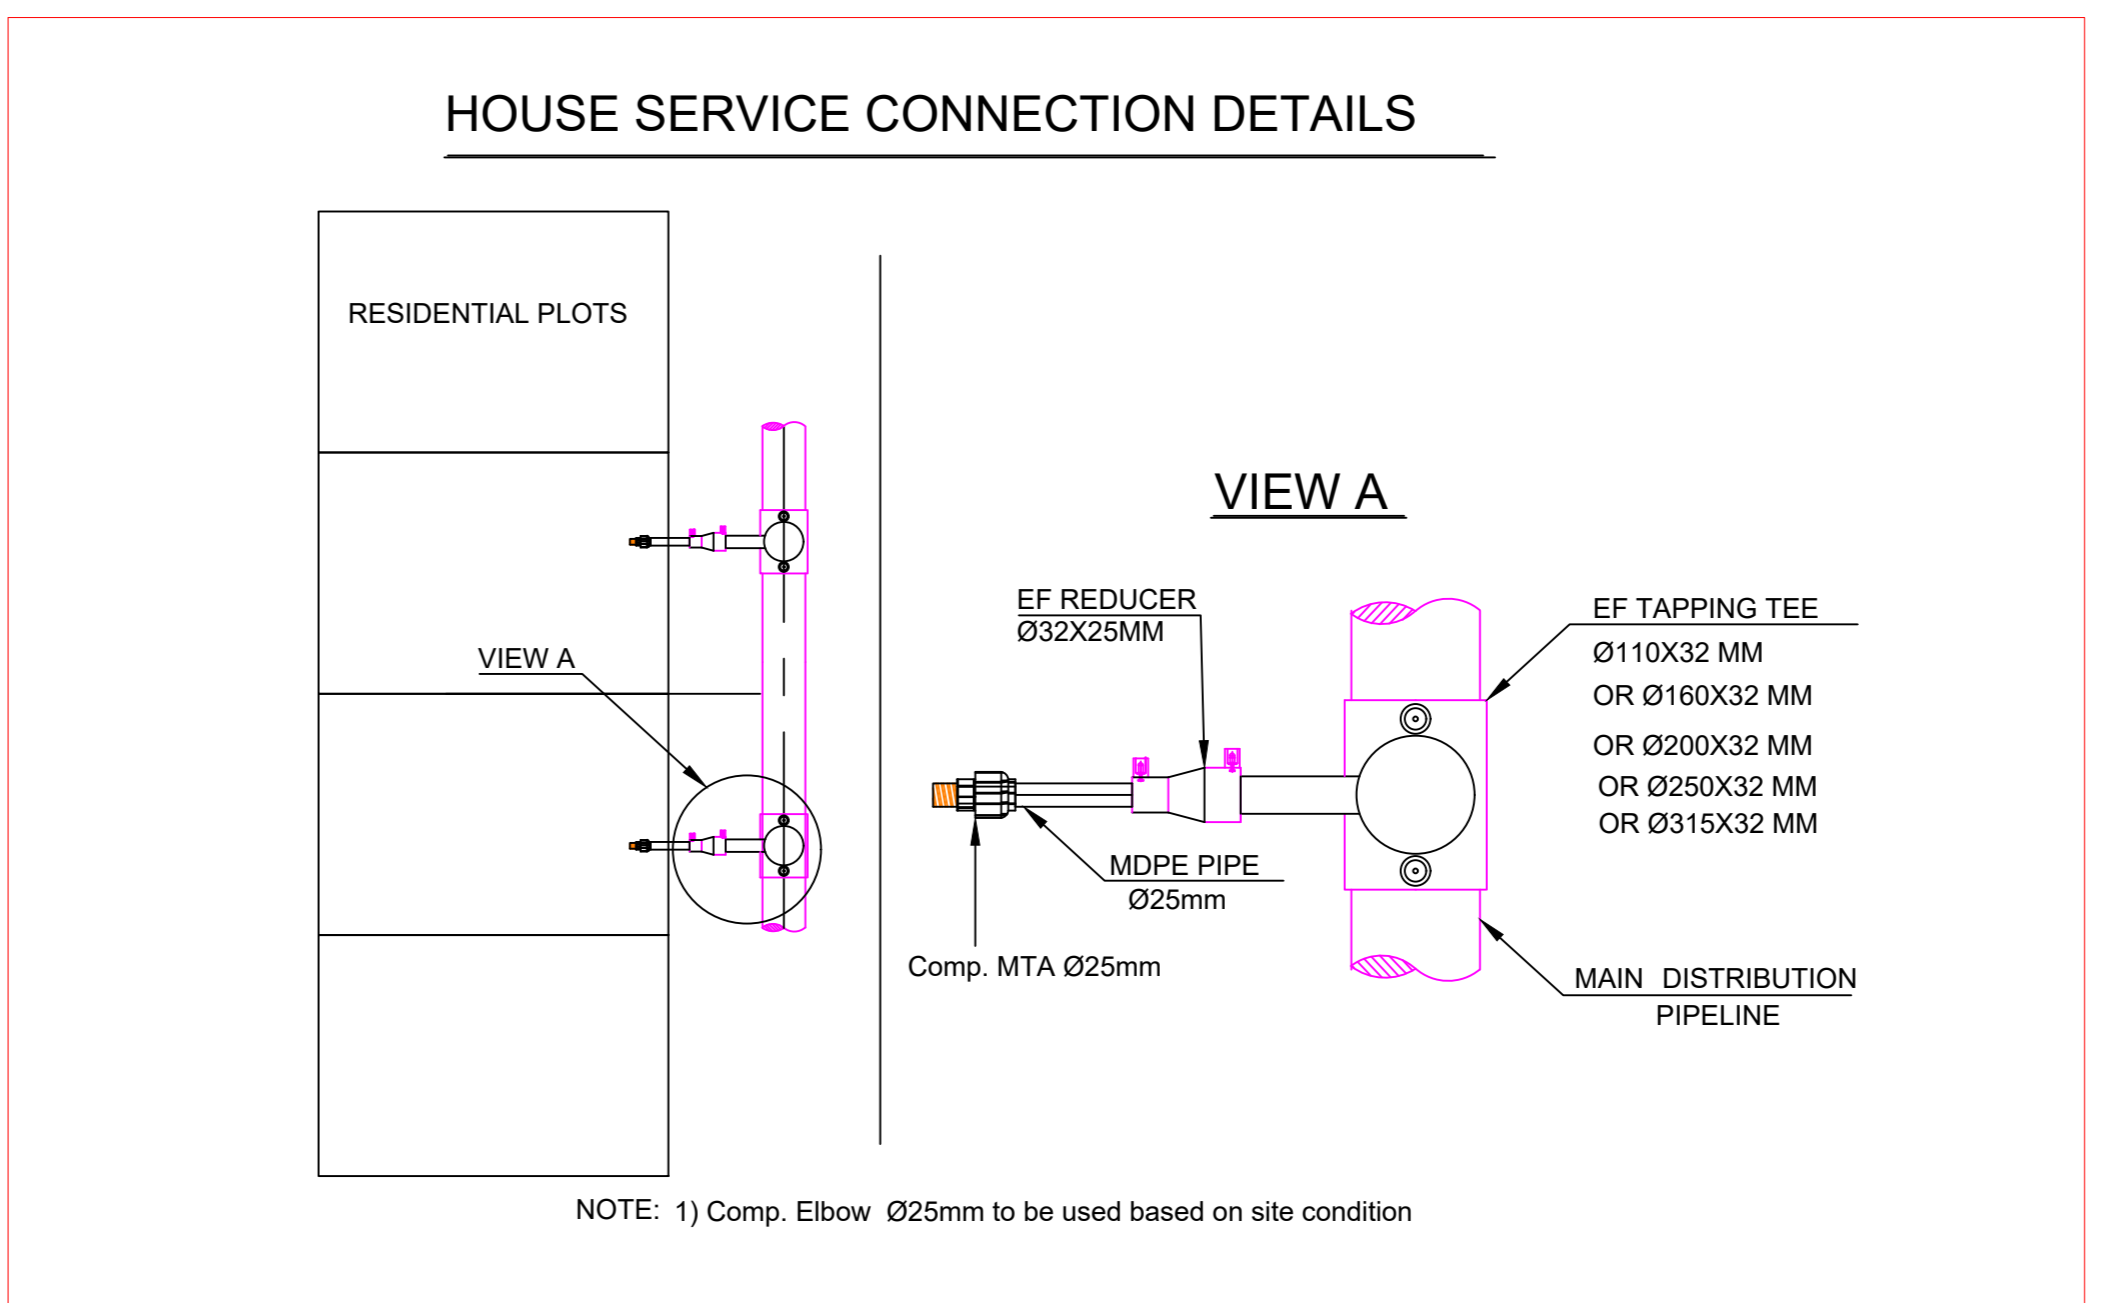

LEGEND		SCHEMATIC DIAGRAM	
DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL



**CLIENT**  
M/s GARV BUILDTech Pvt.Ltd.  
M/s OMAXE LTD, Lead Member  
LSC-10, KALKAJI, NEW DELHI-110019

**OMAXE HI-TECH CITY  
LUCKNOW  
(DA-1)**

**CONSULTANT**  
ENGINEERS, PLANNERS, PROJECT MANAGERS  
(An Integrated Real Estate and Infrastructure Consultant)  
512, Appagal Street, Madhav Nagar, MDK, Plot No. 12, Road 44, Pitampura, New Delhi - 110034  
E-MAIL: designcollaborativeconsulting@gmail.com

NO.	DATE	REVISIONS(DRAWING NO)	BY	CHKD/APPD
TOWN: LUCKNOW				
TITLE: WATER SUPPLY NETWORK FOR ENTIRE AREA				
DRAWING NO. DCC/PI/OM/LUK/2016/D-17/17.2		REV: 0		
APPROVED	CHECKED	DESIGNED	DRAWN	
SCALE	DATE	STATUS		