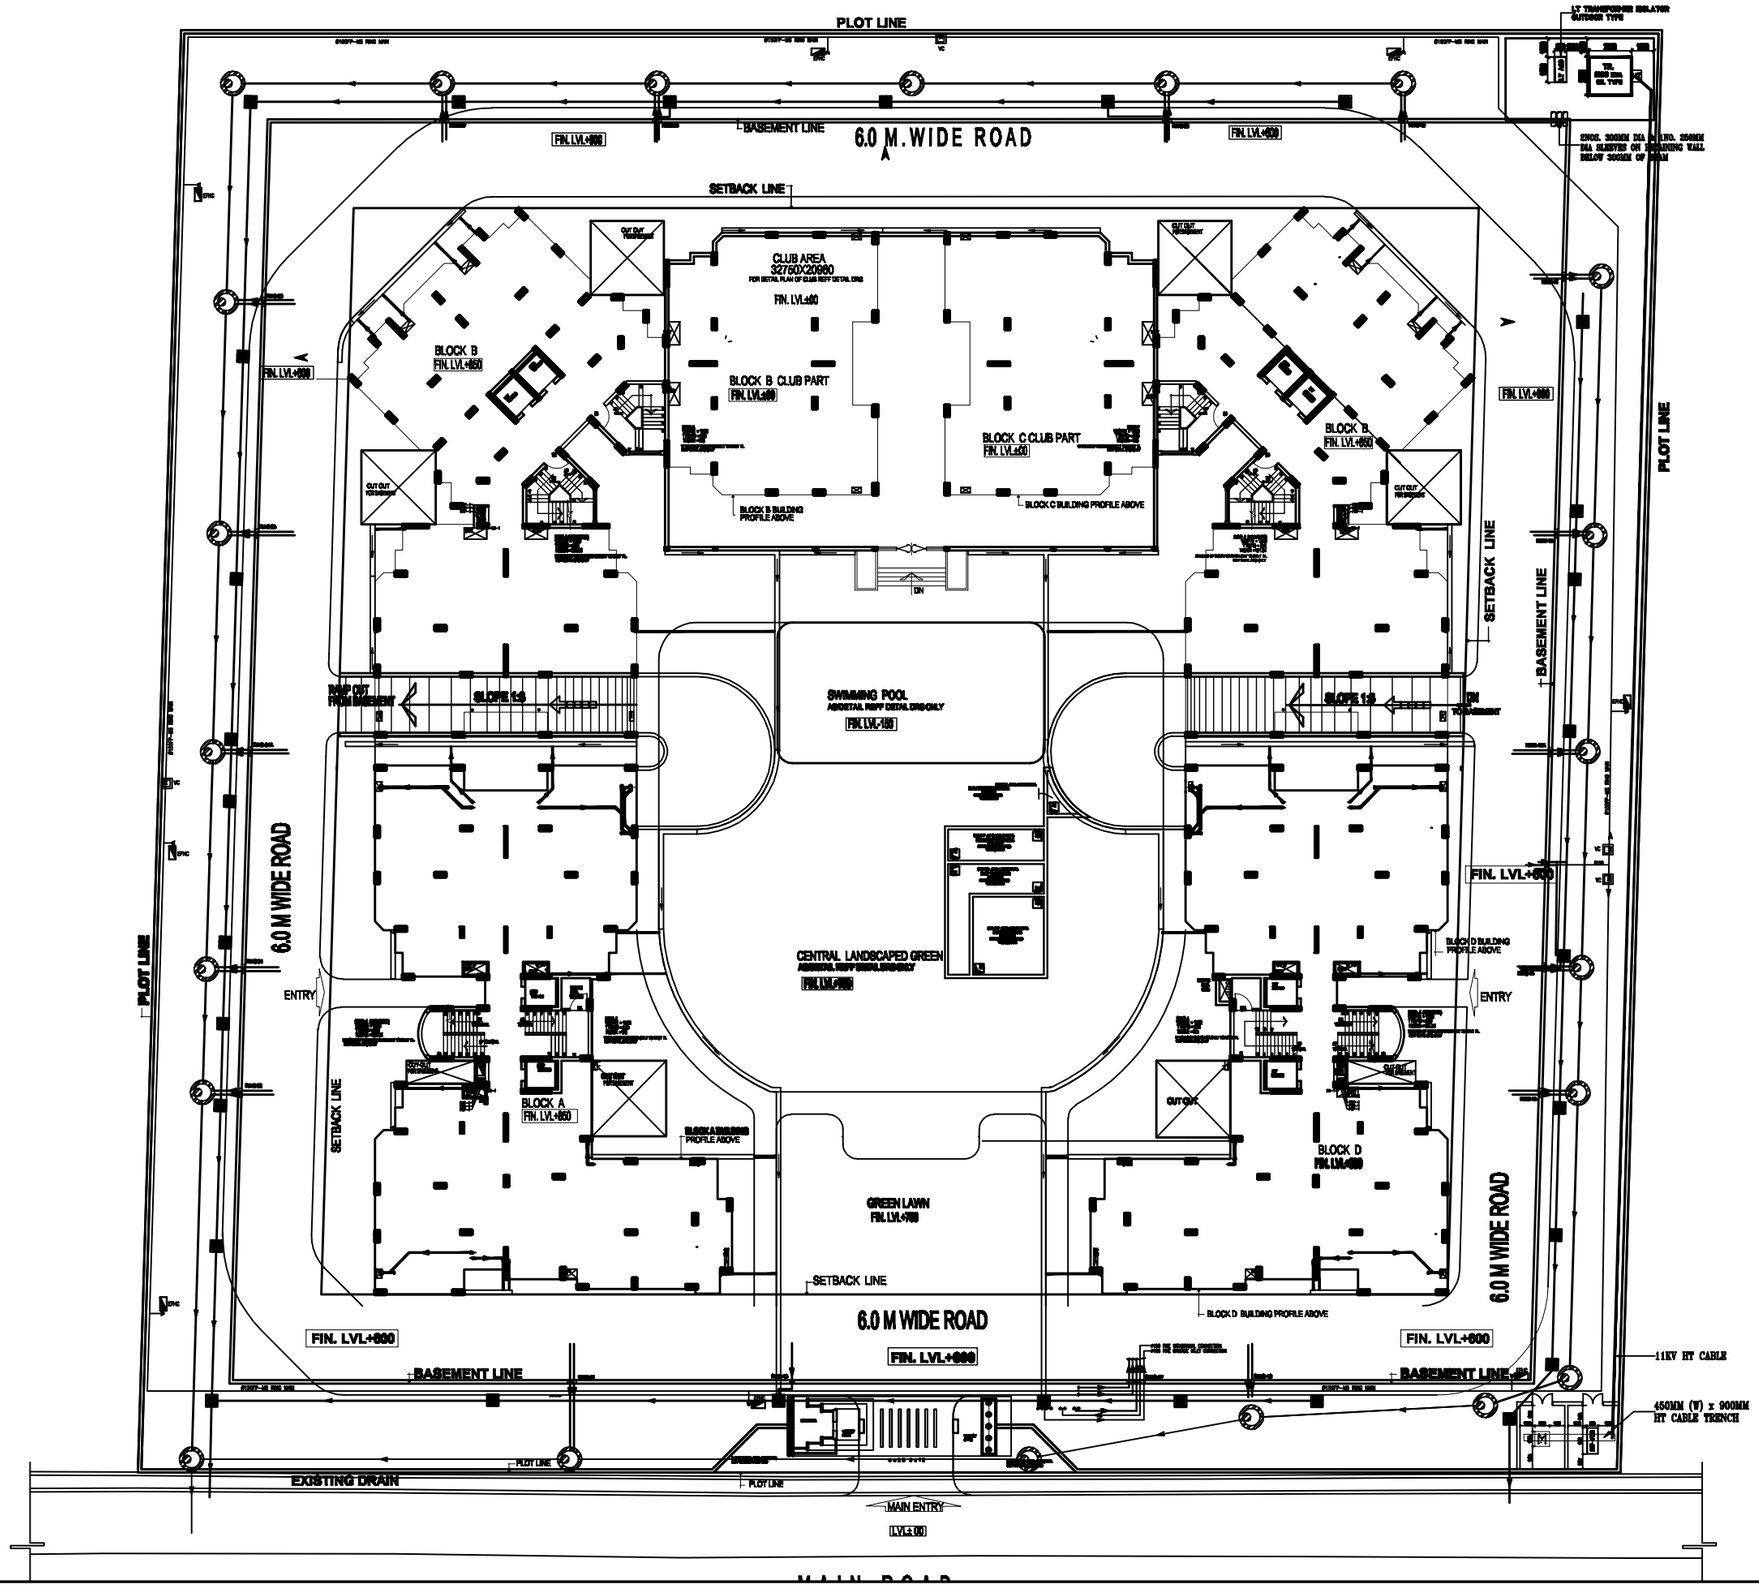

FF-RG-00-GRFP

FIRE LEGEND & ABBREVIATION

FHP	FIRE HYDRANT POLE	
FSD	FIRE SPRINKLER DRAIN	
FSP	FIRE SPRINKLER PIPE	
FHC	FIRE HOSE CABINET	
SC-1	SLAB CUTOUT 300x300MM	
SC-2	SLAB CUTOUT 300x300MM	
SV	SAMPLE VALVE	
WV	WATER/FIRE VALVE	
SP	SPIL SPOT	
	PENDANT SPRINKLER	
	EXTERNAL FIRE HYDRANT / EXTERNAL FIRE HOSE CABINET	
	VALVE CHAMBER 1500x1500x1500	
	FLOW DIRECTION	
2hr	2HR FIRE WALL	
L	HOOK IN LENGTH	
	DIAMETER	
AV	AUTOMATIC AIR VENT	

PLUMBING LEGEND & ABBREVIATION

MP	MAIN PIPE
UP	UPVC
VP	VCP PIPE
DWS	DOMESTIC WATER SUPPLY PIPE
FWS	FLUSHING WATER SUPPLY PIPE
CP	CAST IN PLAN
	CAST IN SLAB
SW	SPOT IN WALL/SOIL PIPE
TOS	TOP OF SLAB
BOS	BOTTOM OF SLAB
RWO	RETAINING WALL CUTOUT
	FLOW DIRECTION
25	25MM PIPE
	DIAMETER

RETAINING WALL CUTOUT SCHEDULE

Mark	Cutout Type	Diameter/Size	Invert Level Bottom of Cutout
CL	100X100	100x100mm	1.00mm
CL	100X100	100x100mm	1.00mm
CL	100X100	100x100mm	1.00mm