# DESIGN OF WATER SUPPLY DISTRIBUTION SYSTEM OF SECTOR-5 JAGRITI VIHAR (EXT.) YOJNA NO-11 MEERUT

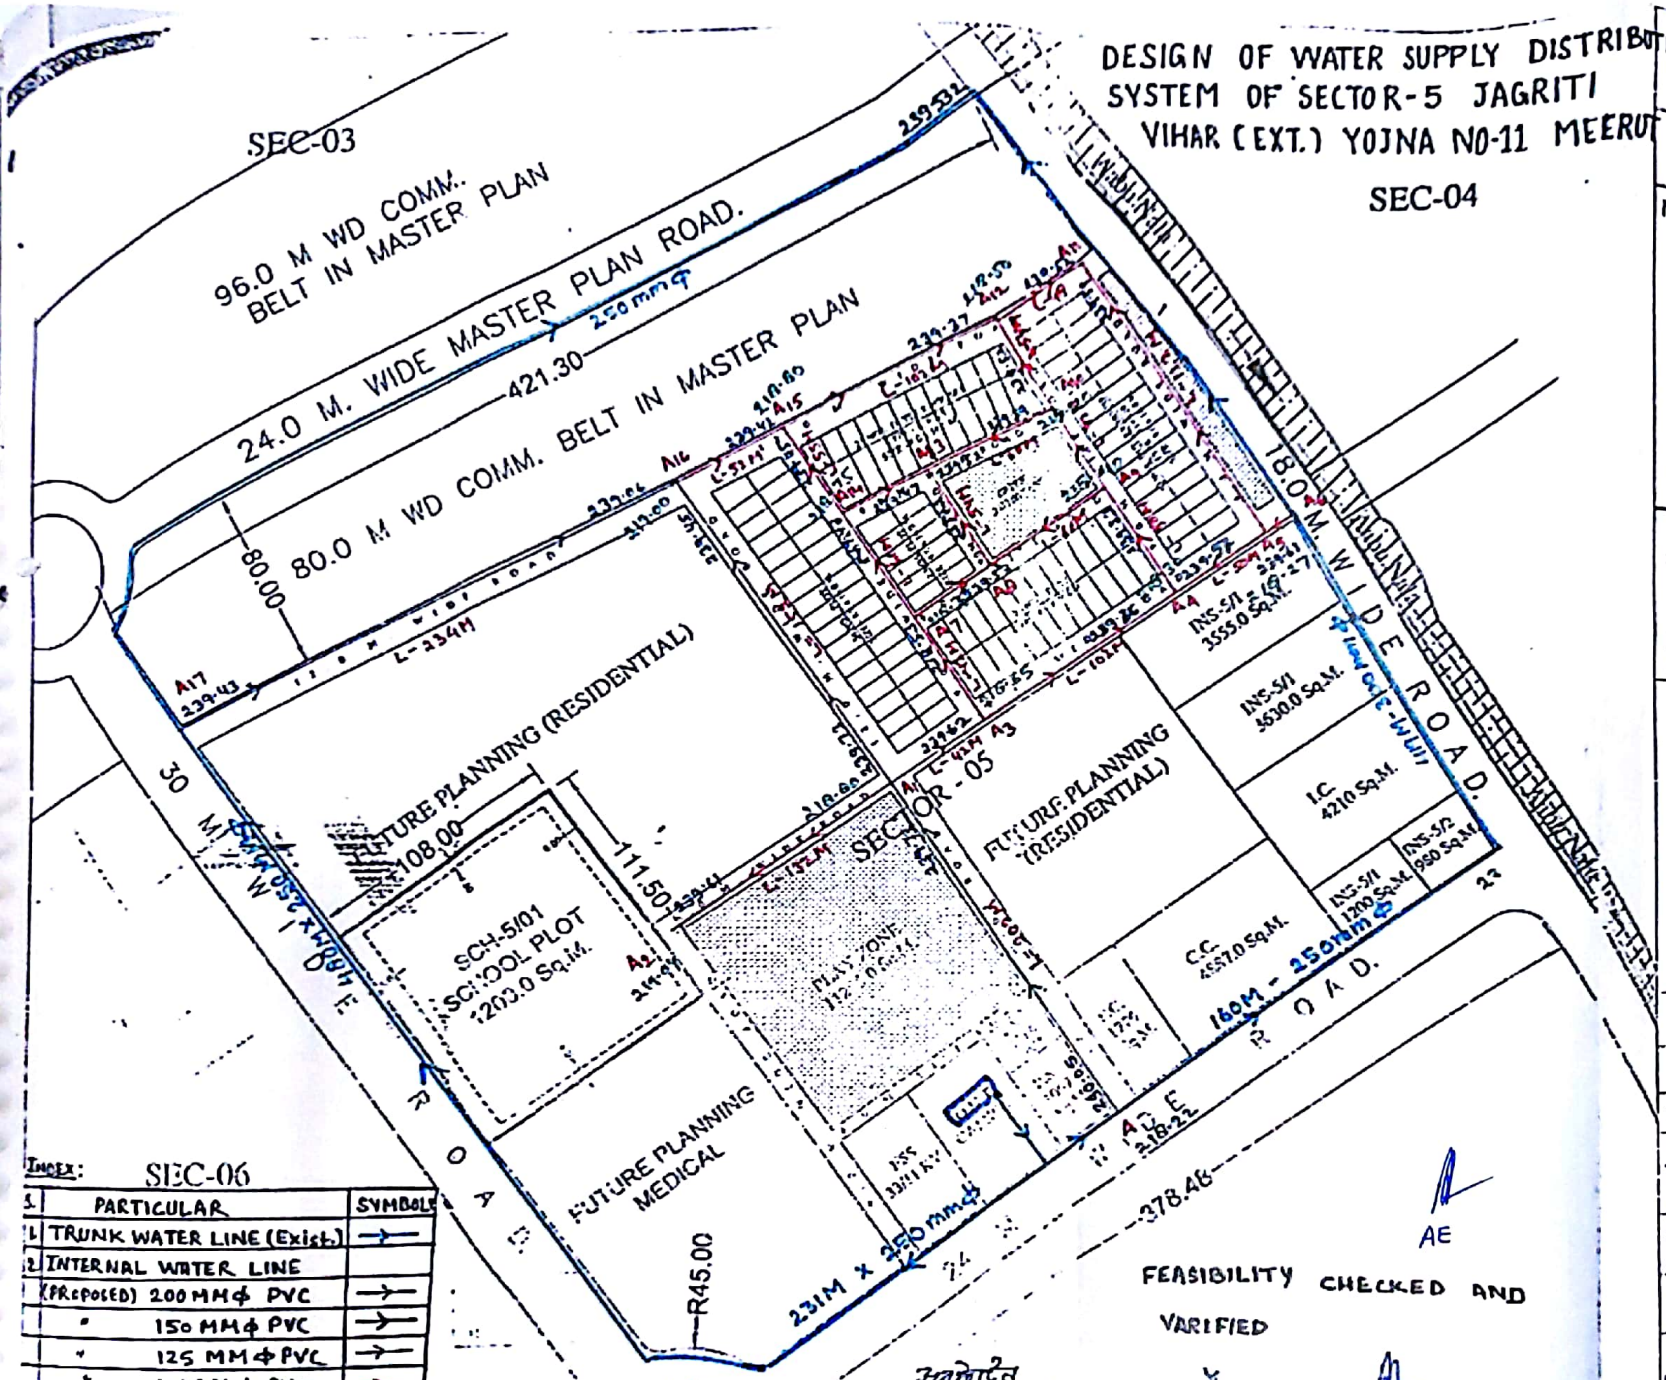


INDEX:

| S. | PARTICULAR | SYMBOLS |
|---|---|---|
| 1. | TRUNK WATER LINE (Exist.) | → |
| 2. | INTERNAL WATER LINE | |
| | (PROPOSED) 200 MM φ PVC | → |
| | " 150 MM φ PVC | → |
| | " 125 MM φ PVC | → |
| | " 100 MM φ PVC | → |
| | G.L. / PATRI LEVEL | 000.00 |
| | HYDR.L. OF LINE | 000.00 |

NOTE: THIS DRAWING SHOULD BE READ WITH DESIGN CHART.

Director
Quality Control & Design Cell
UPAVP Lucknow
31/3/17

UPAVP
ARCHITECTURE AND PLANNING UNIT-1
NEELGIRI COMPLEX, INDIRA NAGAR
LUCKNOW

23

PART LAYOUT PLAN

NOTE -
1. THIS LAY-OUT PLAN HAS BEEN REVISED IN ACCORDANCE WITH THE DECISION TAKEN IN THE CIRCLE - ZONAL MEET DATED 17.06.2016 IN MEERUT & DECISION BY H.C. DATED 16.06.2016 & 30.09.2016
2. THE DRAWING SUPERSEDES PREVIOUS L.O.P. APPROVED DATED 26.09.2016.
3. FEASIBILITY FOR THE DRG. HAS BEEN RECIEVED VIDE LETTER NO.1392/Y-6/124 DATED 23.11.2016 BY E.E. CD.-05 WHICH HAS BEEN RECOMENDED BY SE-2 VIDE HIS LETTER NO. 2362 DATED 26.11.2013.

## CONSTRUCTION PARAMETERS

FOR SCHOOL PLOT NO. SCH - 5/01

| | | |
|---|---|---|
| SET BACKS | : | AS SHOWN |
| GROUND COV. | : | 35% |
| F.A.R. | : | 1.2 |

PARKING & OTHER REQUIREMENTS SHALL BE AS PER UPVIDHI-2008/NBC.

निर्माण हेतु प्रमाणित
वास्तुविद विवेचक
दर्शाई
6/12/16

PART L.O.P. OF SCHEME NO-11
JAGRITI VIHAR YOJNA, MEERUT.

REVISED LAY-OUT PLAN FOR SECTOR - 5

SCALE:

DATE : 07.12.2016

V.R.PATHAK
Designer

SUBODH KUMAR
ASSTT.ARCHITECT PLANNER
08.12.16

S.I.YADAV
ARCHITECT PLANNER
9.12.16

DEPARTMENT PLANNER

Scanned by CamScanner