


External Electrification work

Index

- ① 11 KV O.H. = —
- ② 11 KV Zone 185 Sq. m. Cable = —
- ③ A.B.C. LT Cable = —
- ④ 11/0 433V T/F = —
- ⑤ 11/0 433V LT Pole = —
- ⑥ 9.5 m. High LT Pole = —

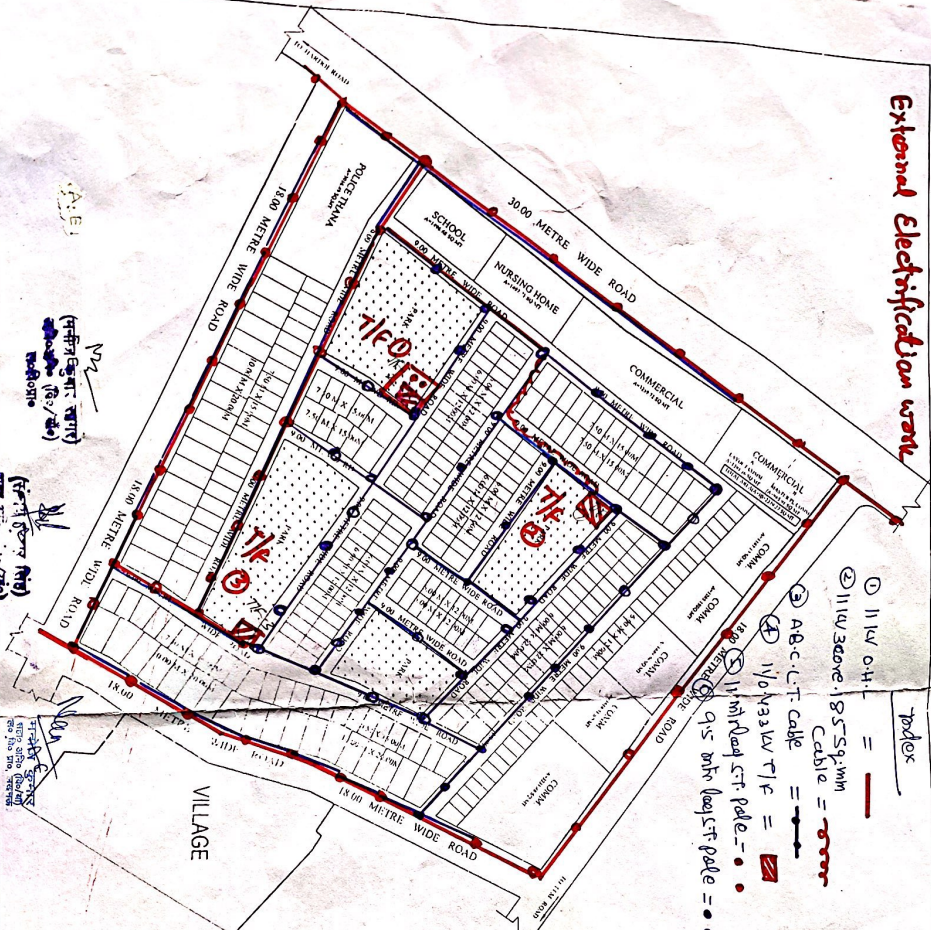

PROPOSED PART LAYOUT PLAN OF SECTOR - 'A' HARDOI ROAD SCHEME, LUCKNOW.

DETAIL OF PLOTS:-

S.N.	TYPE	SIZE OF PLOTS	AREA IN SQ.MT.	NOS.
1.	PLOTS	10.00 M. X 20.00 M.	200.00 SQ.MT.	35
2.	PLOTS	07.50 M. X 15.00 M.	112.50 SQ.MT.	86
3.	PLOTS	06.00 M. X 15.00 M.	075.00 SQ.MT.	192
TOTAL			313	313

AREA STATEMENT:-

S.N.	PARTICULARS	AREA IN SQ.MT.	% AGE
1.	TOTAL AREA OF LAND	8371.12 SQ.MT.	
2.	AREA UNDER M. PLAN CANAL	973.75 SQ.MT.	
3.	NET AREA OF LAND	7397.37 SQ.MT.	1.78%
4.	AREA UNDER PLOTS	31740.15 SQ.MT.	16.12%
5.	AREA UNDER CANAL	04657.00 SQ.MT.	61.97%
6.	AREA UNDER SCHOOL	01477.25 SQ.MT.	10.14%
7.	AREA UNDER NURSING HOME	03016.49 SQ.MT.	65.38%
8.	AREA UNDER POLICE THANA	11478.22 SQ.MT.	15.11%
9.	AREA UNDER PARK	22977.02 SQ.MT.	27.14%
10.	AREA UNDER ROAD		

NOTES:-

1. THE PART LAYOUT PLAN IS PREPARED BY THE ENGINEER IN CHARGE OF THE LAYOUT AND APPROVED BY THE AUTHORITY.
VERIFICATION DATE: 08.12.2021

TENTATIVE

DWG. NO. _____
DATE: 08.12.2021
DRAWN BY: _____
CHECKED: _____
N.S.



Handwritten signatures and initials are present at the bottom left of the page, including 'AE', 'IP', and 'N.S.'.