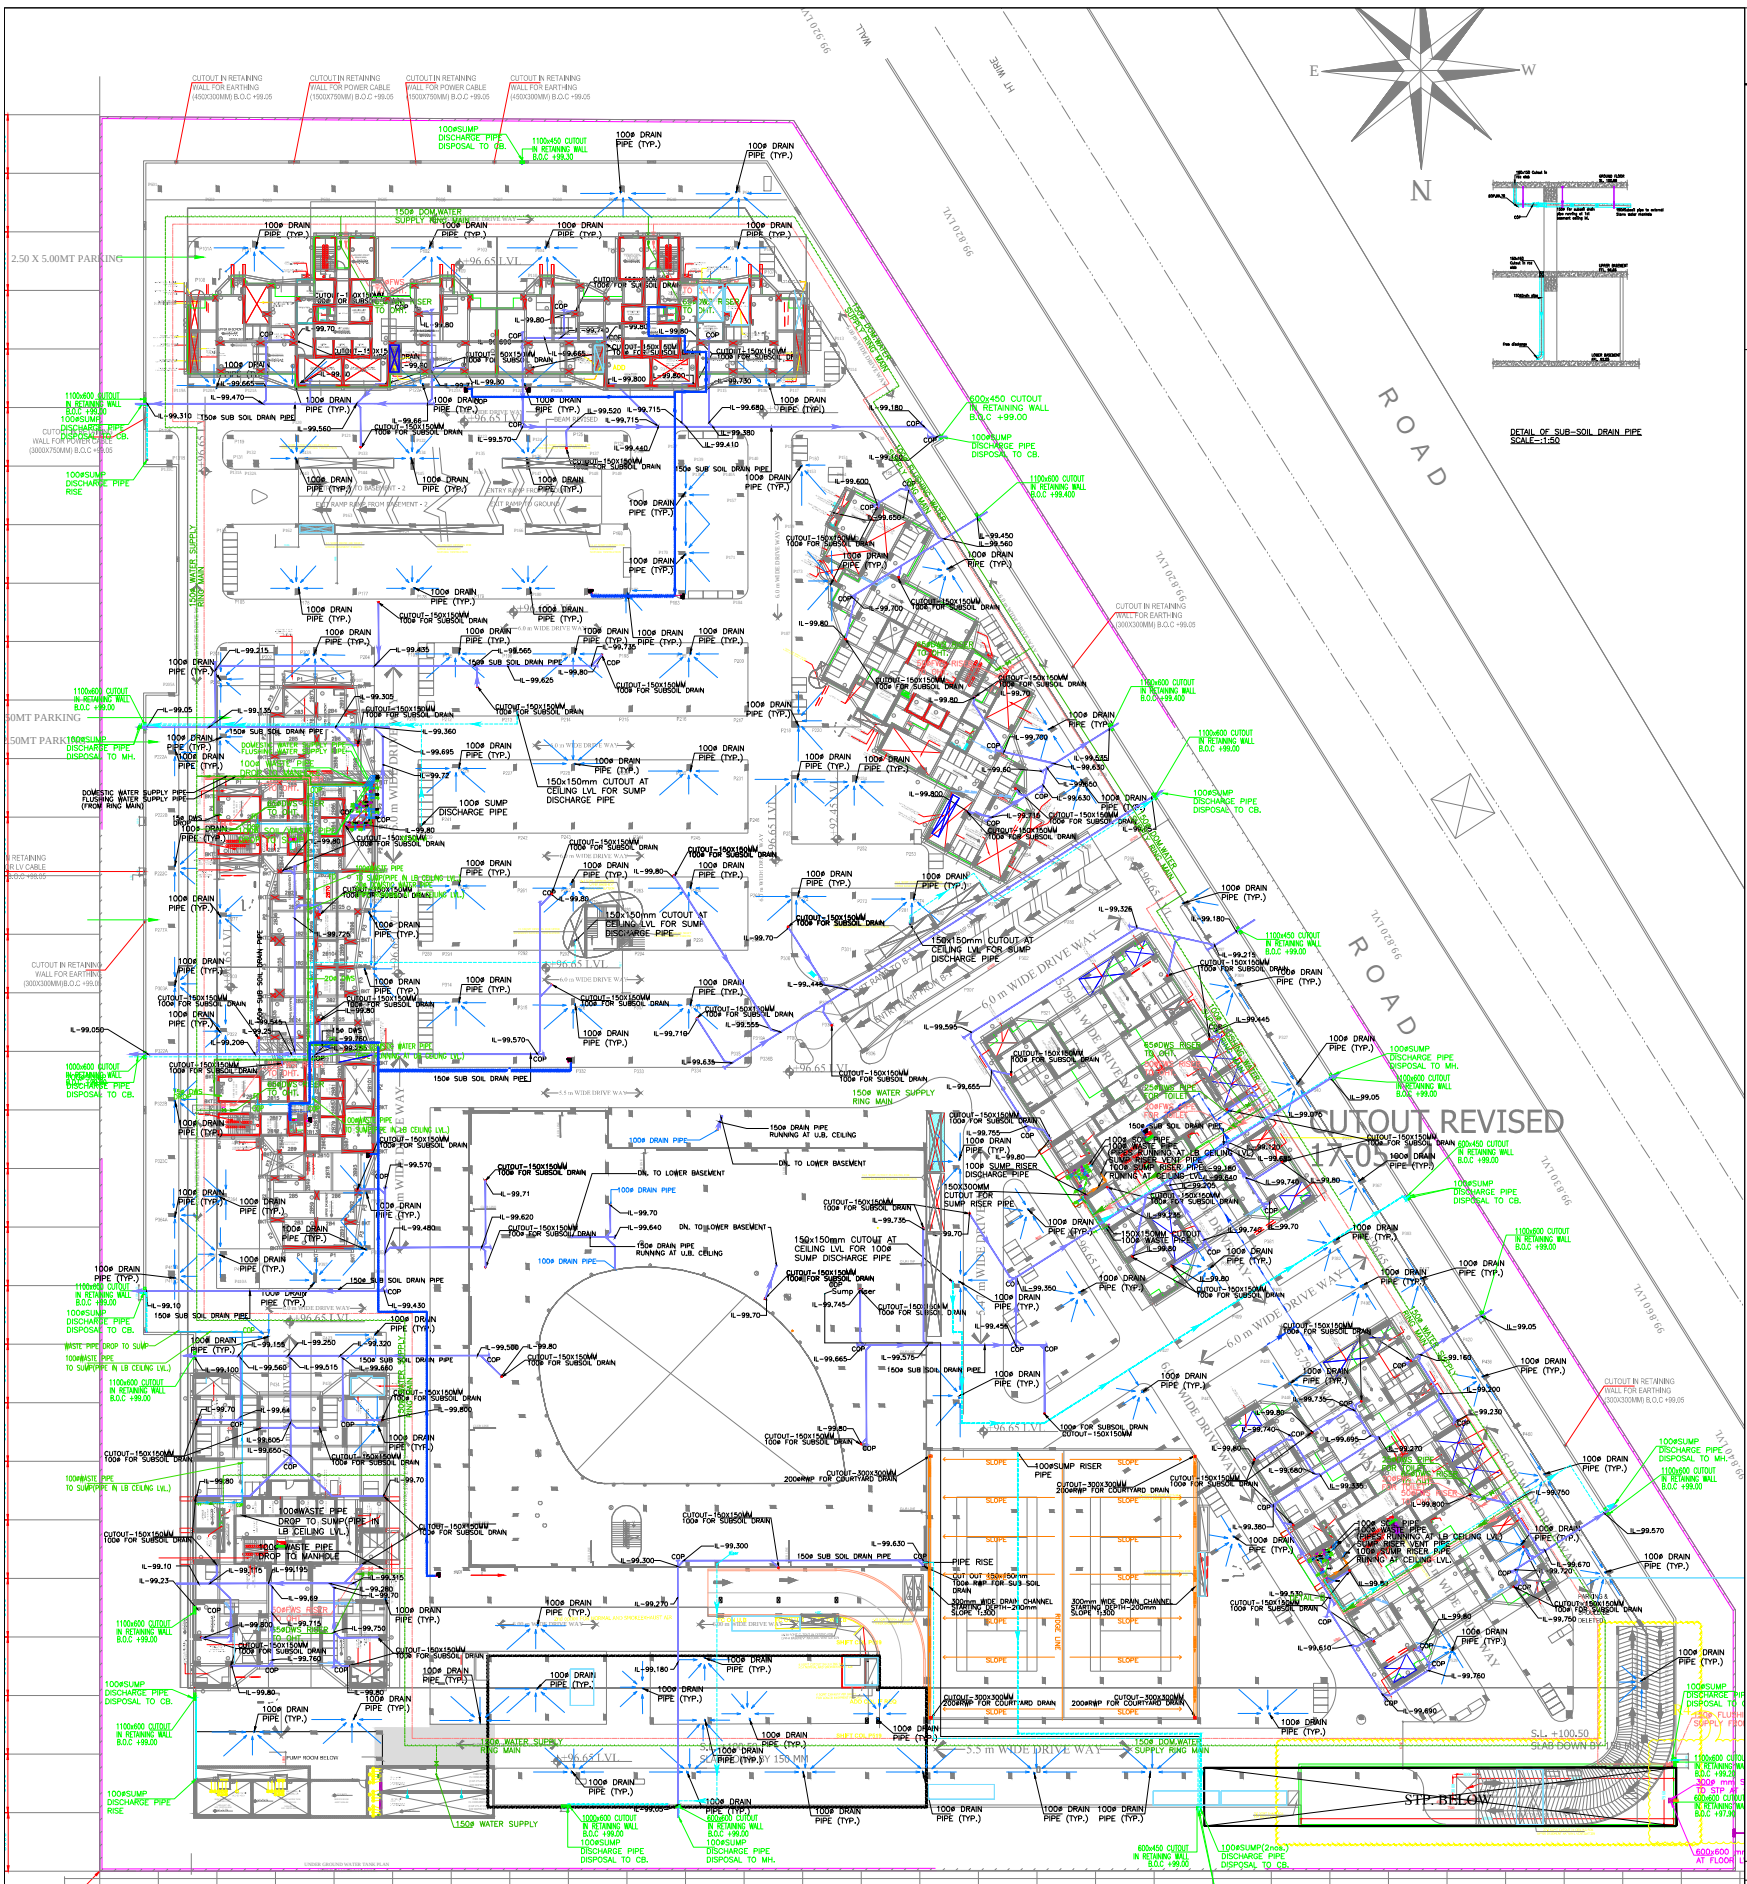


| PRJ.NO. | 4358 | DRG NO. |
|---|---|---|
| | | AHC/MEZZ/WD/DM/003 |



## PLUMBING LEGEND:-

1. 100ø SOIL PIPE(SP)
2. 100ø WASTE PIPE(WP)
3. 75ø VENT PIPE(VP)
4. 100ø RWP/BALCONY DRAIN
5. 150ø RWP
6. DWS RISER
7. FWS RISER
8. HWS RISER
9. HWR RISER

DWS = DOMESTIC WATER SUPPLY
FWS = FLUSHING WATER SUPPLY
HWS = HOT WATER SUPPLY
HWR = HOT WATER RETURN
RO = RO DRINKING WATER SUPPLY
SWS = SOFT WATER SUPPLY
SS = STEAM SUPPLY PIPE
CR = CONDENSATE RETURN PIPE
GHP = GARDEN HYDRANT PIPE
FT = FLOOR TRAP
FD = FLOOR DRAIN
AT = ABLUTION TAP
HF = HEALTH FAUCET
SH = SHOWER
WB = WASH BASIN
WC = WATER CLOSET
SP = SOIL PIPE
WP = WASTE PIPE
VP = VENT PIPE
NRV = NON-RETURN VALVE
BFV = BUTTERFLY/CONTROL VALVE
GV = GLOBE VALVE
YSV = Y-STRAINER
HP = HARVESTING PIT
FWS PIPE
DWS PIPE

| REV | DESCRIPTION | DATE |
|---|---|---|
| | | |
| 8 | REVISED AS PER ARCHITECT COMMENTS | 19.03.2015 |
| 7 | REVISED AS PER ARCHITECT COMMENTS | 13.03.2015 |
| 6 | REVISED AS PER ARCHITECT COMMENTS | 25.02.2015 |
| 5 | REVISED AS PER ARCHITECT COMMENTS | 12.02.2015 |
| 4 | REVISED AS PER CLIENT COMMENTS | 09.01.2015 |
| 4 | REVISED AS PER CLIENT COMMENTS | 10.12.2014 |
| 3 | REVISED VENTILATION SCHEME WITH DUCTED SYSTEM | 09.10.2014 |
| 2 | REVISED AS PER ARCHITECT COMMENTS | 07.06.2013 |
| 1 | REVISED AS PER ARCHITECT COMMENTS | 17.04.2013 |

REVISION

STRUCTURAL CONSULTANT :-

MAHIMTURA CONSULTANTS PVT.LTD

ARCHITECT:

Architect Hafeez Contractor
29 Bank Street, Bombay 23, T.A. (+91 22) 23363528
(+91 22) 23364137
www. architecthafeezcontractor.com
email: hafeez@hcontractor.com

CLIENT:

NEXGEN INFRACOM.PVT.LTD

PROJECT:

MAHAGUN MEZZARIA
SECTOR-78,NOIDA

DRAWING TITLE:

PLUMBING SYSTEM LAYOUT
UPPER BASEMENT FLOOR PLAN
WATER SUPPLY LAYOUT, CEILING LAYOUT PLAN
(+96.65 LVL )

MEP SERVICES CONSULTANT

AECOM

A-197, SECTOR-63
NOIDA(UP) INDIA

TEL: 0120-4049000
FAX: 0120-4049001
www.aecom.com

| | |
|---|---|
| STATUS:- VENTILATION TENDER DRAWING | |
| SCALE: 1:300 | |
| DATE: 07.06.2013 | |
| DESIGNED BY: -- V.S | |
| DRAWN BY: -- S.K | DRG. NO: NODD12103_SHT_40_0000_PL-0002 |
| CHECKED BY: -- A.Q | CONTRACT NO: NODD12103 |
| APPROVED BY: -- A.Q | SHT. NO. -- / NO.OF SHT. -- / REVISION NO. R8 |

COPYRIGHT RESERVED