



Deslting Chamber & Recharge Pit

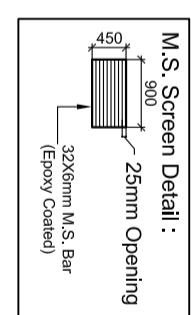

M.S. Screen Detail

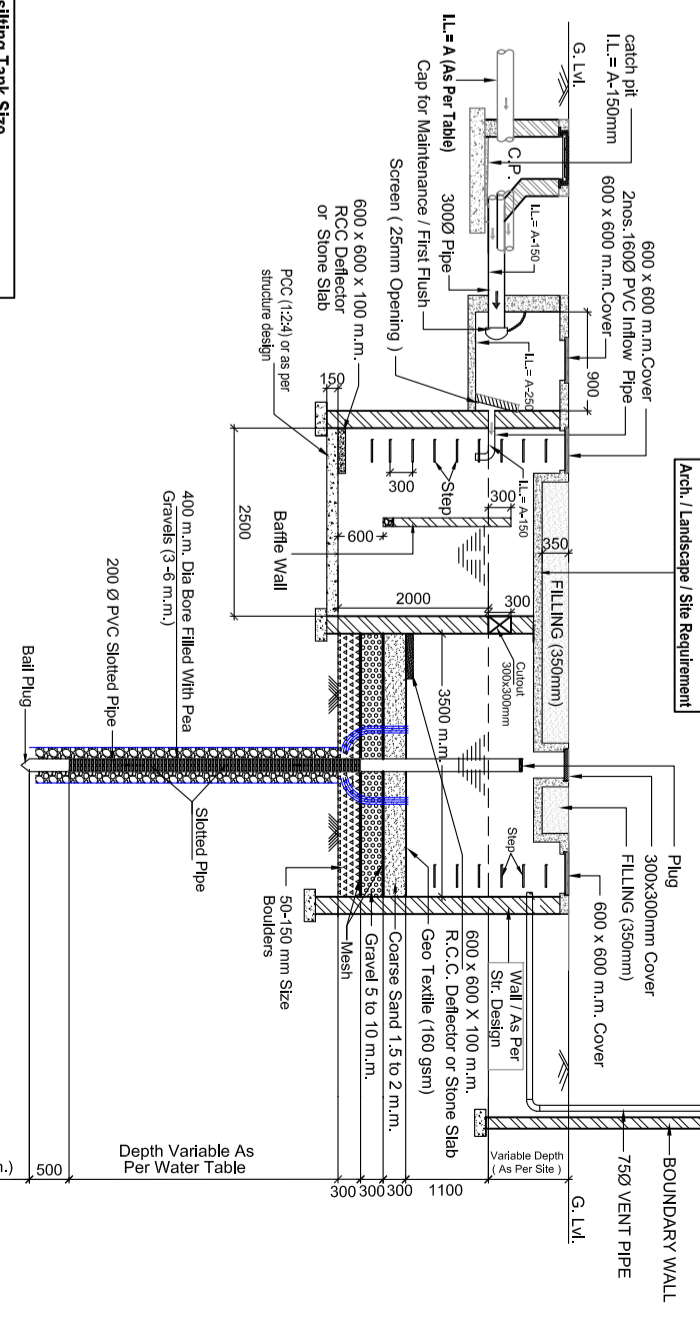

Section RW/H Detail

<b>Deslting Tank Size</b>	(L) = 2500 mm (W) = 1750 mm Effective Depth (D) = 2000 mm
<b>Recharge Pit Size</b>	(L) = 3500 mm (W) = 1750 mm Effective Depth (D) = 2000 mm

Total Number of RW/H = 14

S.No.	SYMBOL	DESCRIPTION
1.	M.H.	MANHOLE
2.	SEWER LINE	SEWER LINE
3.	C.P.	CATCH PIT
4.	— — — — —	UNDER GROUND PIPE DRAIN
5.	— — — — —	DOMESTIC WATER SUPPLY LINE
6.	— — — — —	MUNICIPAL WATER SUPPLY PIPE LINE
7.	— — — — —	RECYCLED WATER SUPPLY LINE FOR FLUSHING & HORTICULTURE
8.	— — — — —	PROPOSED TIE WELL
9.	— — — — —	GARDEN HYDRANT
10.	— — — — —	BASEMENT RETAINING WALL
11.	— — — — —	RAIN WATER HARVESTING
12.	— — — — —	

LEGEND : FIRE SYSTEM

S.No.	SYMBOL	DESCRIPTION
1.	— — — — —	FIRE LINE
2.	— — — — —	YARD WIREMANT 63 MM DIA. SINGLE HEADED WIREMANT VALVE WITH 200G. 55 MM LONGS M.M. DIA. FIRE HOSE PIPE & NO. BRANCH PIPE WITH NOZZLE
3.	— — — — —	4 WAY FIRE BRIGADE NET CONNECTION
4.	— — — — —	BUTTERFLY VALVE
5.	— — — — —	CONCRETE VALVE CHECK VALVE
6.	— — — — —	MASONRY CHAMBER FOR SOLID/MO VALVE

Project	<b>NIRALA ESTATE AT GREATER NOIDA</b> PLOT NO. GH-04, TECHZONE - IV FOR - M/S NIRALA INFRA TECH PVT.LTD
Subtitle	<b>LAYOUT PLAN (PHASE - II TO VI)</b>
Scale	1 : 500
date	October 2018
Scale	1 : 500
Scale	1 : 500

**ARCHITECTS**  
**DEEPAK MEHTA & ASSOCIATES**  
ARCHITECTS, PLANNERS, LANDSCAPE ARCHITECTS & INTERIORS  
14/2, 2ND FLOOR, PLOT NO. 16, ABHIRAM POKHRA, L.S.C., ANAND VIHAR PH - II  
DELHI - 110016, INDIA. TEL : 91-11-22791941, 91-9992979173  
Email : deepakmehta@deepakmehta.com, Website : www.deepakmehta.com

**Services consultant**  
**Consummate Engineering Services (P) Ltd.**  
Head Office - B-47 Sector - 67, Noida - 201 301  
Tel : (0120) 2385091 (30 Lines)  
Lko. Office - F-06, Bohas Purnima, Gurgaon Nagar, Ludhiana  
e mail : m@cses.in, website : www.cses.in