



SEWER INVERT LVL. MIN. 900MM BELOW FINISH ROAD LVL (FRL)



SEWERING

11-11

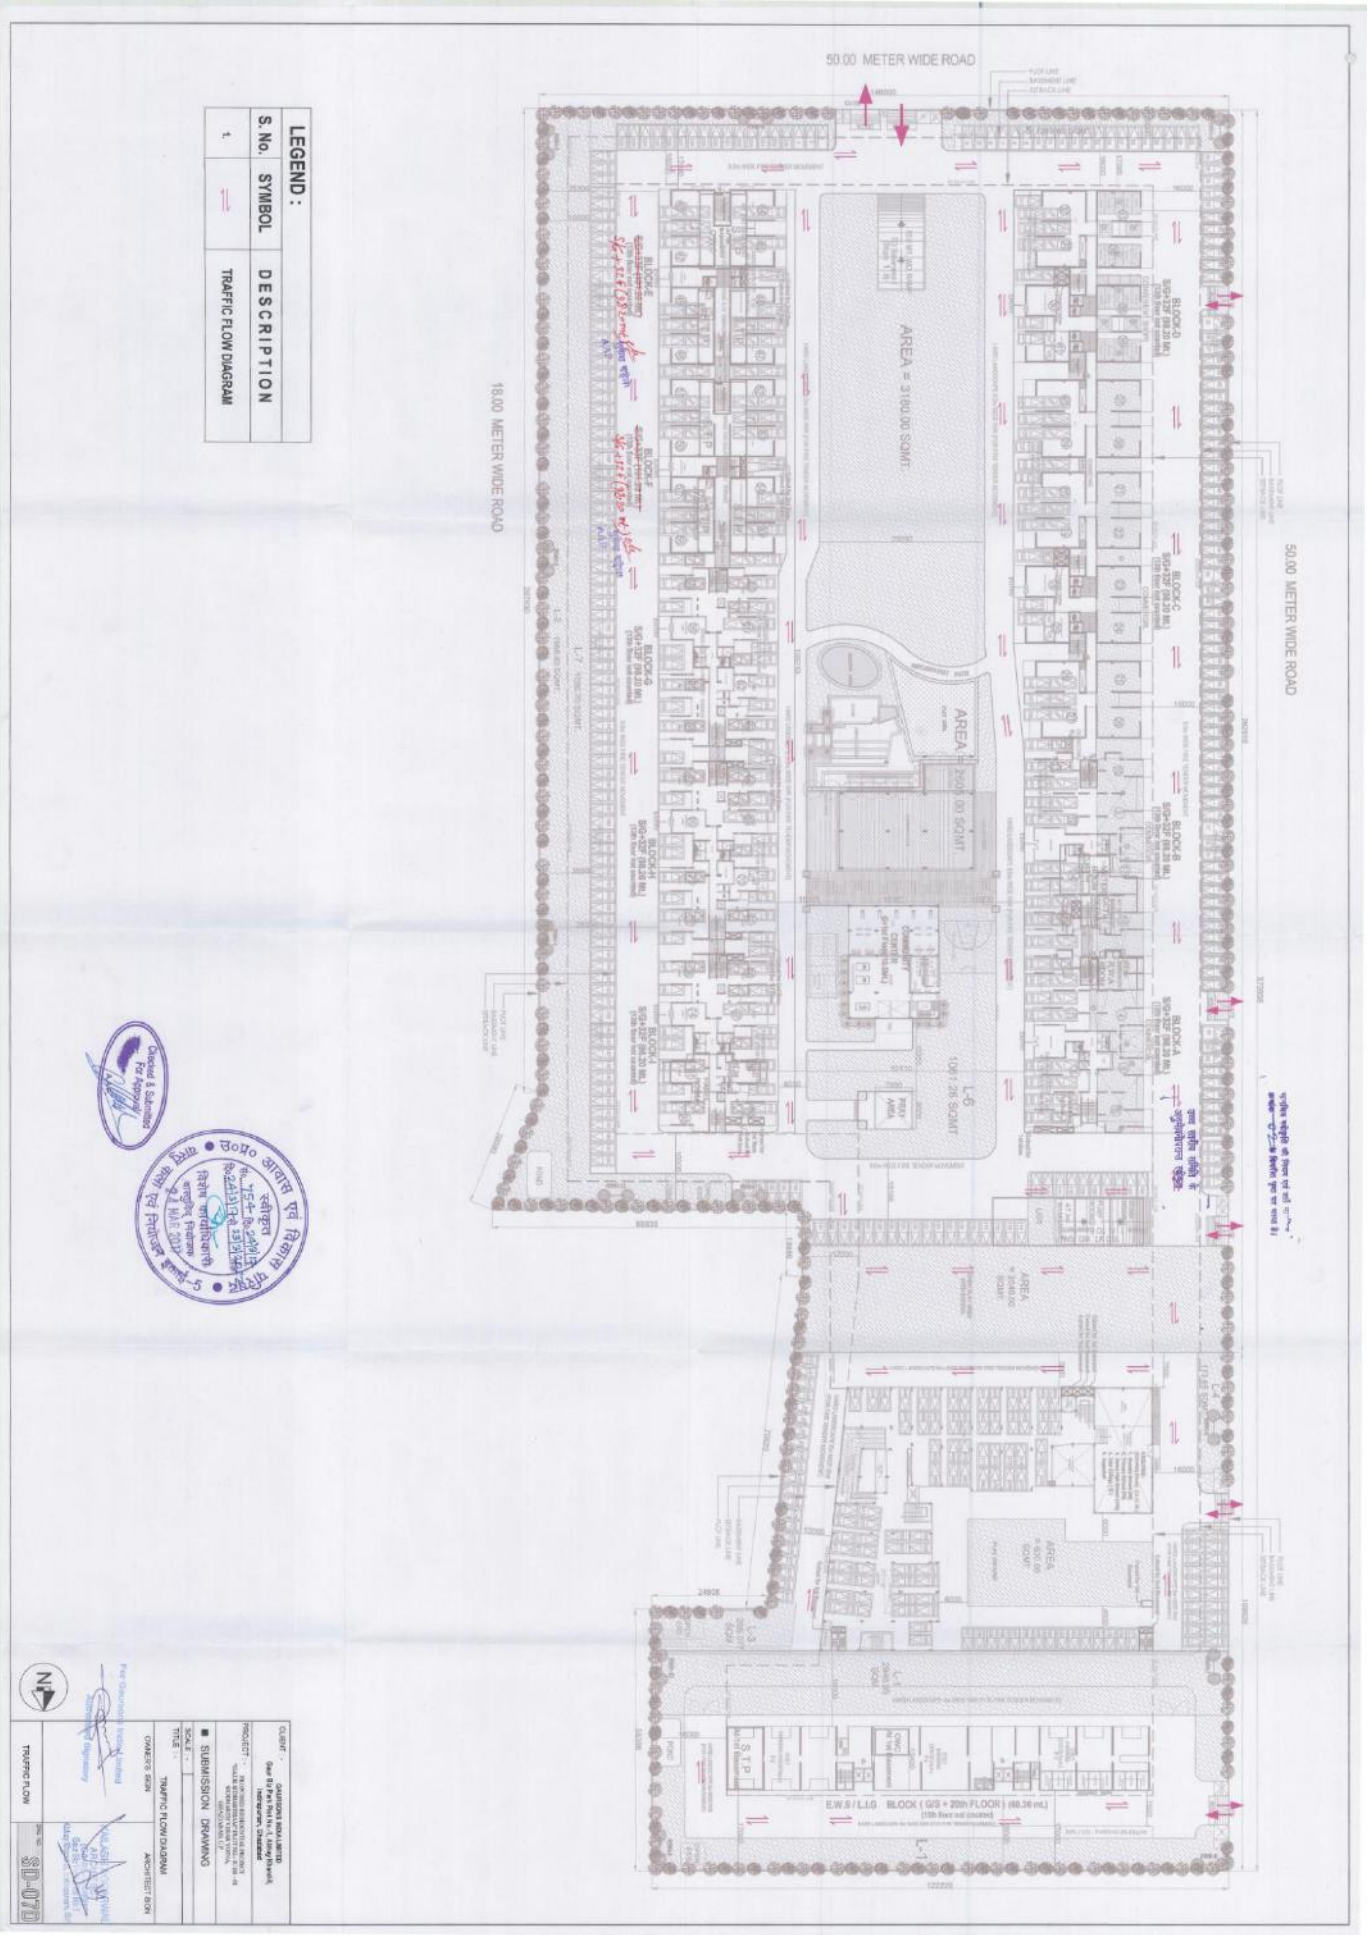

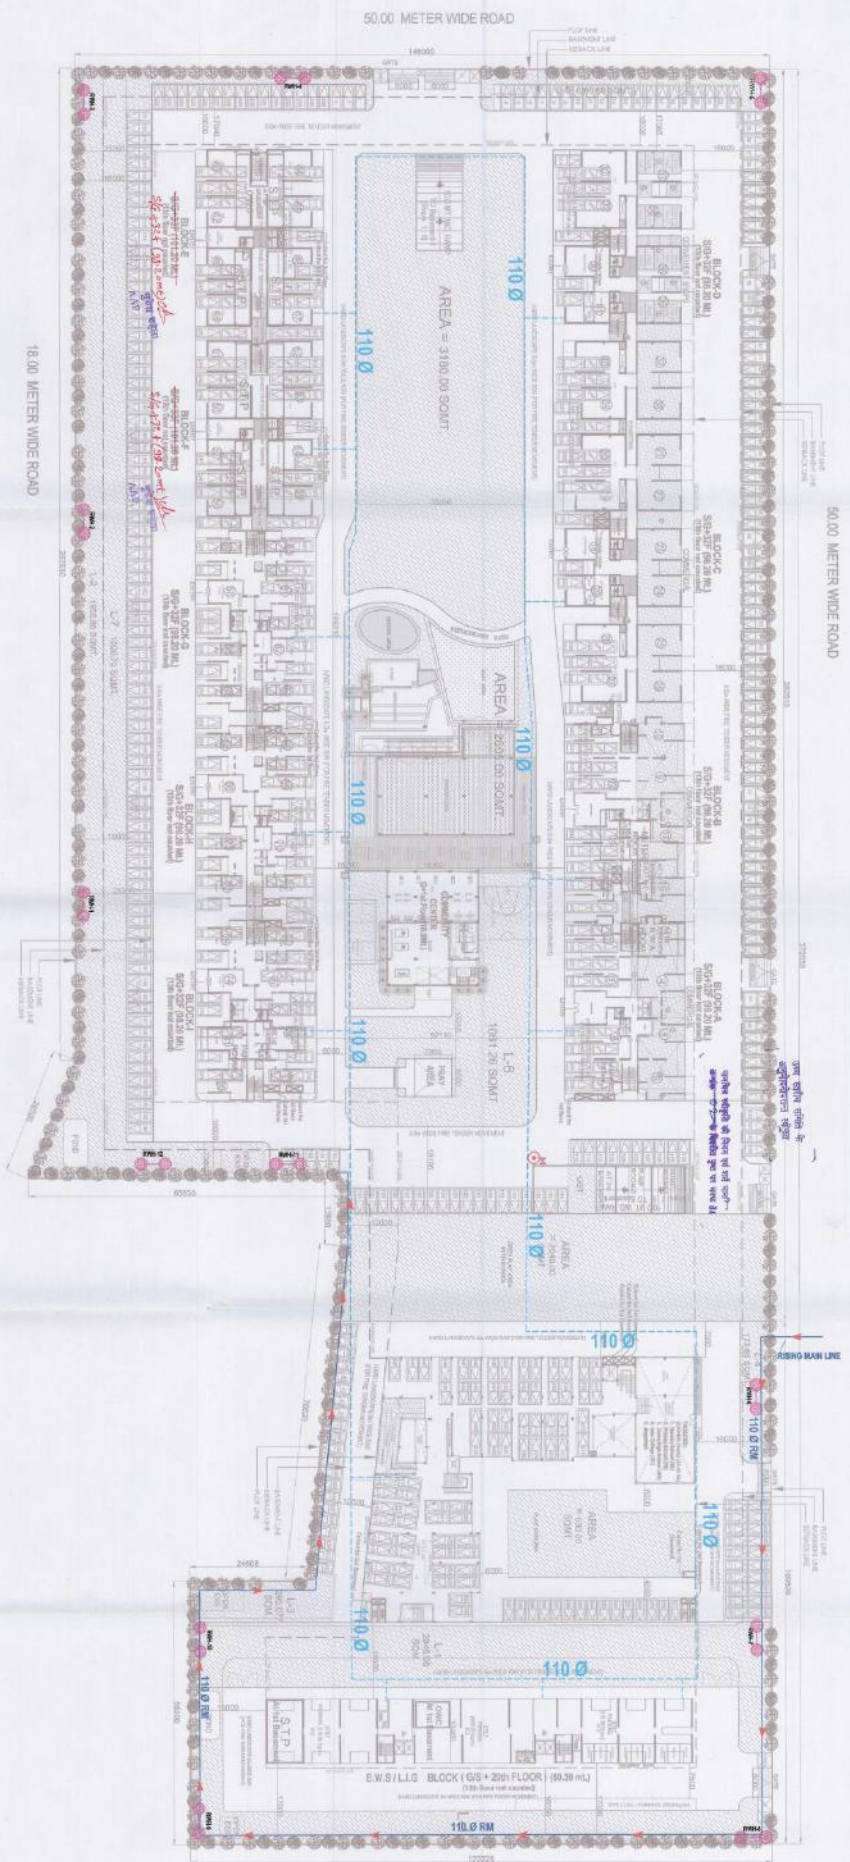

NOTES :

1. THE DEPTH OF WATER LINE SHALL BE AS FOLLOWS :
 - a) DOMESTIC WATER SUPPLY LINE 1050 MM.
 - b) RECYCLE WATER SUPPLY LINE 900 MM.
 - c) RISING MAIN 1200 MM.
2. MATERIAL OF PIPE:
 - a) HDPE (PE 80) (PN 6)

LEGEND :

S. No.	SYMBOL	DESCRIPTION
1.		DISTRIBUTION WATER SUPPLY PIPE LINE
2.		RISING MAIN WATER PIPE LINE
3.		INDICATES DOMESTIC WATER SUPPLY PIPE LINE DIA
4.		INDICATES RISING MAINS DIA
5.		ISOLATING VALVE
6.		EXISTING TUBE WELL



CLIENT : GUJARATI INVESTMENTS
DR. B. P. Patel & Associates
CHARTERED ENGINEERS
PROJECT : WATER SUPPLY LAYOUT PLAN
SCALE : 1:1000
SUBMISSION DRAWING
DATE : 15.4.2023
DRAWN BY : [Signature]
CHECKED BY : [Signature]
DATE : 15.4.2023
PROJECT : WATER SUPPLY LAYOUT PLAN
SCALE : 1:1000
SUBMISSION DRAWING
DATE : 15.4.2023
DRAWN BY : [Signature]
CHECKED BY : [Signature]
DATE : 15.4.2023

SD-07E

