PRODUCED BY AN AUTODESK STUDENT VERSION

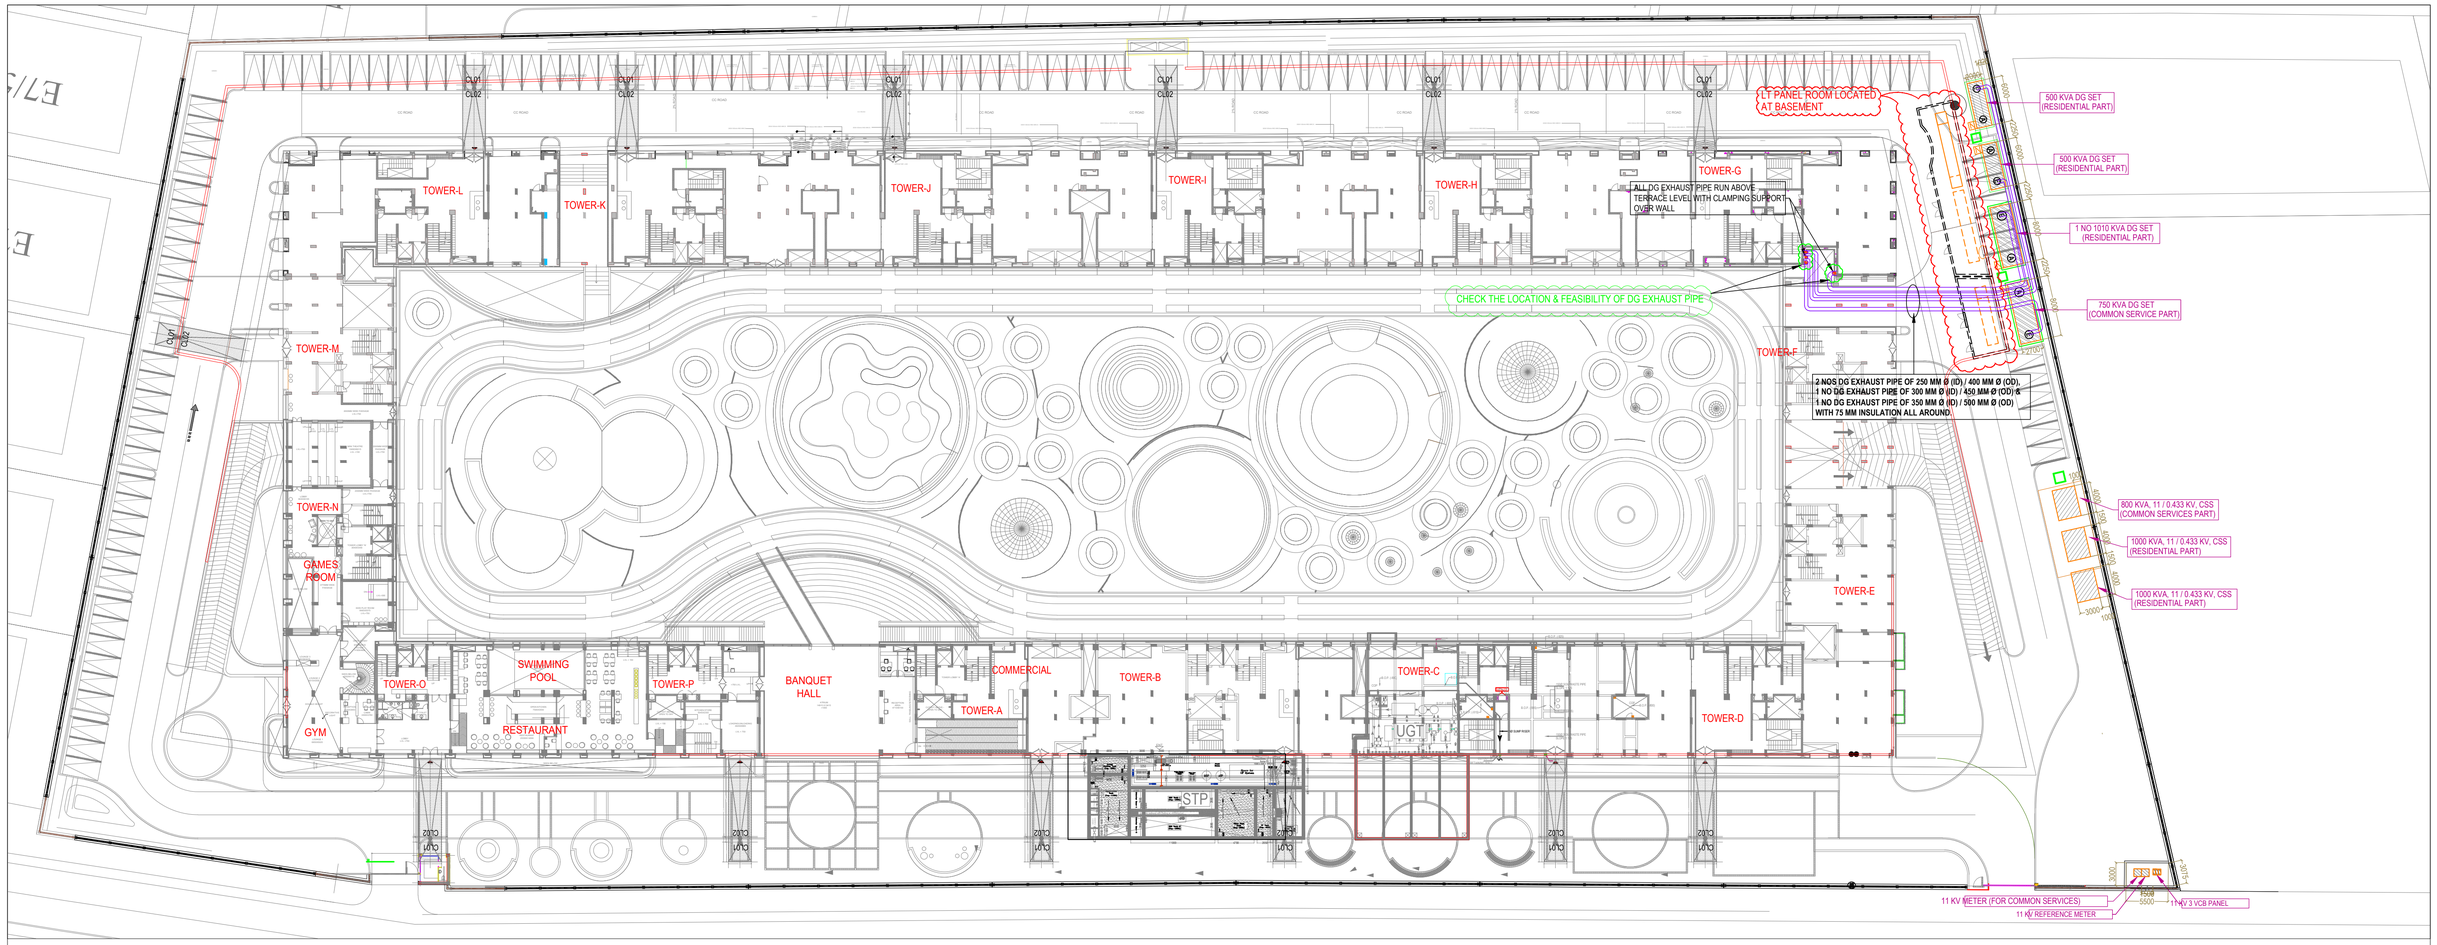

rev. no.	date	revision
R1	07-04-2022	DG SET LOCATION REVISED
R0	02.02.2022	GFC ISSUED.

project
ORANGE CASTLE
AT LUCKNOW

title
ELECTRICAL DRAWING

subtitle
SETTING OUT PLAN

drawing released for
- [x] APPROVAL
- [ ] SUBMISSION
- [ ] ADVANCE COPY
- [ ] CONSTRUCTION

drg. no. OC / ELEC / EXT - 01	drawn by Najmul
scale 1 : 400 @ A1	designed by Ateeq Ur Rehman
date February, 2022	checked by Anand Havelia

architects
ARCHOHM
c-28c, sector-8, noida - 201301 (up), tel : 91 120 46 40 300, fax : 91 120 42 46 788
mail@archohm.com www.archohm.com

services consultant
Consummate Engineering Services (P) Ltd.
cespl
Noida Office : B - 67, Sector - 67, Noida - 201 301
Tel : (0120) 2303500 (30 Lines)
Lko. Office : R 006, Rohtas Plumeria, Gomti Nagar, Lucknow
e mail : mail@cespl.in, website : www.cespl.in

NOTES :
1) Clear height of 11 KV Meter shall be minimum 3.6 mtr.
2) Plinth Level of 11 KV Meter & VCB room shall be 450 mm above final finished ground level.
3) Trench detail shall be finalized after receiving foundation detail of 11 KV Meter & Transformer.
4) The exact size of DG exhaust pipe shall be finalized by the vendor after calculating the Back Pressure as per actual site conditions.
5) The foundation of Transformer / DG set shall be as per manufactures details.
6) The size of HT Panel Room should be cross checked by the HT Panel manufacture.

PRODUCED BY AN AUTODESK STUDENT VERSION
PRODUCED BY AN AUTODESK STUDENT VERSION
PRODUCED BY AN AUTODESK STUDENT VERSION