


EXTERNAL WATER SUPPLY SYSTEM

PROPOSED TOWNSHIP (SPRING GARDEN)
AT KHASRA NO.
(374-376,380,381,383-387,404-407,419-422)
VILLAGE UTTARDHAUNA AT
FAIZABAD ROAD,LUCKNOW.

External Water Supply Scheme							
Line No	U/S Node	D/S Node	Length	Dia	Pipe		
			In M	mm	Material	7	8
1	2	3	4	7	8		
1	1	2	12	81	PVC		
2	2	3	14	81	PVC		
3	3	4	65	81	PVC		
4	3	5	89	81	PVC		
5	5	6	54	81	PVC		
6	5	7	48	81	PVC		
7	7	8	15	81	PVC		
8	7	9	70	81	PVC		
9	2	10	32	81	PVC		
10	10	11	47	81	PVC		
11	11	12	54	81	PVC		
12	10	13	47	81	PVC		
13	13	14	45	81	PVC		
14	14	15	82	81	PVC		
15	16	15	48	81	PVC		
16	13	16	82	81	PVC		
17	16	17	12	81	PVC		
		21					
21	21	22	10	80	PVC		
22	22	23	13	80	PVC		
23	24	23	26	81	PVC		
24	25	24	28	81	PVC		
25	26	25	28	81	PVC		
26	22	28	12	81	PVC		
27	24	27	13	81	PVC		
28	25	28	13	81	PVC		
29	23	29	43	81	PVC		
30	29	30	47	81	PVC		
31	29	31	99	81	PVC		
32	29	32	36	81	PVC		
33	32	33	33	81	PVC		
34	32	34	78	81	PVC		
35	23	35	28	81	PVC		
36	35	36	49	81	PVC		
37	36	37	25	81	PVC		
38	38	37	49	81	PVC		
39	35	38	25	81	PVC		
40	36	39	11	81	PVC		
41	37	40	11	81	PVC		
42	28	41	38	81	PVC		
43	41	42	87	81	PVC		
		51					
51	51	52	10	81	PVC		
52	52	53	14	81	PVC		
53	53	54	28	81	PVC		
54	55	54	55	81	PVC		
55	56	55	29	81	PVC		
56	52	56	41	81	PVC		
57	54	57	13	81	PVC		
58	55	58	13	81	PVC		
59	53	59	38	81	PVC		
60	59	60	97	81	PVC		
61	53	61	28	81	PVC		
62	61	62	34	81	PVC		
63	62	63	54	81	PVC		
64	64	63	34	81	PVC		
65	61	64	54	81	PVC		
66	62	65	35	81	PVC		
67	63	66	12	81	PVC		
68	56	67	29	81	PVC		
69	67	68	81	81	PVC		
Total			2253	81	PVC		
			23	99	PVC		
Total			2276				

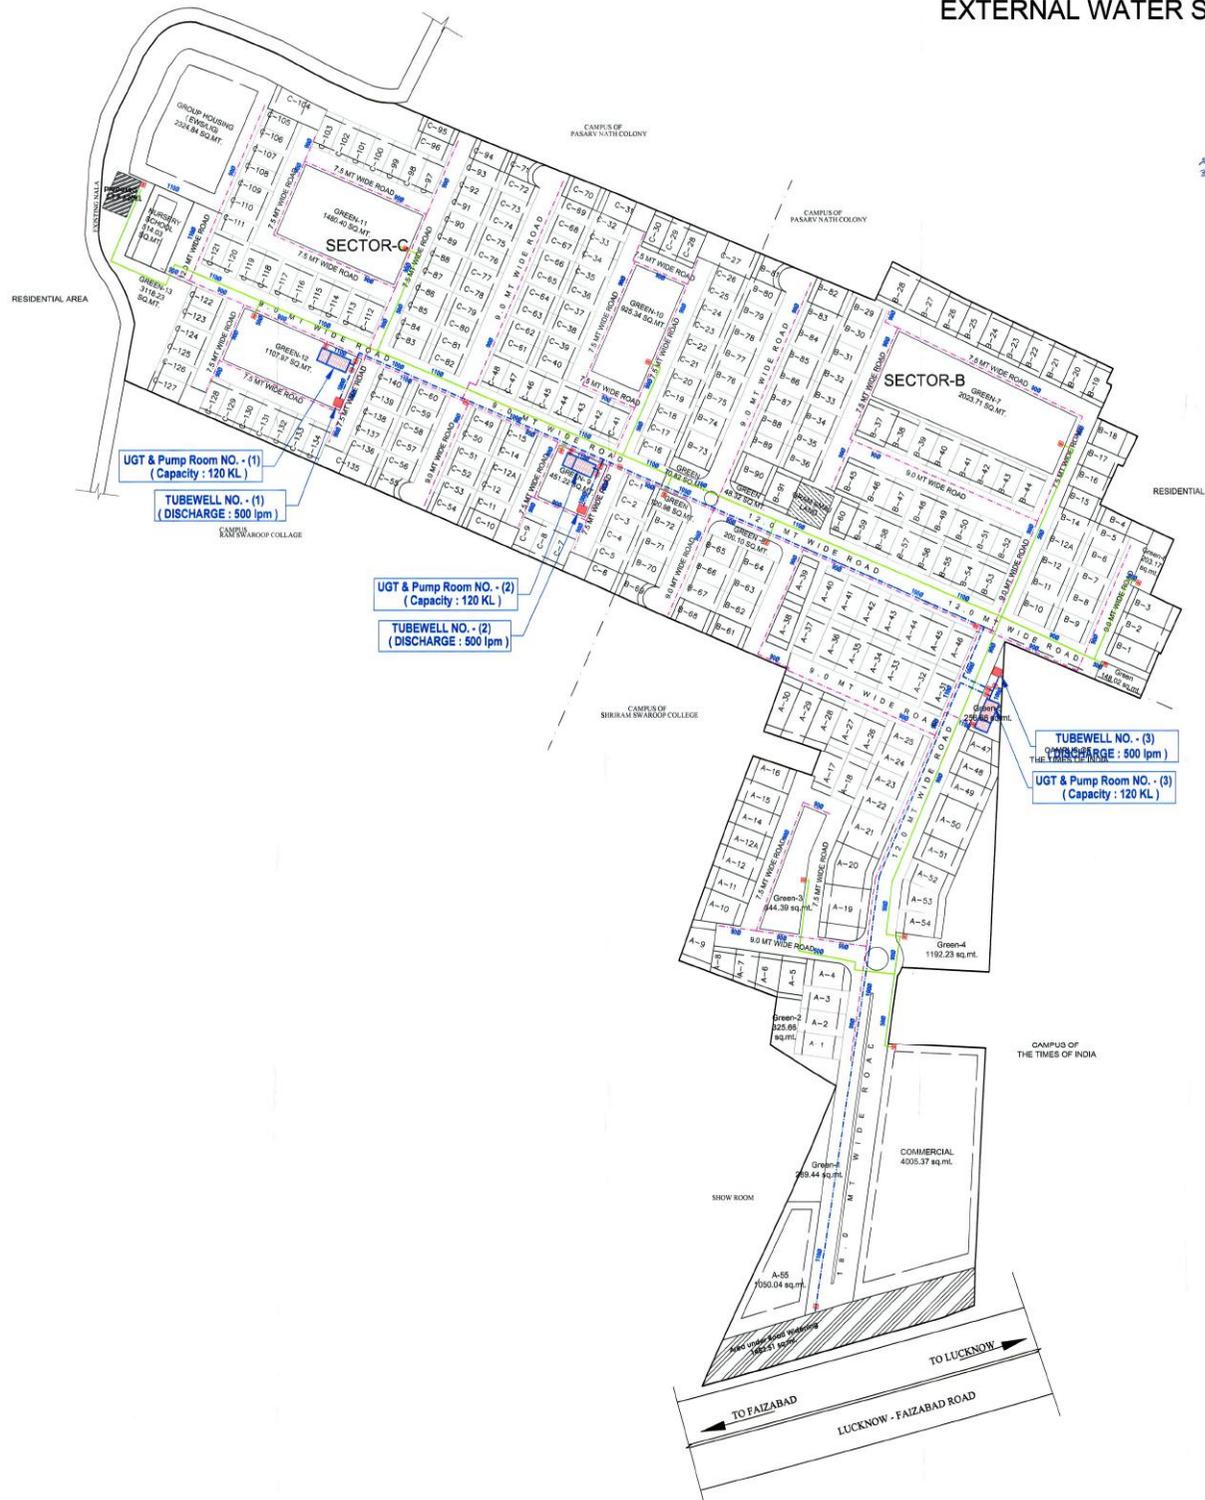

Handwritten notes in Hindi and a circular stamp with the text 'Dette' and other illegible text.

LEGEND : (WATER SUPPLY SYSTEM)		
S.No.	SYMBOL	DESCRIPTION
1.	---	DISTRIBUTION WATER LINE (PVC OR HDPE)
2.	---	RECYCLE WATER LINE
3.	---	TRUNK WATER LINE
4.	---	ISOLATING VALVE
5.	---	MASONRY CHAMBER FOR ISOLATING VALVE
6.	---	FORMATION LEVEL (FINISHED ROAD LEVEL)
7.		
8.		
9.		

- NOTES : (WATER SUPPLY SYSTEM)**
1. THE DEPTH OF WATER SUPPLY MAIN SHALL BE 1000 MM BELOW DRESSED GROUND LEVEL.
 2. LOCATION OF MAIN WATER SUPPLY LINE SHALL BE ON THE OPPOSITE SIDE OF MAIN SEWER LINE.
 3. C.I. DOUBLE FLANGED AS PER IS : 1538 SHALL BE PROVIDED FOR ALL INLETS & OUTLETS OF OVER HEAD TANKS.

PIPE MATERIAL :	
1. 900 / 1100 PIPE	HDPE PVC (800mm) OR HDPE PVC (1000mm)

CLIENT
SPRING GARDEN
B-46, VIBHUTI KHAND,
GOMTI NAGAR, LUCKNOW.

SERVICESCONSULTANT
S Shiv Sunder Constructions &
S Consultants (P) Ltd.
5/763, Vikas Khand, Gomti Nagar, Lucknow
Mob No - 9936190952
email : enggimate@gmail.com

ARCHITECT
dimension plus studio
architecture | landscape | interiors | planning |
add: Vijay Khand, Gomti Nagar, Lucknow . U.P.

DWG TITLE	
EXTERNAL WATER SUPPLY SYSTEM	
DATE	NORTH
18 nov 2018	
SCALE	DWG NO.
1:650	SPG/LOP-03
CLIENT'S SIGN	ARCHITECTS SIGN