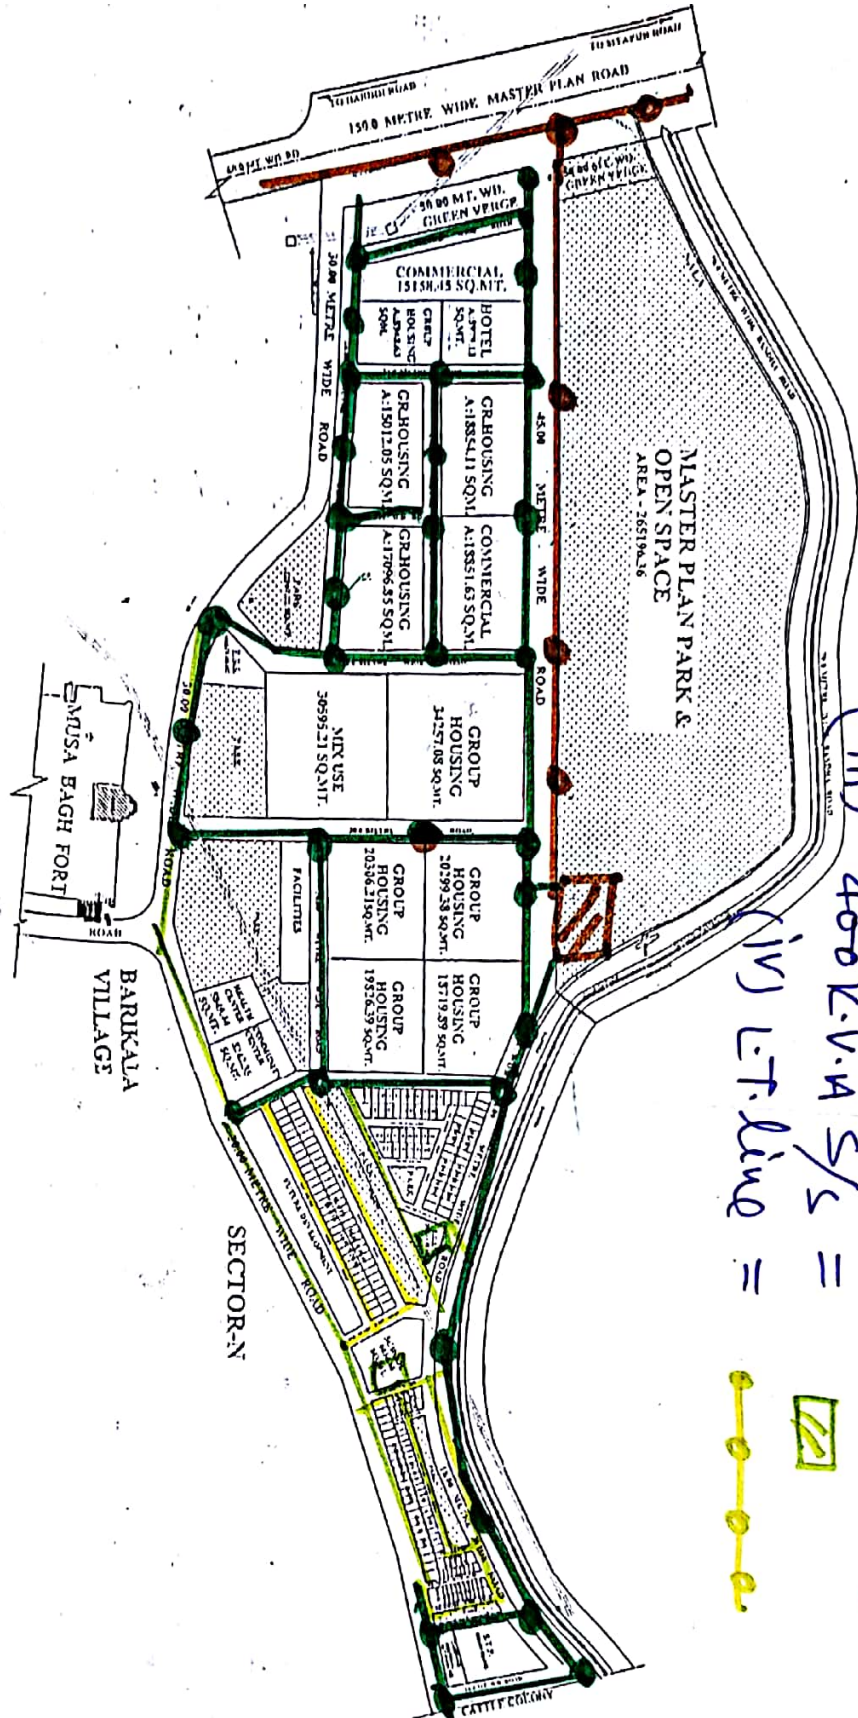



Index

(1) 33KV line with 33/11KV 2X1000V.A

(ii) 11KV line $\frac{5}{3}$

(III) $400\text{K.V.A } 5/5 =$

(iv) E.T. line =

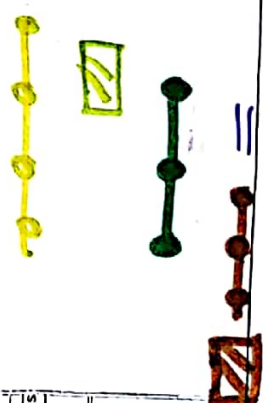

REVISED LAYOUT PLAN
OF SECTOR - J,
BASANT KUNJ,
HARDOI ROAD SCHEME,
LUCKNOW.

DETAIL OF AREA STATEMENT.

[illegible]

DETAIL OF PLOTS

DETAIL OF PLOTS			
SN\PLOTS	SIZE OF PLOTS	AREA	NOS
1. PLOTS	10.00 X 20.00	200.00 SQ. MT.	134
2. PLOTS	7.50 X 15.00	112.50 SQ. MT.	41
3. PLOTS	6.00 X 12.00	72.00 SQ. MT.	29
TOTAL	PLOTS		204

NOTE:-

1. NOC OF AG IS REQUESTED FOR ANY CONSTRUCTION WITHIN 100' FROM THE BOUNDARY OF MCDONALD'S RESTAURANT.
2. THIS LAYOUT PLAN HAS BEEN REVISED ON THE BASIS OF REVIEW GIVEN BY DDC.
3. THIS LAYOUT PLAN HAS BEEN REVISED FOR SITE VERIFICATION ONLY.

TESTATIME

DATE: APRIL 2019

DAC NO.:

DEULTSY:

CELESTIAL

LUCKNOW DEVELOPMENT AUTHORITY

11/11/2019 11:11 AM

10

२५

14

五

→

✓
D. MISHRA
T. P. DAS

22

—

14

14.11.11

100

RECEIVED
CT.

2

10

Figure 1. The effect of the concentration of the *Agrobacterium* suspension on the transformation efficiency of *Agrobacterium* strains. The *Agrobacterium* strains were incubated with the plant explants for 2 weeks. The explants were then cultured on the selective medium. The number of explants transformed was counted. The results are the mean $\pm$ SD of three independent experiments.

—

100

[illegible]