


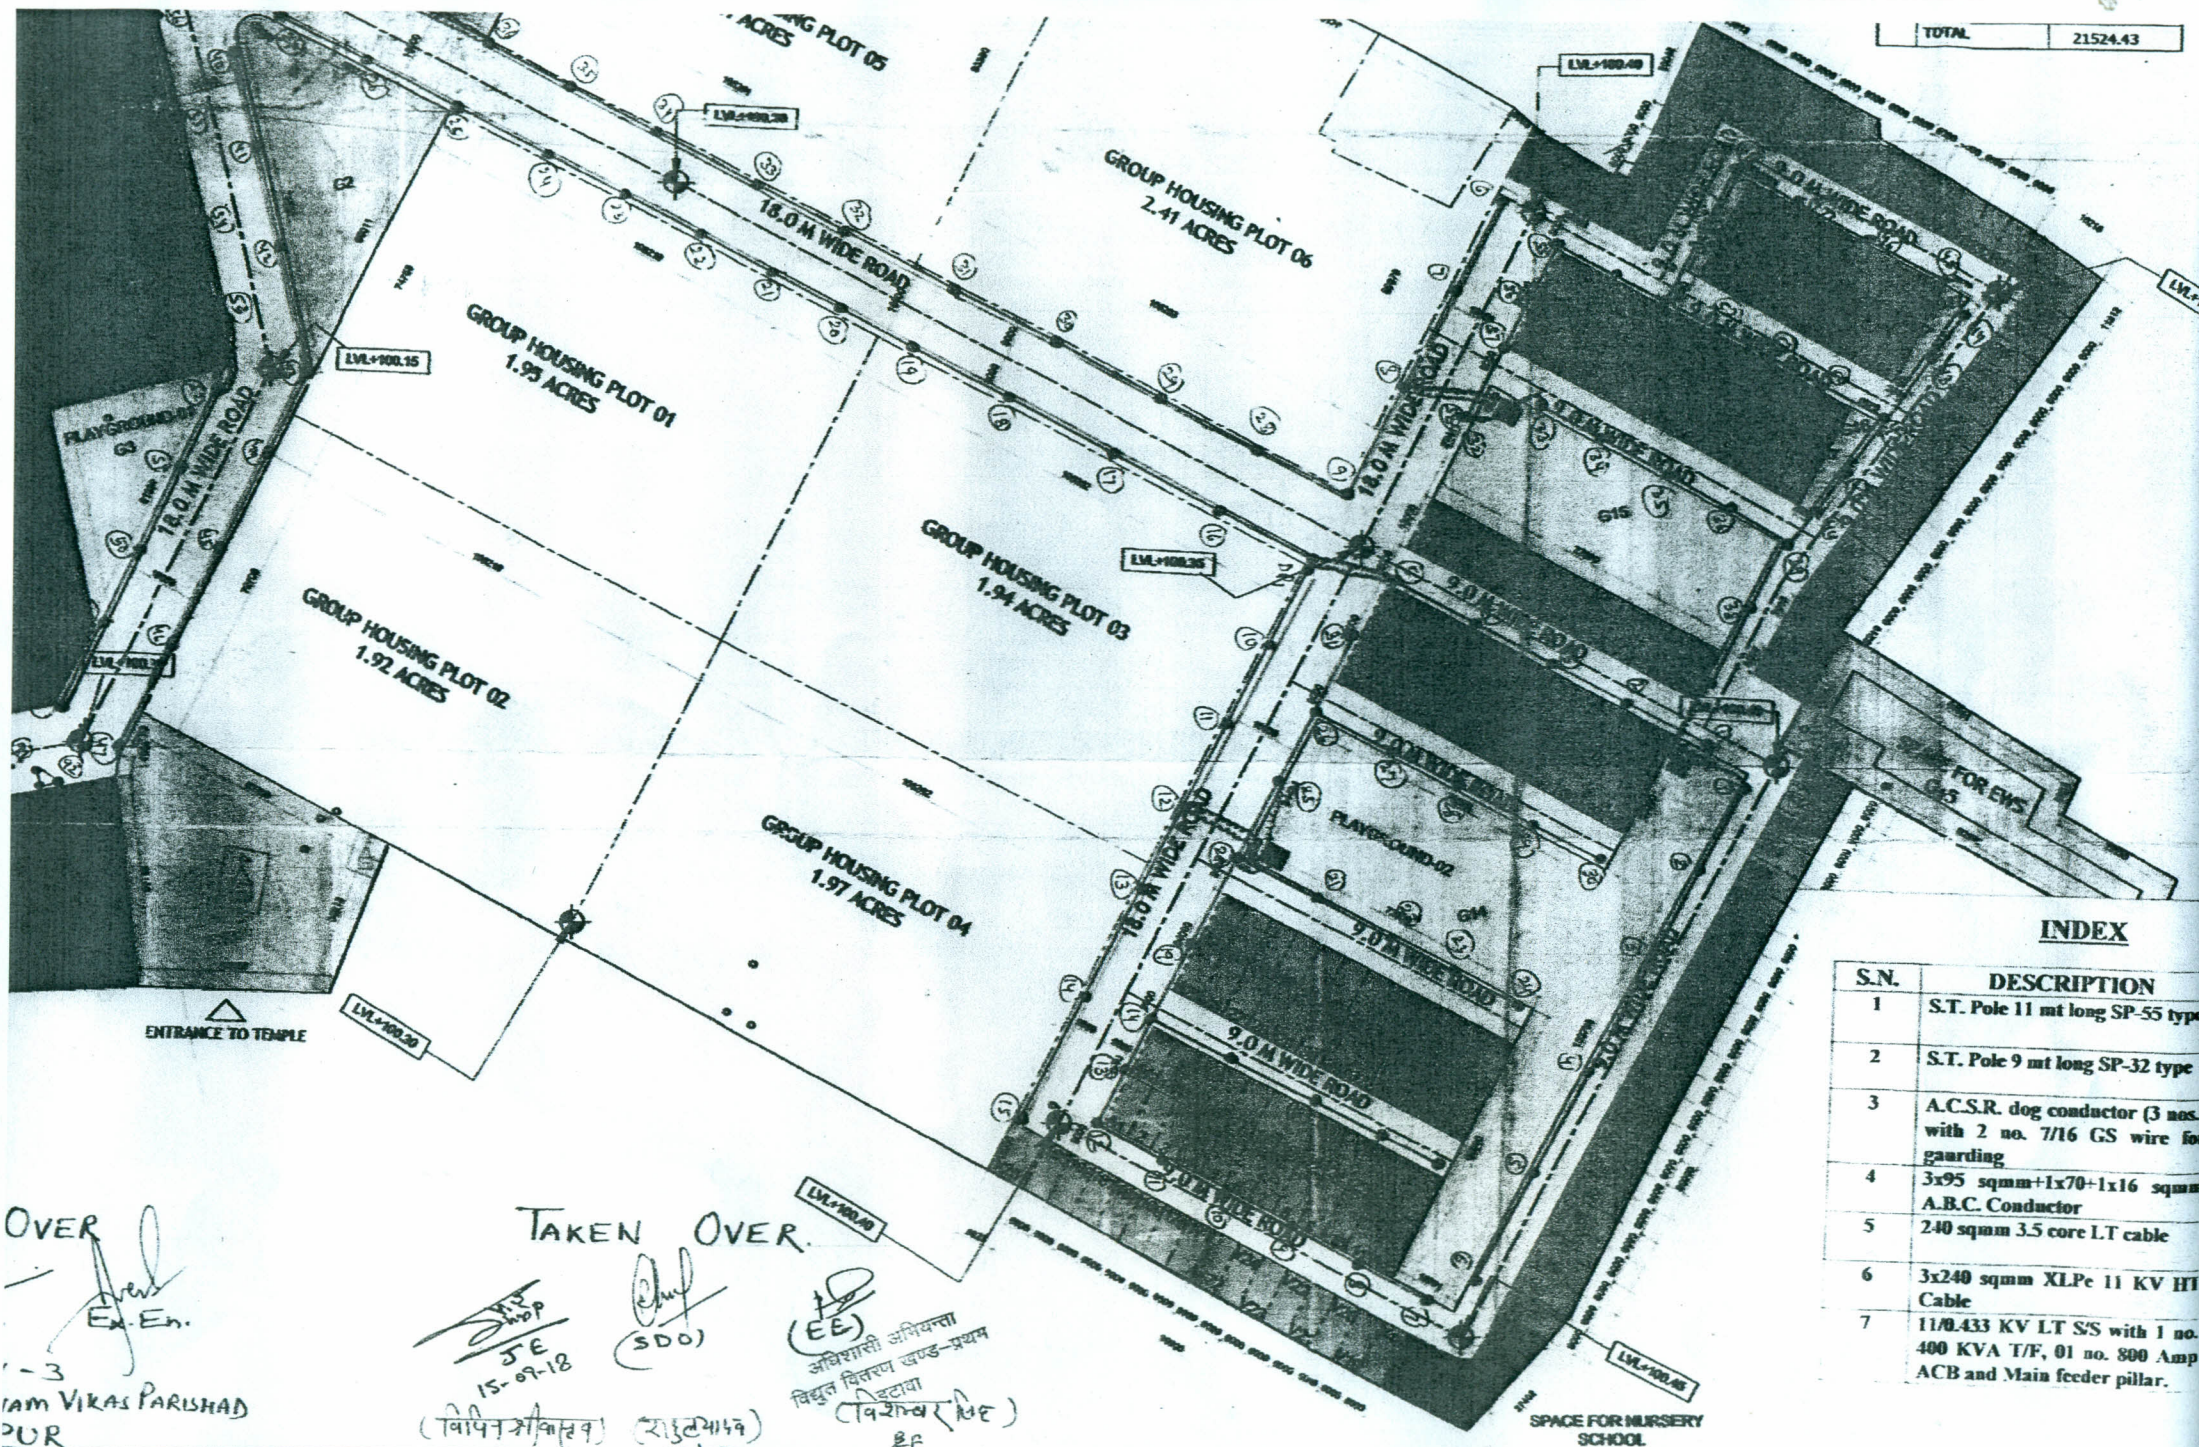

INDEX

S.N.	DESCRIPTION
1	S.T. Pole 11 mt long SP-55 type
2	S.T. Pole 9 mt long SP-32 type
3	A.C.S.R. dog conductor (3 nos. with 2 no. 7/16 GS wire for guarding)
4	3x95 sqmm+1x70+1x16 sqmm A.B.C. Conductor
5	240 sqmm 3.5 core LT cable
6	3x240 sqmm XLPe 11 KV HT Cable
7	11/0.433 KV LT S/S with 1 no. 400 KVA T/F, 01 no. 800 Amp ACB and Main feeder pillar.

OVER
 Ex-En.
 1-3
 Iam Vikas Parishad
 PUR

TAKEN OVER.

JE
 15-07-18

(S.D.O.)

(EE)
 अधिशासी अभियन्ता
 अविभागीय खण्ड-प्रथम
 विद्युत विभाग
 (विशेष अधिकारी)
 ई.ए.

REVISIONS AND ISSUES

REVISIONS -04 (PROPOSED SUBSTATION ADDED)

20-11-15

U P A V P

MASTER PLAN OF REDEVELOPMENT
 OF KATAI MILL, ETAWAH