



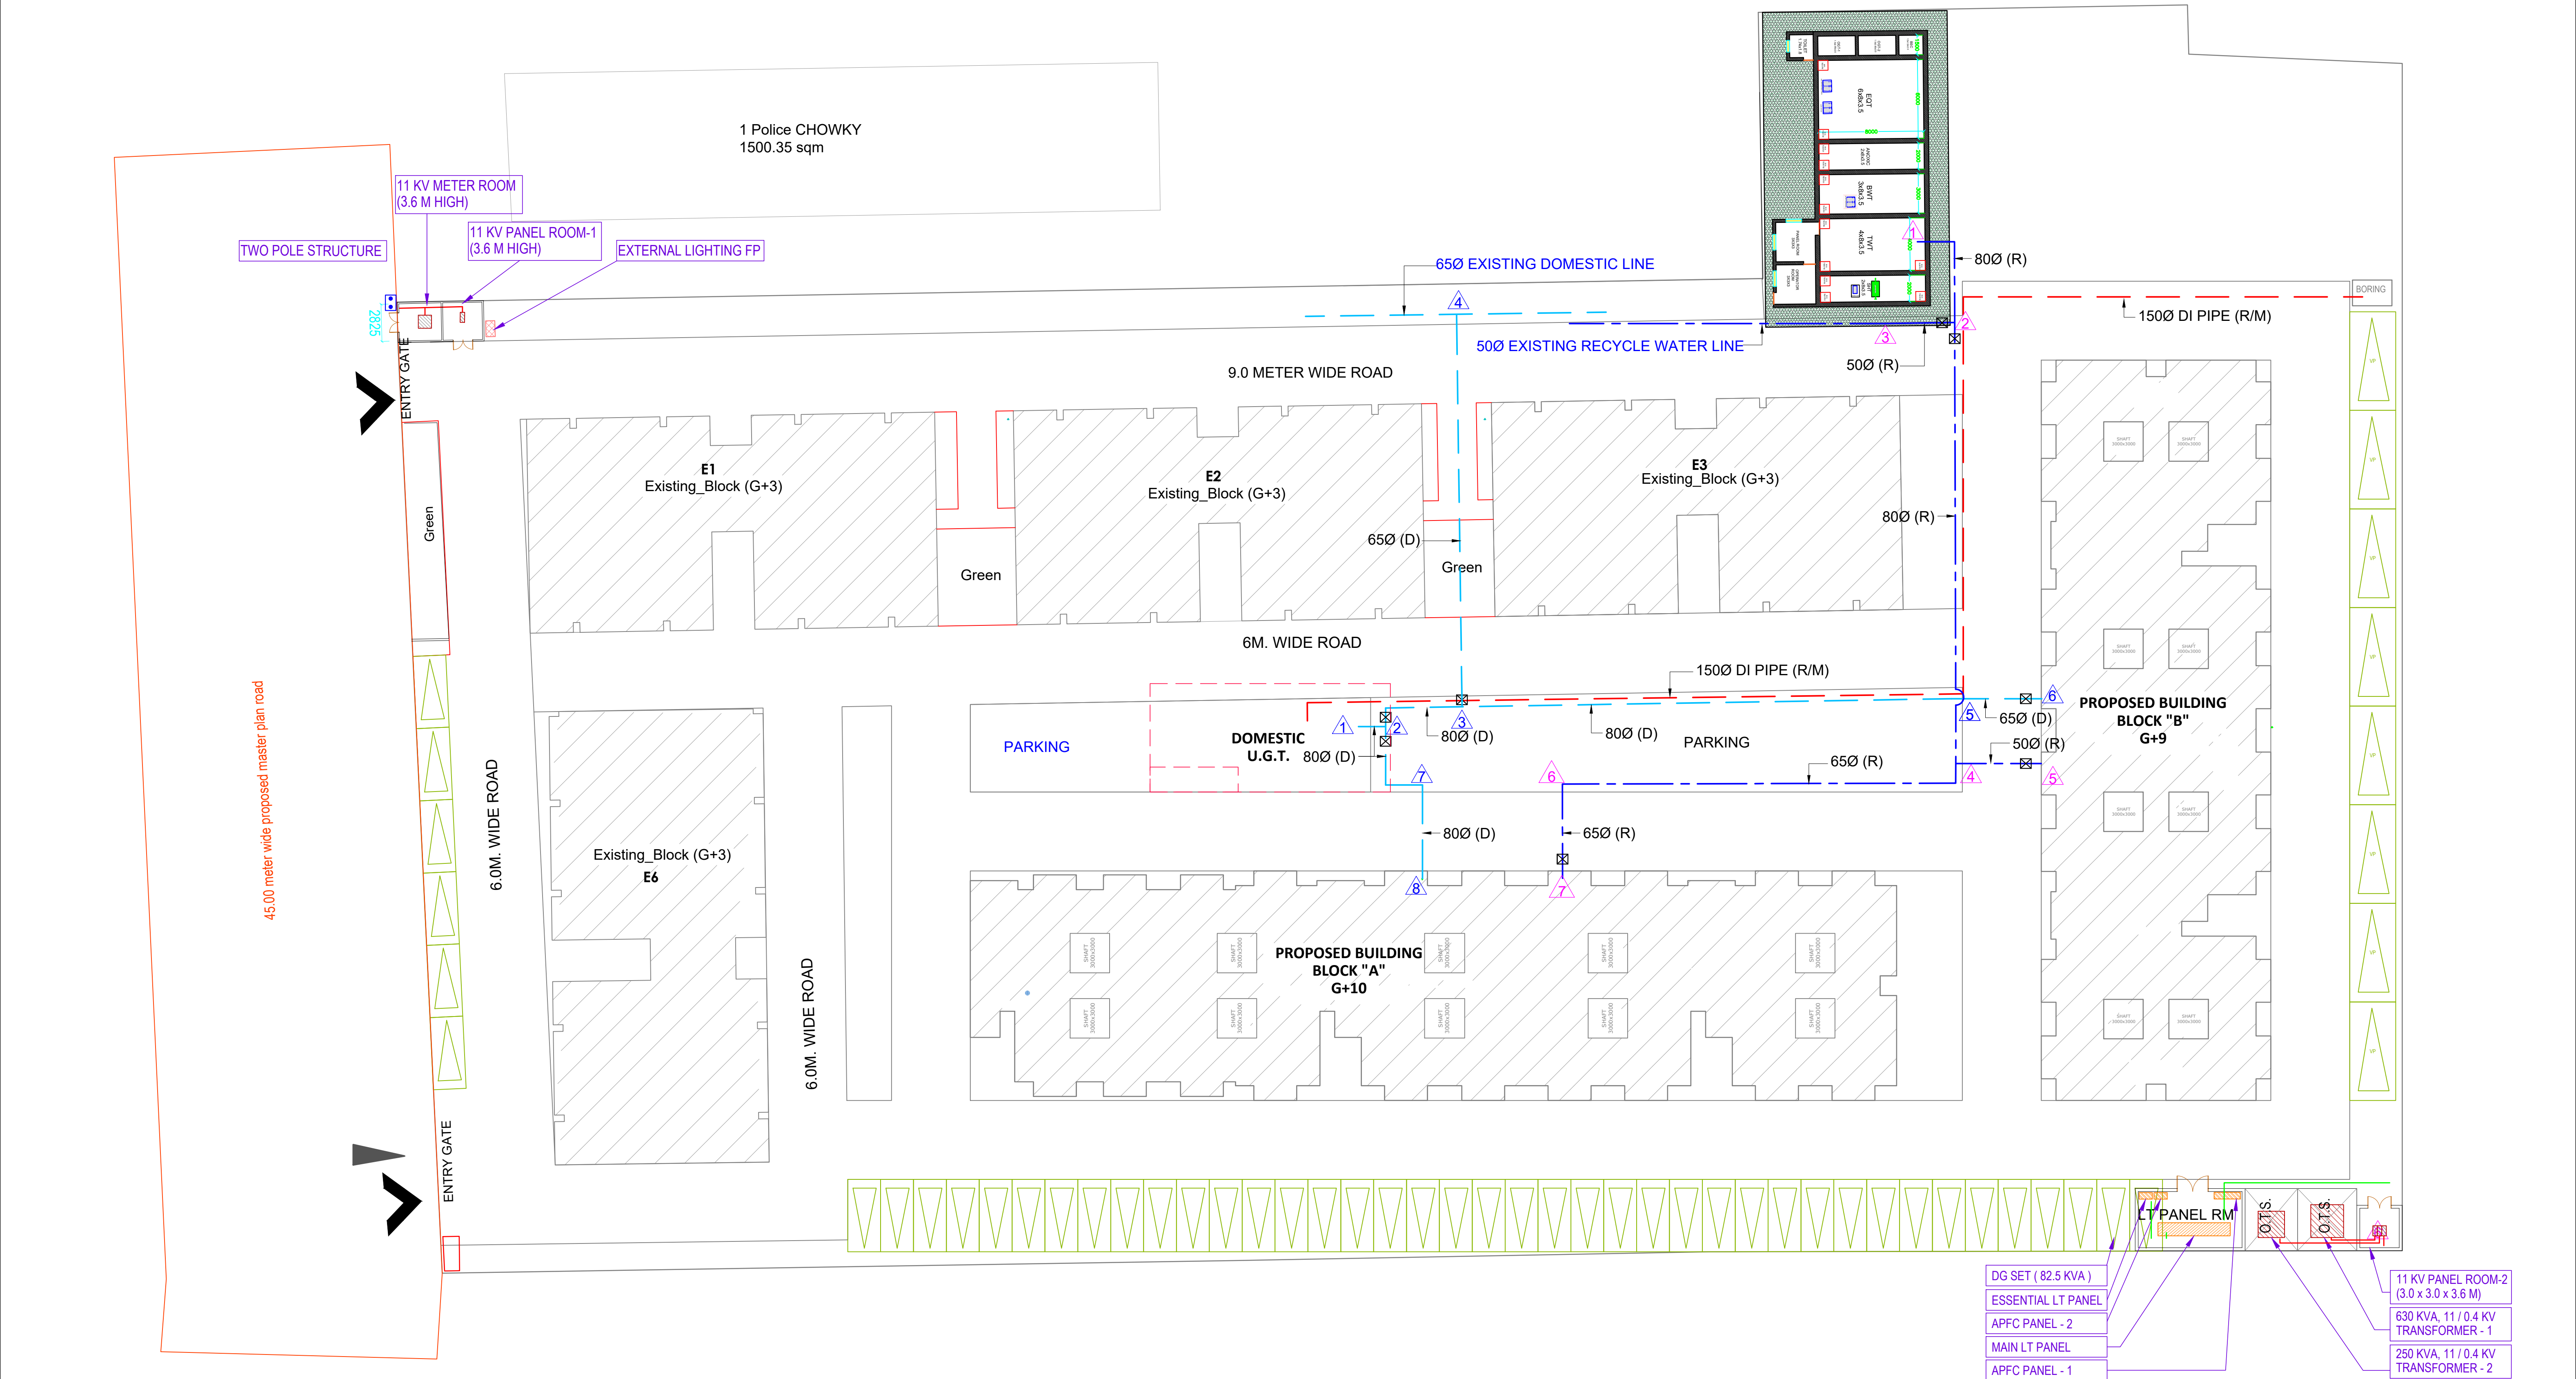

NOTES :

1. THE DEPTH OF WATER SUPPLY MAIN SHALL BE 1000 MM BELOW DRESSED GROUND LEVEL.
2. THE DEPTH OF RISING MAINS FROM TUBEWELL TO UNDER GROUND TANK SHALL BE 1200 M.M. BELOW DRESSED GROUND LEVEL.
3. THE MATERIAL OF WATER SUPPLY LINE SHALL BE
 - a) D. I. (CLASS K-7) AS PER IS : 8329 WITH TYTON JOINTS.
 - b) G. I. (CLASS B) AS PER IS : 1239 WITH TEFLON TAPE / WHITE LEAD JOINTS.
4. LOCATION OF MAIN WATER SUPPLY LINE SHALL BE ON THE OPPOSITE SIDE OF MAIN SEWER LINE.
5. DOMESTIC WATER LINE IS DENOTED BY xx Ø (D), RECYCLE WATER LINE IS DENOTED BY xx Ø (R) AND RISING MAIN DENOTED BY xx Ø (R/M).

North




PROJECT
**PROPOSED/EXISTING E.W.S.&
L.I.G.
GROUP HOUSING
EMAAR MGF LAND Ltd.**
FOR
**"GOMTI GREENS" TOWNSHIP
KH. NO. 167,168,169 & 174
(PART)
LUCKNOW**

EXTERNAL WATER
SUPPLY NETWORK
LAYOUT

services consultant

**Shiv Sunder Constructions &
Consultants (P) Ltd.**
5/763, Vikas Khand,Gomti Nagar,
Lucknow.
Mob No -9415195823 / 9450375372

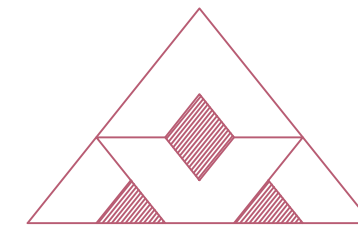

PUNIT SRIVASTAV
VASTULIPI

ARCHITECTS & INTERIOR DESIGNERS
VASTU SHASTRA CONSULTANTS
5/171, VIRAM KHAND, GOMTI NAGAR,
LUCKNOW
PH. NO.- 9415418151, 9935590999
email - vastulipi@gmail.com
web- site - www.vastulipi.com