


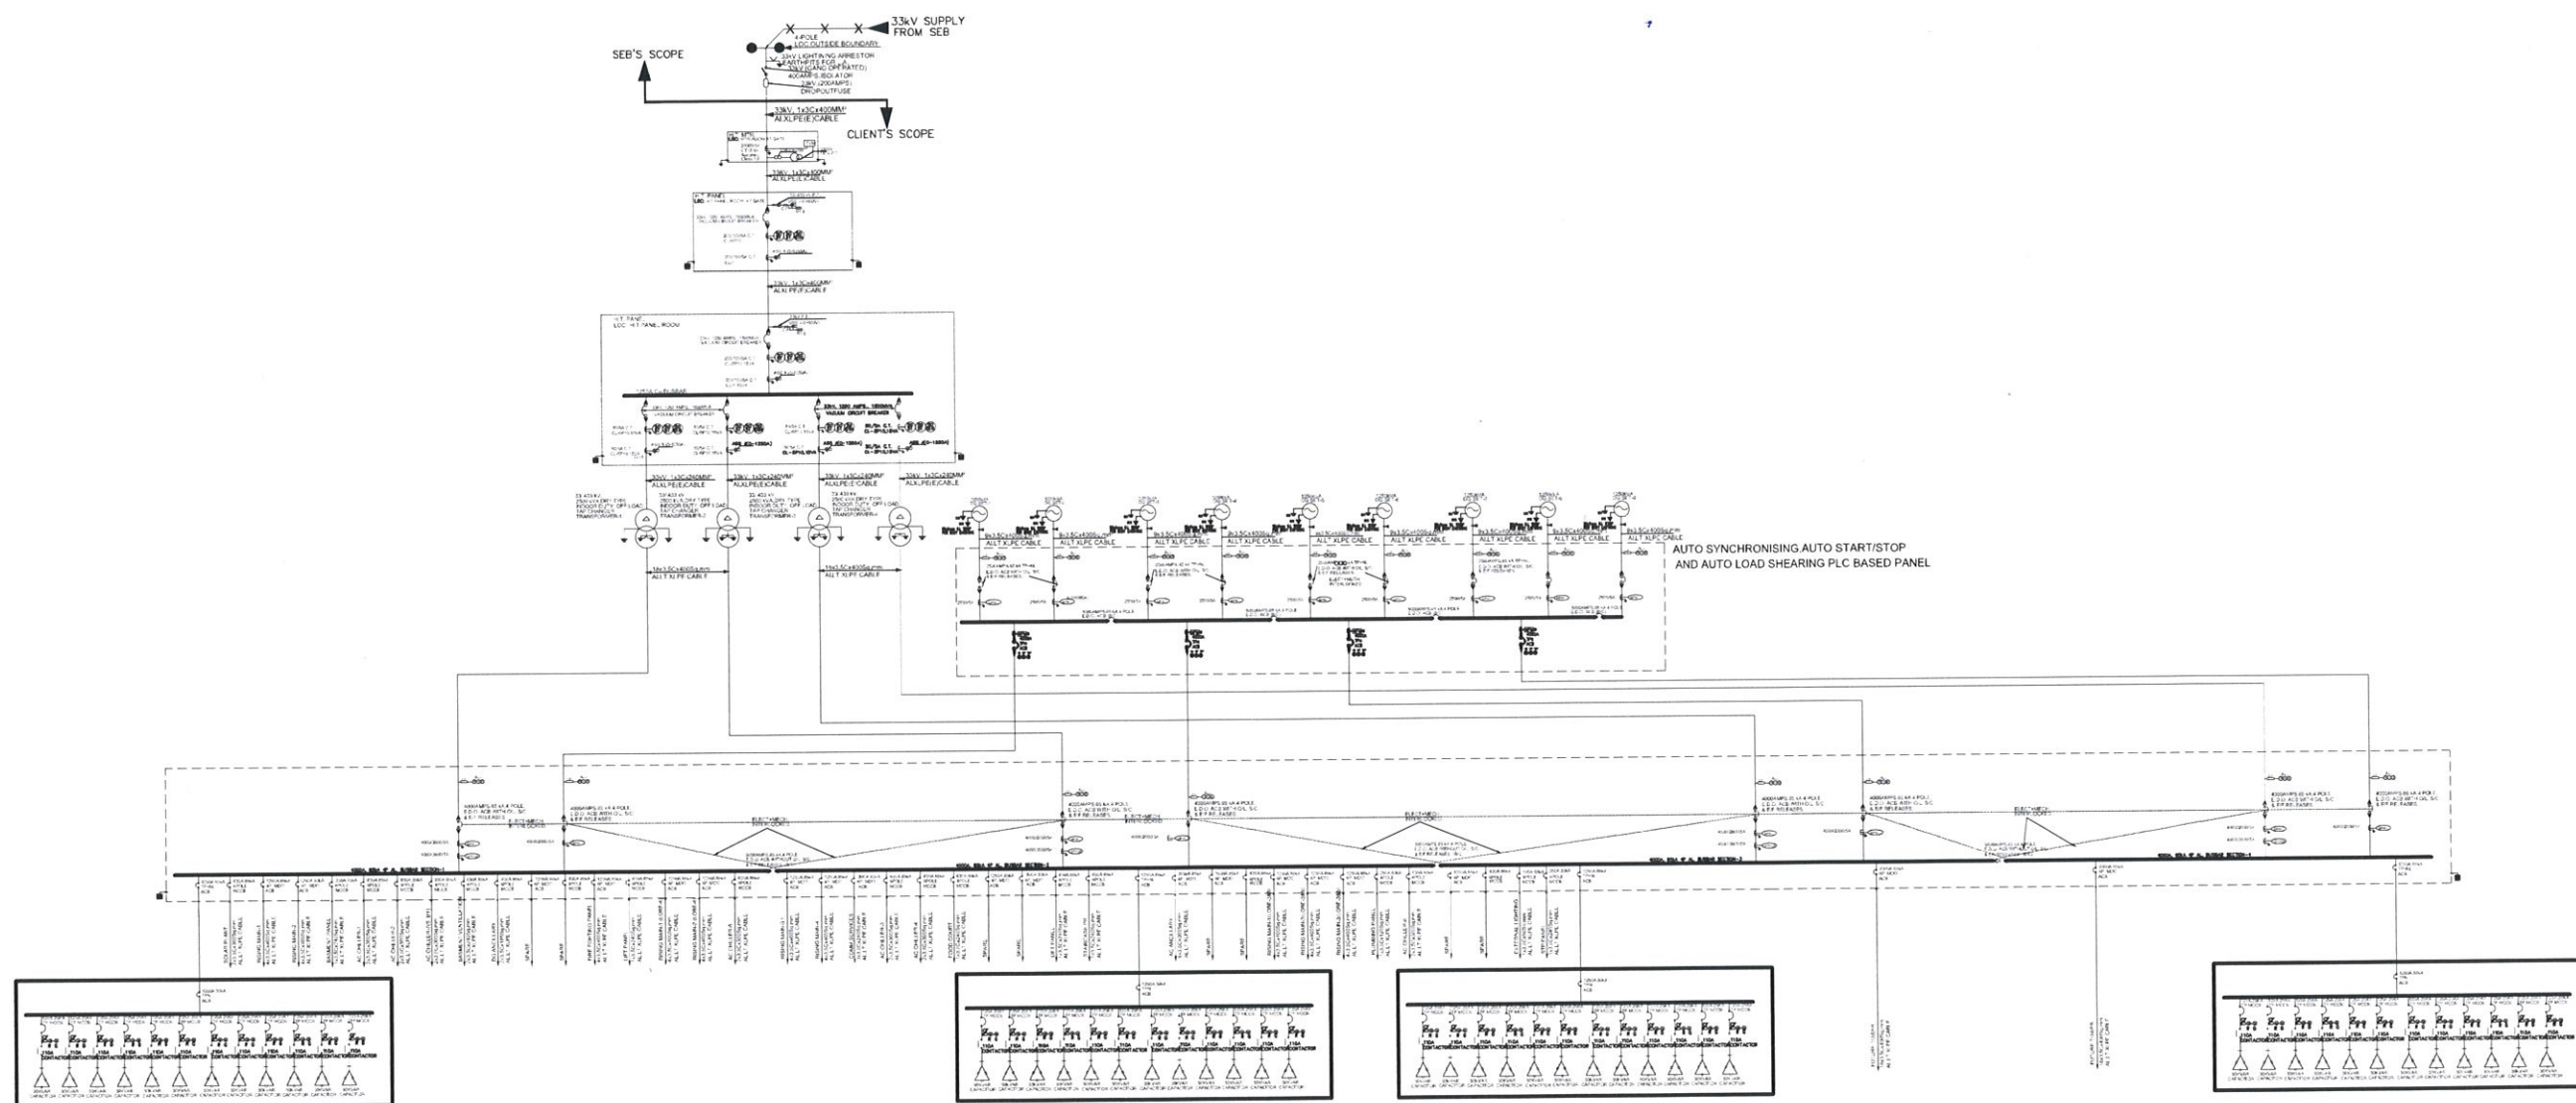

- NOTES**
1. THE GRID SUPPLY AND DG SUPPLY IS NOT TO BE PARALLELED.
 2. NEUTRAL OF EACH D.G. SET & TRANSFORMER WILL BE SEPARATELY EARTHED.
 3. ONLY COPPER EARTH PLATES WILL BE USED FOR NEUTRAL EARTHING, UNLESS NOT SPECIFY FOR OTHERS.
 4. G.I. EARTH PLATES WILL BE USED FOR BODY EARTHING OF TRANSFORMER, D.G. SETS OR PANELS ETC.
 5. ALL EARTHING SHALL BE DONE AS PER IS-3043, UNLESS SPECIFY FOR OTHERS.
 6. NONE OF THE NEUTRAL EARTH PITTS OF TWO DIFFERENT EQUIPMENTS SHALL BE JOINED TOGETHER.
 7. TOTAL NOS. OF EARTH PITTS
COPPER PLATE EARTH PITTS = 2 NOS.
G.I. (PLATE) EARTH PITTS = 3 NOS.
PIPE EARTH PITTS = 2 NOS.

LEGEND DESCRIPTION

V	VOLTMETER
A	AMMETER
Hz	FREQUENCY METER
KW	KILOWATT METER
KWH	KILOWATT HR. METER
PF	POWER FACTOR METER
KVAR	KVAR METER
AS	AMMETER SELECTOR SWITCH
VS	VOLTMETER SELECTOR SWITCH
MCCB	MCCB
CS	CHANGE OVER SWITCH
EDC	EDC MICROPROCESSOR AIR CIRCUIT BREAKER
LI	LIGHT INDICATOR
G.I. PLATE	G.I. PLATE EARTH PIT
COPPER PLATE	COPPER PLATE EARTH PIT
MULTI-FUNCTIONAL METER	MULTI-FUNCTIONAL METER (DIGITAL 144 SQ.MM.) SUITABLE FOR COMMUNICATION PORT

DATE NO ISSUED TO SIGN

PRINTS ISSUED

DATE SUBJECT REV.

PROJECT:
IT PARK, NOIDA
A-37/38, SECTOR 62, NOIDA

PROMOTERS:

ARCHITECT:

HOLISTIC CONSULTANCY CONSORTIUM
ARCHITECTURE, TOPI, PLANNING, PMS, INDUSTRIAL, DESIGN, EPC
SARITA, VIKHAR NEW 25, JH.

ELECTRICAL CONSULTANT:

DRG. TITLE:

MAIN SCHEMATIC DIAGRAM

JOB NO. DRAWING NO. EL-03/R0


DRG. STATUS: APPROVAL REVISION: R0

SCALE: DATE: 04.08.2021

ARCHITECT'S SIGNATURE: OWNER'S SIGNATURE:

NOTE:

For Anand Habitat Infrastructure Pvt. Ltd.
[Signature]
Authorised Signatory

[illegible]

PRINTS ISSUED	
---------------	--

DATE:	SUBJECT	REV.
-------	---------	------

PROMOTERS:



HOLISTIC
CONSULTANCY

MAIN SCHEMATIC DIAGRAM		
JOB NO:-	DRAWING NO:-	

DRG STATUS:-	REVISION:-	
APPROVAL	R0	

N.T.S.	04.08.2021		
--------	------------	--	--

	Date _____
--	------------

--	--