


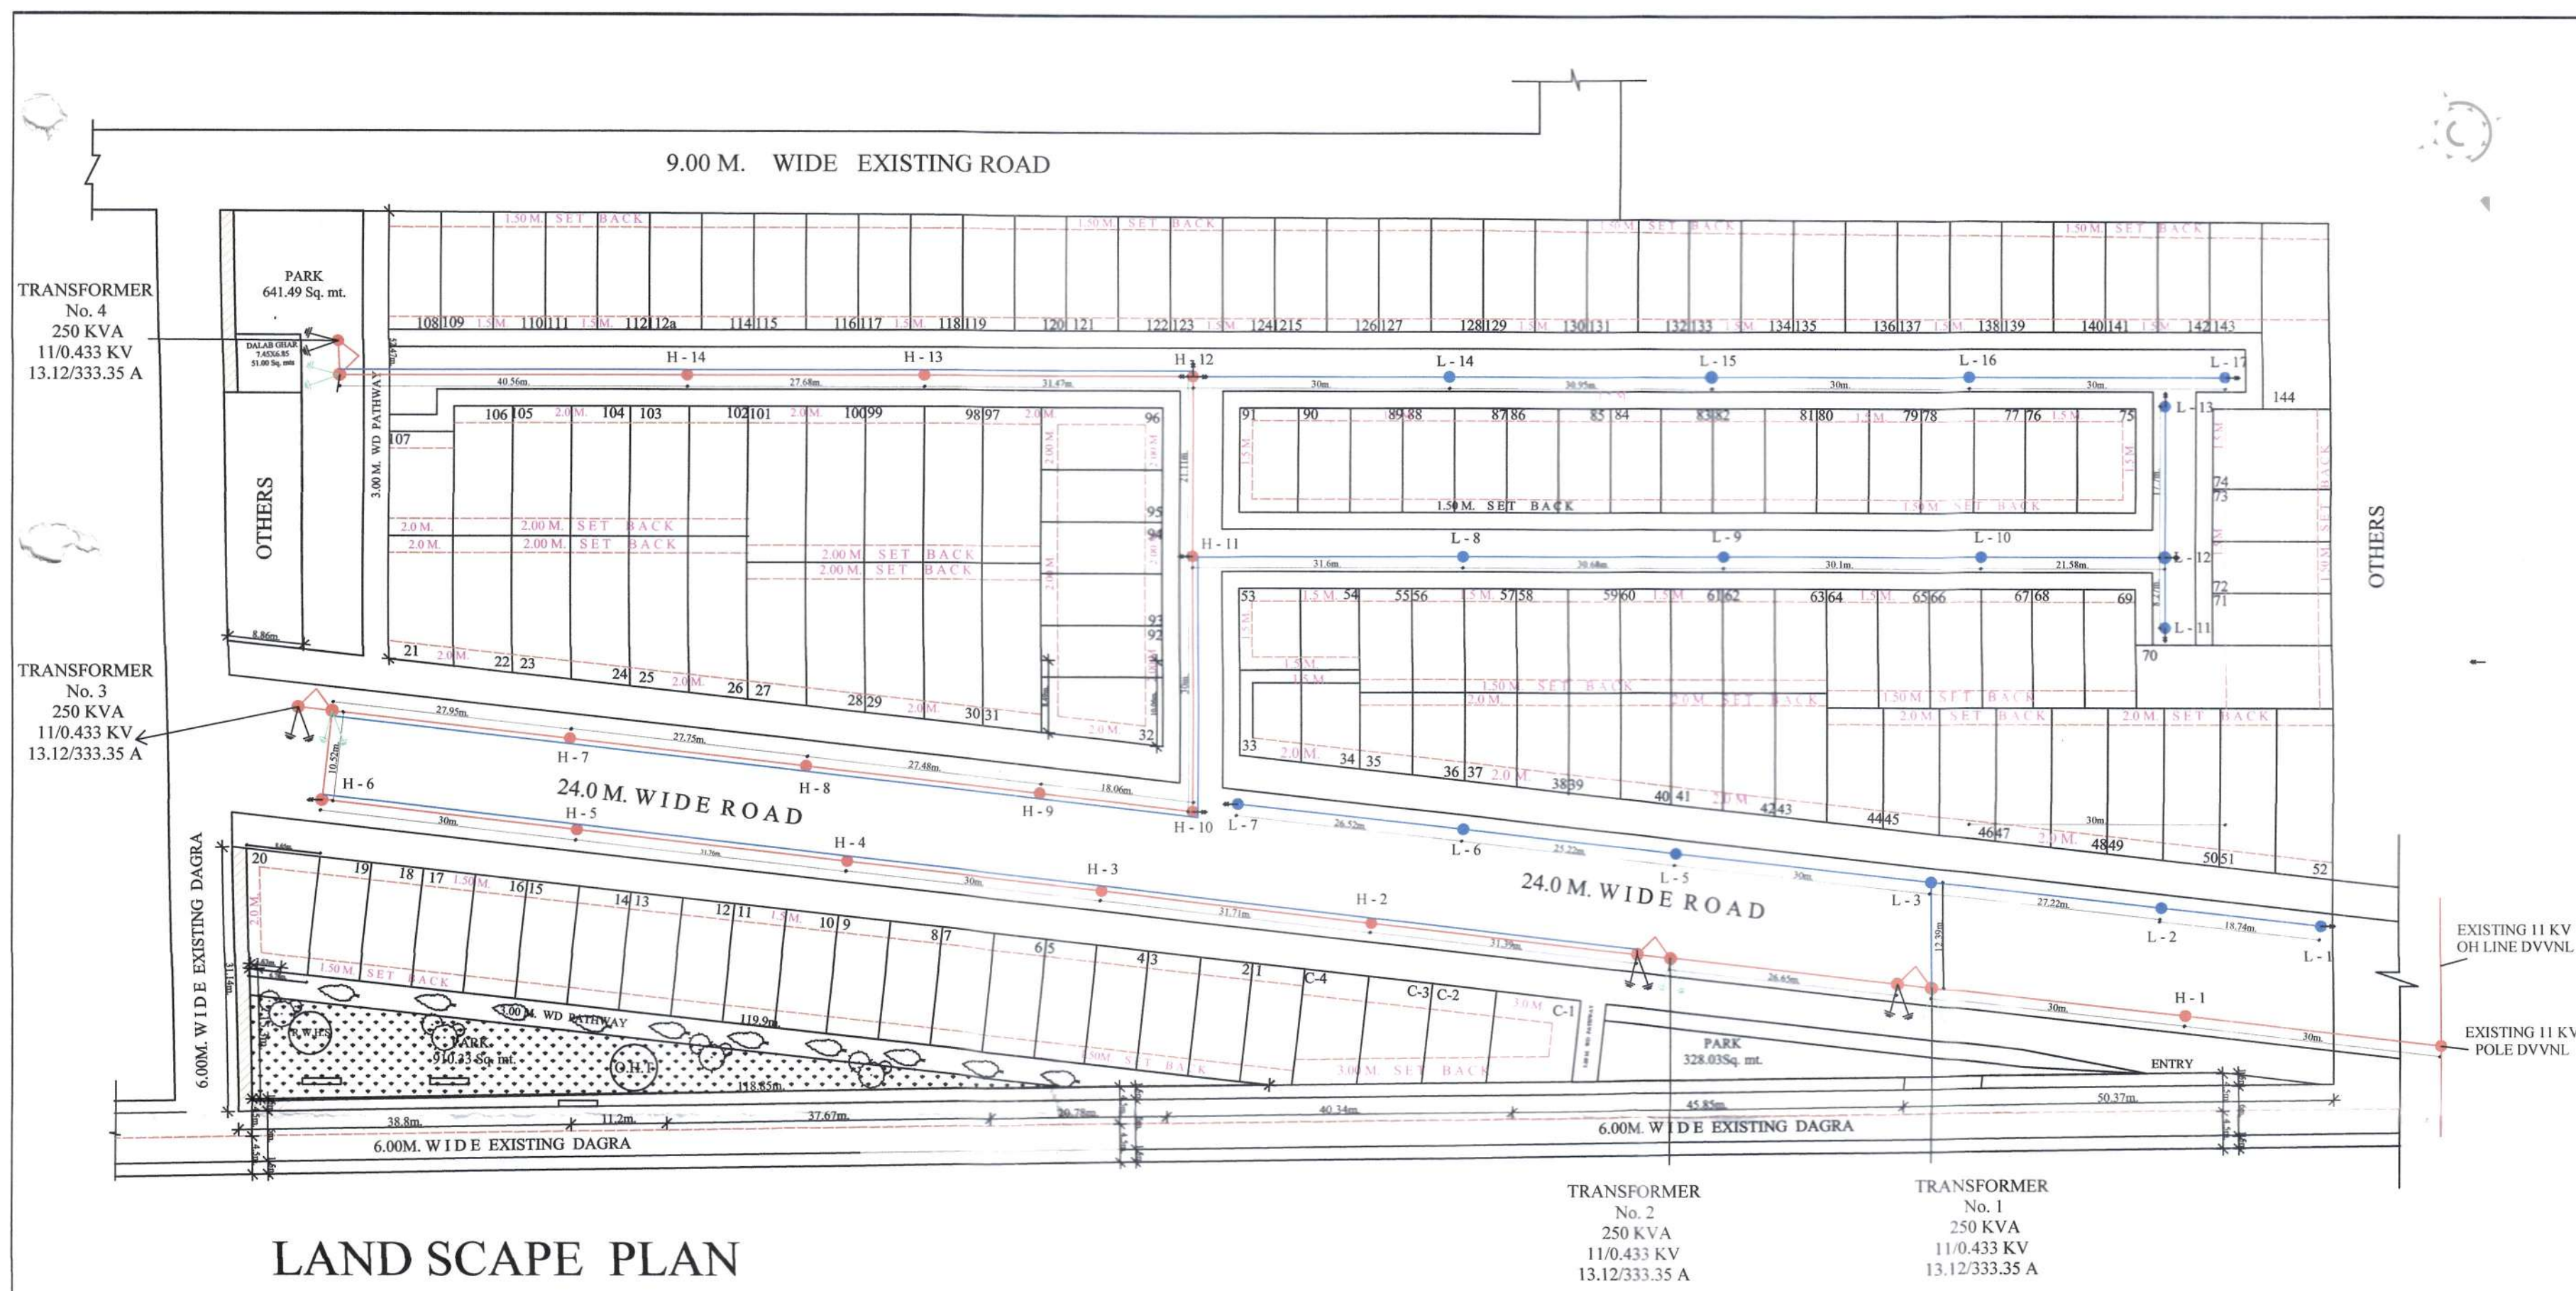

REFERENCE :-

ORNAMENTAL FLOWERING

- 11 KV OH LINE
- LT LINE
- 11 MT LONG POLE
- 9 MT LONG POLE
- BODY EARTH
- NEUTRAL EARTH
- TRANSFORMER
- STAY SET

NOTE

- 4 X 250 KVA TRANSFORMER 11/0.433 KV 13.12/333.35 A
- 11 KV TPMO DO FUSE SET.
- LT MCCB 4 POLE 400 Amp FOR 250 KVA T/F.
- HT/LT CABLES SHALL BE LAID AS PER I.E.R. 1956.
- DISTANCE BETWEEN THE EARTH PITS IS 2000 MM.
- EARTH STRIP SIZE IS 50 X 6.30 MM GI.
- EARTH PIPE SIZE ID 40 MM, 2.9 MM THICK, 3000 MM LONG GI.
- EARTH PLATE SIZE 900 X 900 X 6.35 MM.
- 11 KV RABBIT CONDUCTOR.
- 400 Sq MM 3.5/C LT PVC CABLE ON EACH PHASE & NEUTRAL.
- SUPPLIERS METER & EQUIPMENTS SHALL BE INSTALLED AS PER PROVISIONS MADE IN ELECTRICITY SUPPLY CODE 2005 & AS PER PROVISIONS OF 64 (1)(B) OF INDIAN ELECTRICITY RULES 1956
- 2750 MM CLEARANCE SHALL BE MAINTAINED FOR BARE CONDUCTOR OR LIVE PARTS.
- T/F AND SUB-STATION SHALL NOT BE INSTALLED OUTSIDE THE OWNER PREMISES.
- CONTROLS OF REQUISITE CAPACITY TO CARRY AND BREAK THE CURRENT SHALL BE INSTALLED AS NEAR AS POSSIBLE.
- THE METERING SHALL BE DONE ON LT SIDE BY DVVNL TO INDIVIDUAL CONSUMERS.

REVISED LAND SCAPE PLAN OF " MAYUR VIHAR " ON KHASRA NO. 67A(Part),67B(Part) SITUATED AT MAUZA CHAMRAULI ,DISTT. & TEHSIL AGRA.



LAYOUT FOR PROPOSED 4 X 250 KVA TRANSFORMER 11/0.433 KV POLE TYPE S/S FOR MAYUR VIHAR AT KHASRA No. 67 A (PART), 67 B (PART) MAUZA CHAMRAULI AGRA

DRAWING NOT TO SCALE.
ALL DIMENSIONS ARE IN MM.