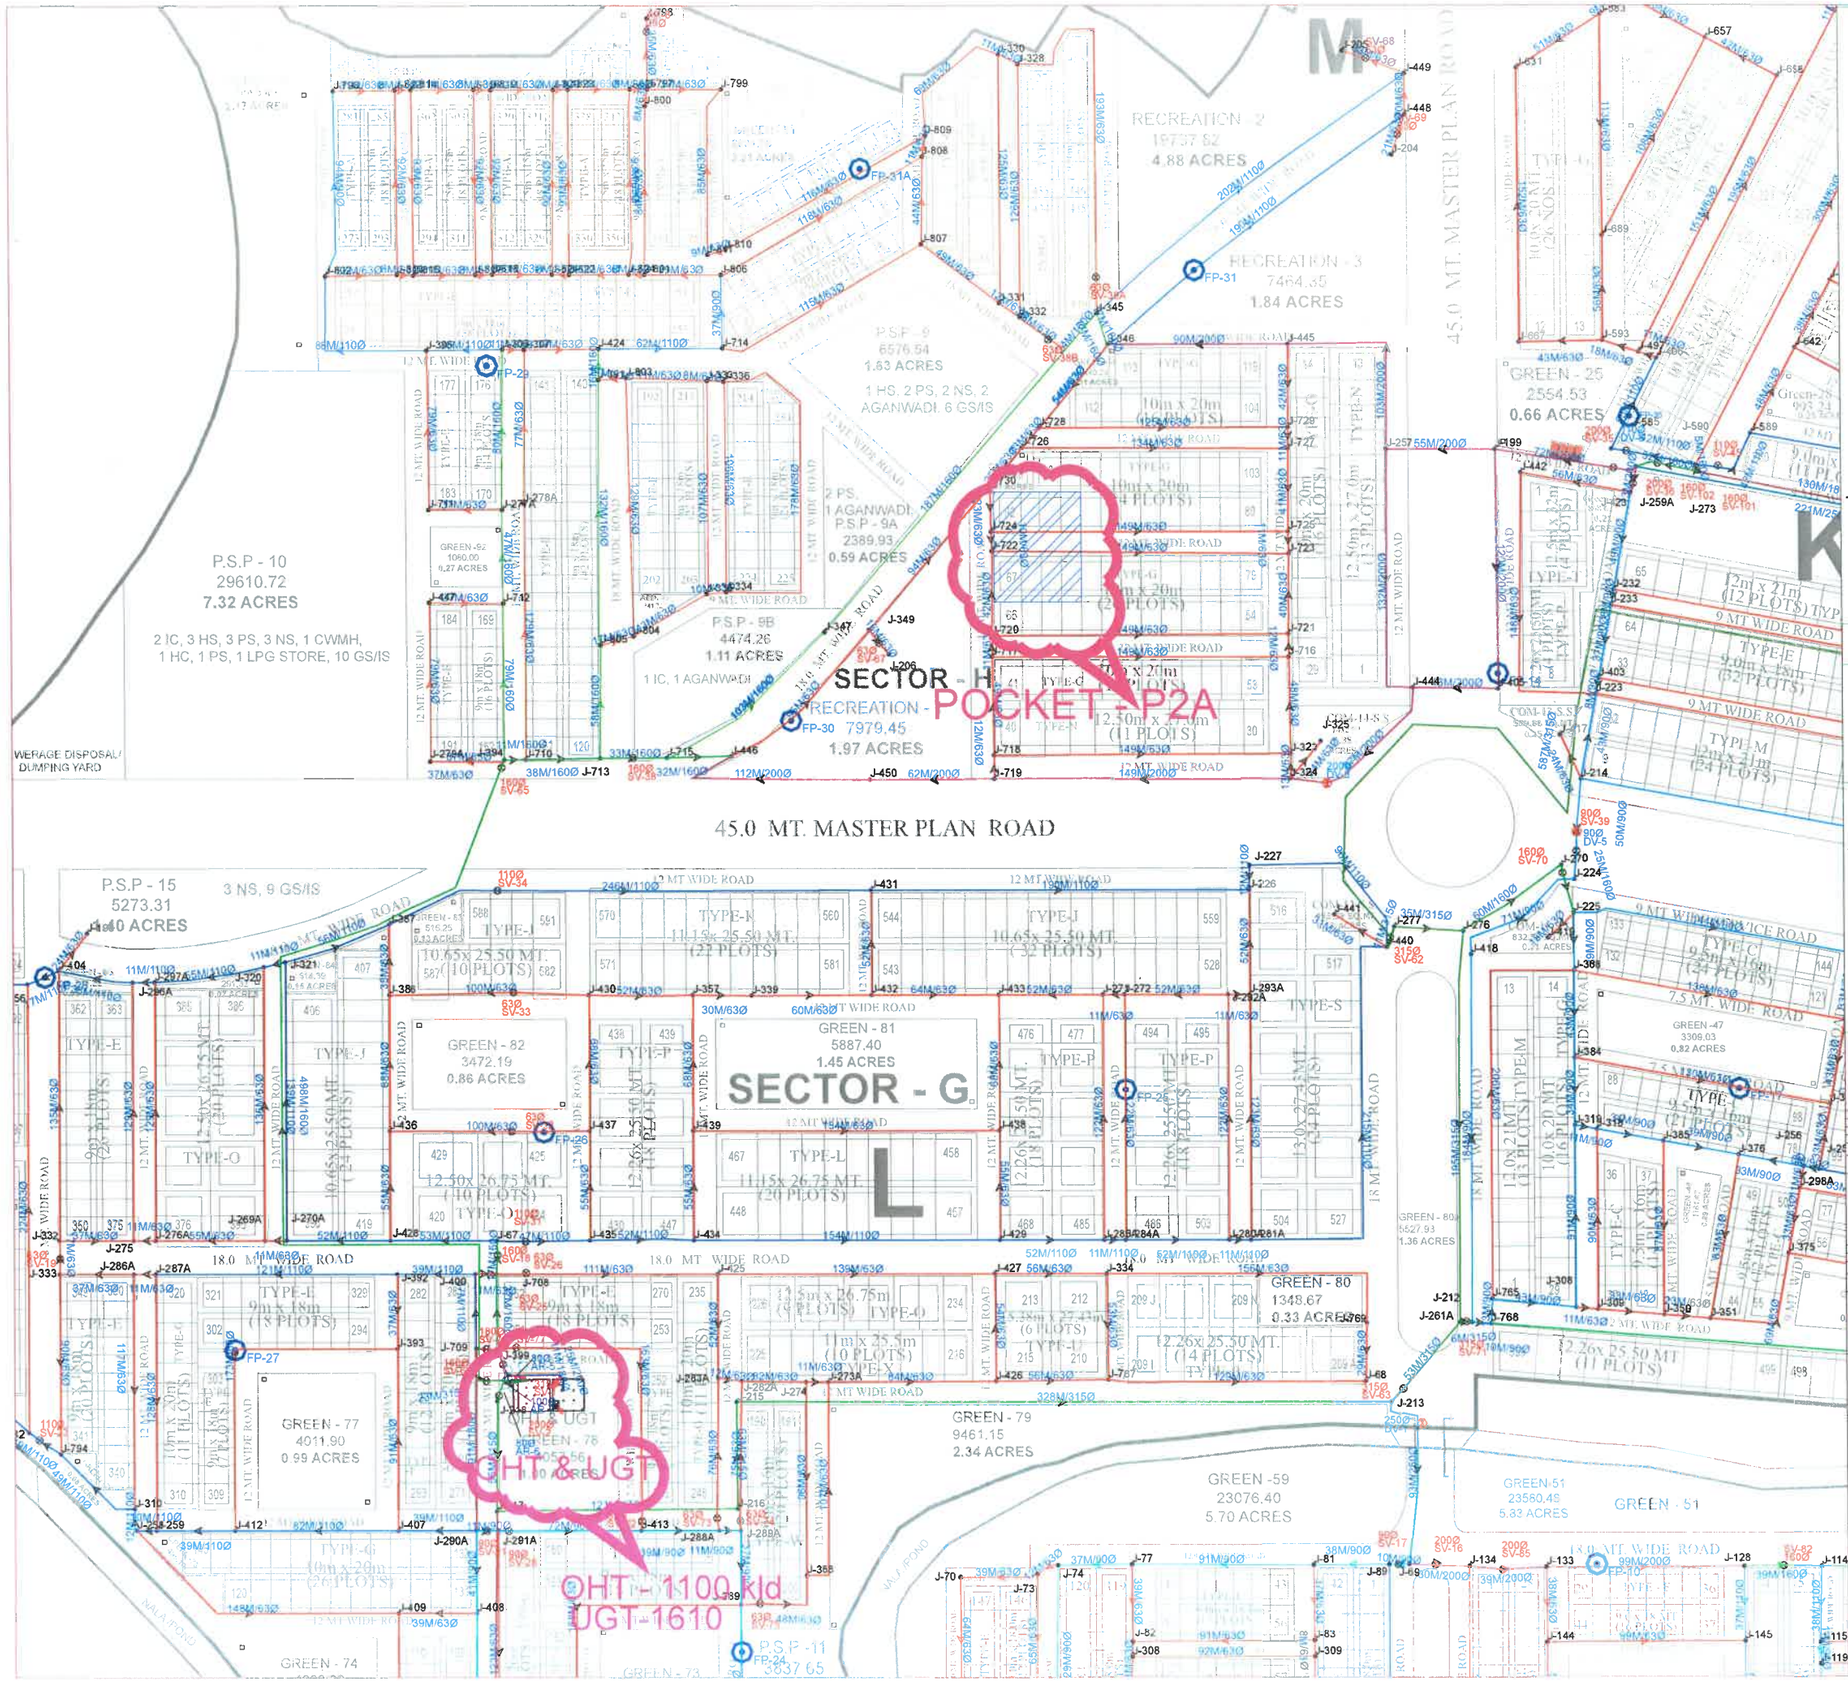

LEGEND

Junction Number J-92
Length/Diameter of pipe 100
Overhead Tank
Sluice valve
Fire Hydrant FP-2
Air Valve
Drain Valve
315Ø MDPE pipe
250Ø MDPE pipe
200Ø MDPE pipe
180Ø MDPE pipe
160Ø MDPE pipe
110Ø MDPE pipe
90Ø MDPE pipe
63Ø MDPE pipe

- 1.The site can use HDPE and the pressure rating of the pipes should be 6 Kg/CM^2
2.In crossing of Internal roads NP2/NP3 pipe will be laid as sleeve
3.In crossing of Master Plan road Ductile Iron pipe will be used in place of HDPE

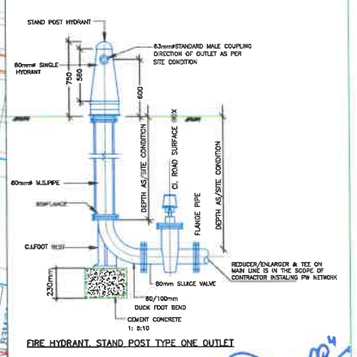

FIRE HYDRANT STAND POST TYPE ONE OUTLET

APURBA BORAH
Regd. Architect
CA/2013/61618

NO	DATE OF ISSUE	MODE OF ISSUE
	07.05.24	
	19.12.22	
	26.10.22	
	16.7.19	
	20.9.018	

NO	DATE	REVISIONS(DRAWING NO)	BY	HKD	APP	PROJ ENGG
	07.05.24	Layout Change	DA	JK	JK	JK
	26.10.22	Layout Change	DA	JK	JK	JK
	16.7.19	Layout Change	DA	JK	JK	JK

CLIENT
OMAXE
Omaxe Ltd
7, LSC, Kalkaji,
New Delhi – 110019 (India)
Telephone:+91-11- 41893106

OMAXE HI-TECH CITY
LUCKNOW

CONSULTANT
DESIGN COLLABORATIVE CONSULTING

TOWN LUCKNOW

TITLE POCKET-P2A OF WATER SUPPLY NETWORK

DRAWING NO. DCC/P/OM/LUK/2016/D-17/17 2
REV

PREPARED	CHECKED	DESIGNED	DRAWN
JK	JK	DA	ASR

SCALE NTS
DATE 06.02.2026
STATUS