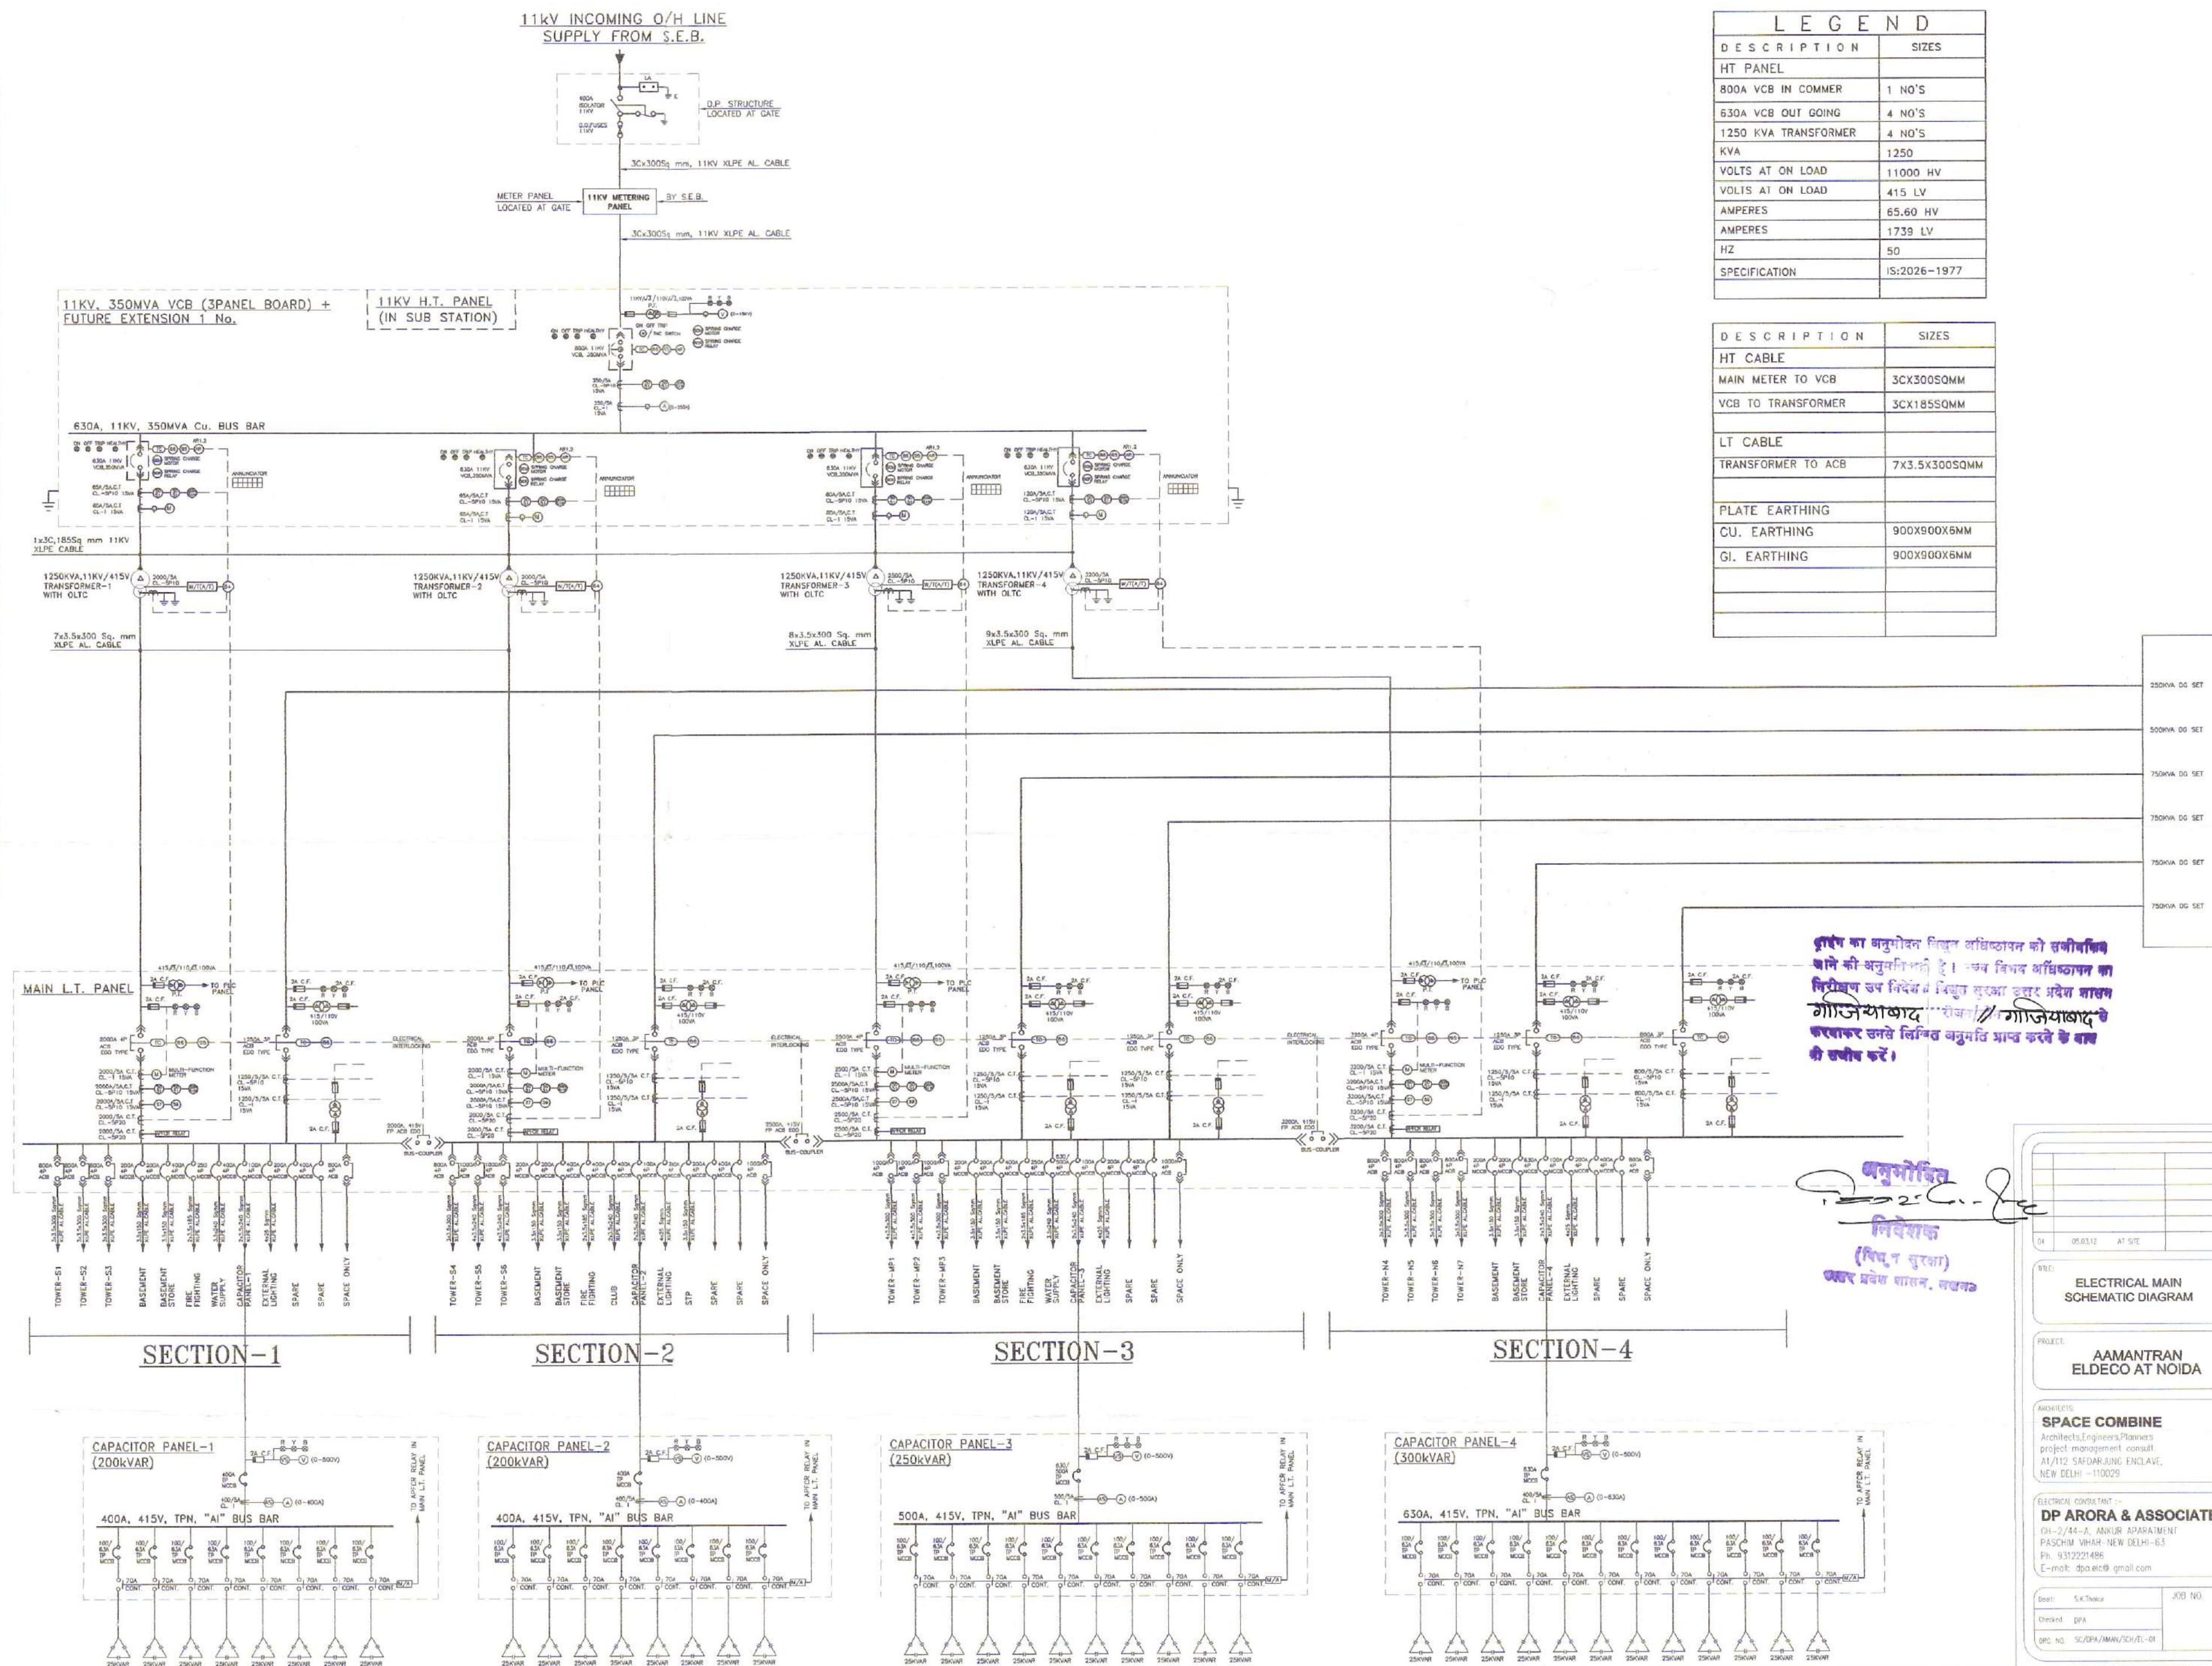


[illegible]

L E G E N D	
DESCRIPTION	SIZES
HT PANEL	
800A VCB IN COMMER	1 NO'S
630A VCB OUT GOING	4 NO'S
1250 KVA TRANSFORMER	4 NO'S
KVA	1250
VOLTS AT ON LOAD	11000 HV
VOLTS AT ON LOAD	415 LV
AMPERES	65.60 HV
AMPERES	1739 LV
HZ	50
SPECIFICATION	IS:2026-1977

DESCRIPTION	SIZES
HT CABLE	
MAIN METER TO VCB	3CX300SQMM
VCB TO TRANSFORMER	3CX185SQMM
LT CABLE	
TRANSFORMER TO ACB	7X3.5X300SQ
PLATE EARTHING	
CU. EARTHING	900X900X6MM
GI. EARTHING	900X900X6MM

प्राईम का अनुमोदन विद्युत अधिकायन को सजीवित
 करने की अनुमति मिली है। जब विद्युत अधिकायन का
 निरीक्षण उप विदेशी विद्युत सुरक्षा क़रार प्रदेश मास
गोजियाबाद ... गोजियाबाद के
 करवाकर सने लिखित अनुमति प्राप्त करने के बाद
 की सजीव करें।

अनुभवि
निदेशक
(विद्युत सुरक्षा)
अवर प्रवेश शासन, लखनऊ

DH	05.03.12	AT SITE			

TITLE:

ELECTRICAL MAIN SCHEMATIC DIAGRAM

PROJECT:

AAMANTRAN ELDECO AT NOIDA

ARCHITECTS:

SPACE COMBINE

Architects, Engineers, Planners
project management consult.
A/112 SAFADARJUNG ENCLAVE,
NEW DELHI - 110029

ELECTRICAL CONSULTANT :-

DP ARORA & ASSOCIATE

Gh-2/44-A ANKUR APARTMENT
PASCHIM VIHAR NEW DELHI-63
Ph. 9312221486
E-mail: dpa.ec@ gmail.com

Boat: S.K.Talwar	JOD NO.
Checked: DPA	
DRG. NO. SC/DPA/VIHAR/SCH/ELI-01	

For Eldec Infrastructure & Properties Limited
Rajnish
 Authorised Signatory