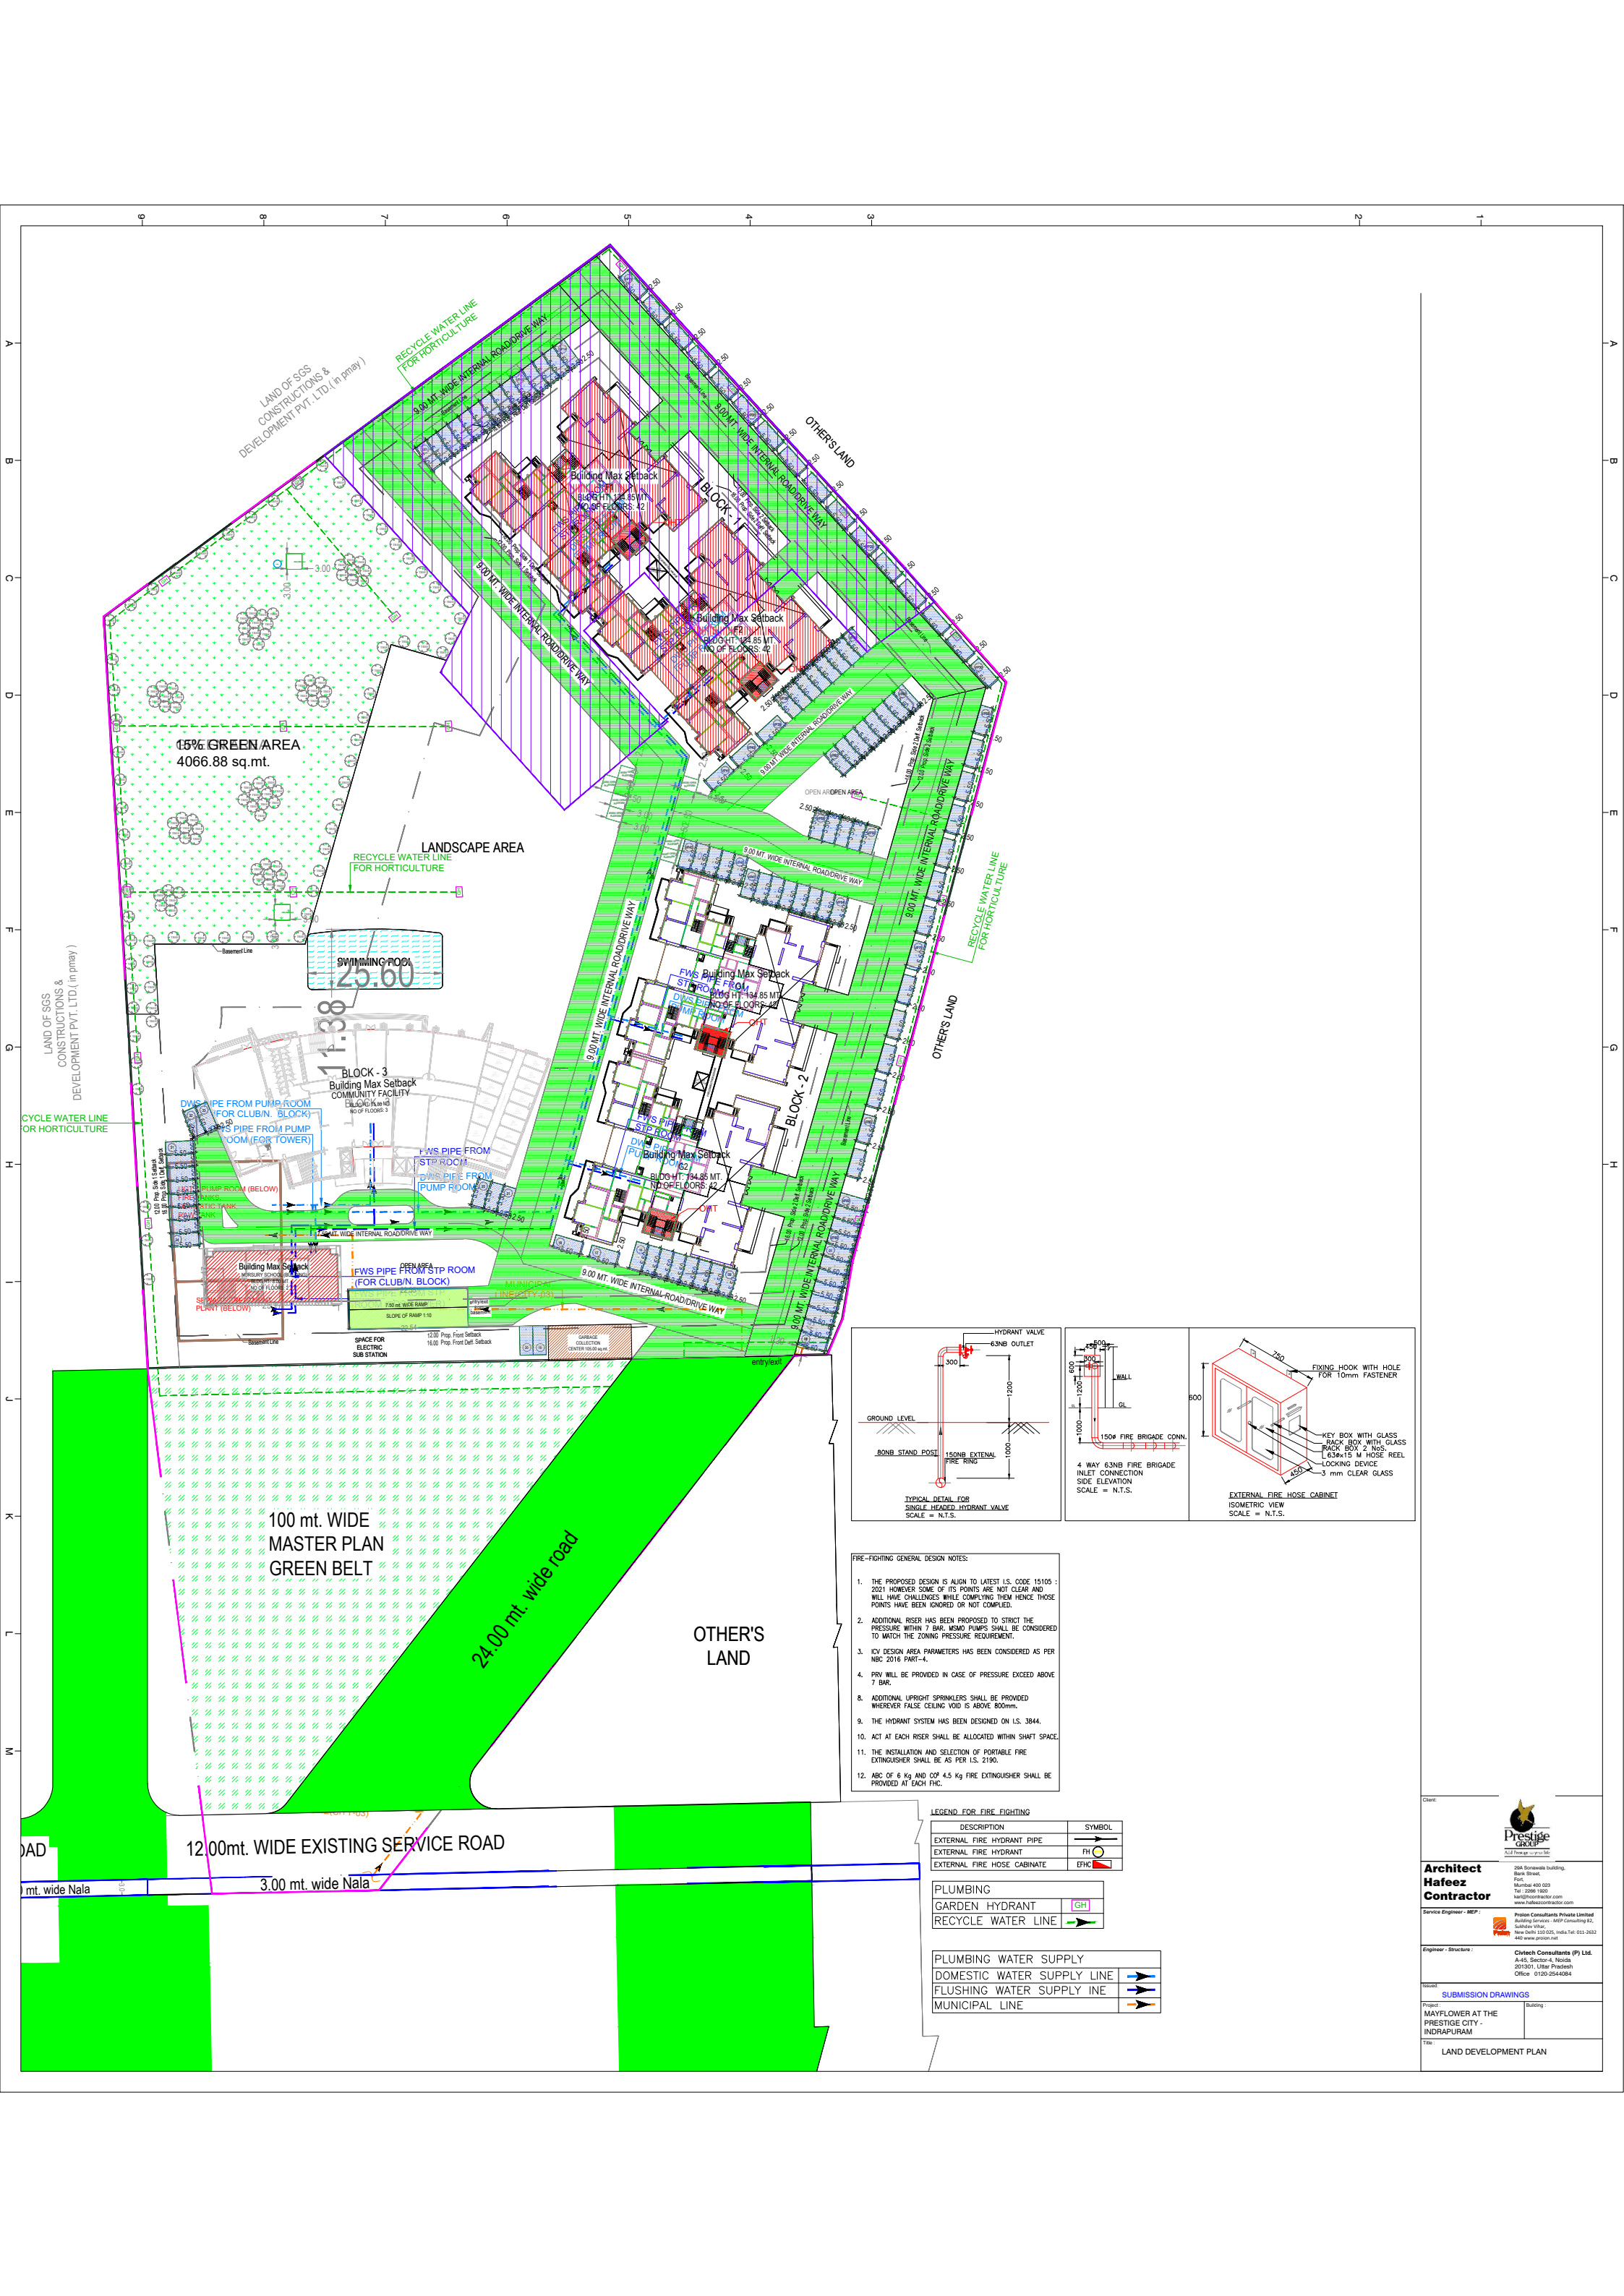


- FIRE-FIGHTING GENERAL DESIGN NOTES:
- THE PROPOSED DESIGN IS ALIGN TO LATEST I.S. CODE 15105 : 2021 HOWEVER SOME OF ITS POINTS ARE NOT CLEAR AND WILL HAVE CHALLENGES WHILE COMPLYING THEM HENCE THOSE POINTS HAVE BEEN IGNORED OR NOT COMPLIED.
 - ADDITIONAL RISER HAS BEEN PROPOSED TO STRICT THE PRESSURE WITHIN 7 BAR. MIMO PUMPS SHALL BE CONSIDERED TO MATCH THE ZONING PRESSURE REQUIREMENT.
 - ICV DESIGN AREA PARAMETERS HAS BEEN CONSIDERED AS PER NBC 2016 PART-4.
 - PRV WILL BE PROVIDED IN CASE OF PRESSURE EXCEED ABOVE 7 BAR.
 - ADDITIONAL UPRIGHT SPRINKLERS SHALL BE PROVIDED WHEREVER FALSE CEILING VOID IS ABOVE 800mm.
 - THE HYDRANT SYSTEM HAS BEEN DESIGNED ON I.S. 3844.
 - ACT AT EACH RISER SHALL BE ALLOCATED WITHIN SHAFT SPACE.
 - THE INSTALLATION AND SELECTION OF PORTABLE FIRE EXTINGUISHER SHALL BE AS PER I.S. 2190.
 - ABC OF 6 Kg AND COF 4.5 Kg FIRE EXTINGUISHER SHALL BE PROVIDED AT EACH FHC.

LEGEND FOR FIRE FIGHTING

DESCRIPTION	SYMBOL
EXTERNAL FIRE HYDRANT PIPE	
EXTERNAL FIRE HYDRANT	
EXTERNAL FIRE HOSE CABINATE	

PLUMBING

GARDEN HYDRANT	
RECYCLE WATER LINE	

PLUMBING WATER SUPPLY	
DOMESTIC WATER SUPPLY LINE	
FLUSHING WATER SUPPLY INE	
MUNICIPAL LINE	

Client

Architect
Hafeez Contractor

Service Engineer - MEP

Engineer - Structure

20A, Bonawade Building,
Bank Street,
Mumbai-400 029
Tel : 2268 1800
www.hafeezcontractor.com

Project Consultants Private Limited
Building Services - MEP Consulting B2,
Sunder Circle,
New Delhi-110 025, India Tel: 011-2652
460 www.prestige.com

Civitech Consultants (P) Ltd.
A-45, Sector-4, Noida
201301, Uttar Pradesh
Office : 0120-3044004

Project
MAYFLOWER AT THE
PRESTIGE CITY -
INDRAPURAM

Building

Submission Drawings

LAND DEVELOPMENT PLAN