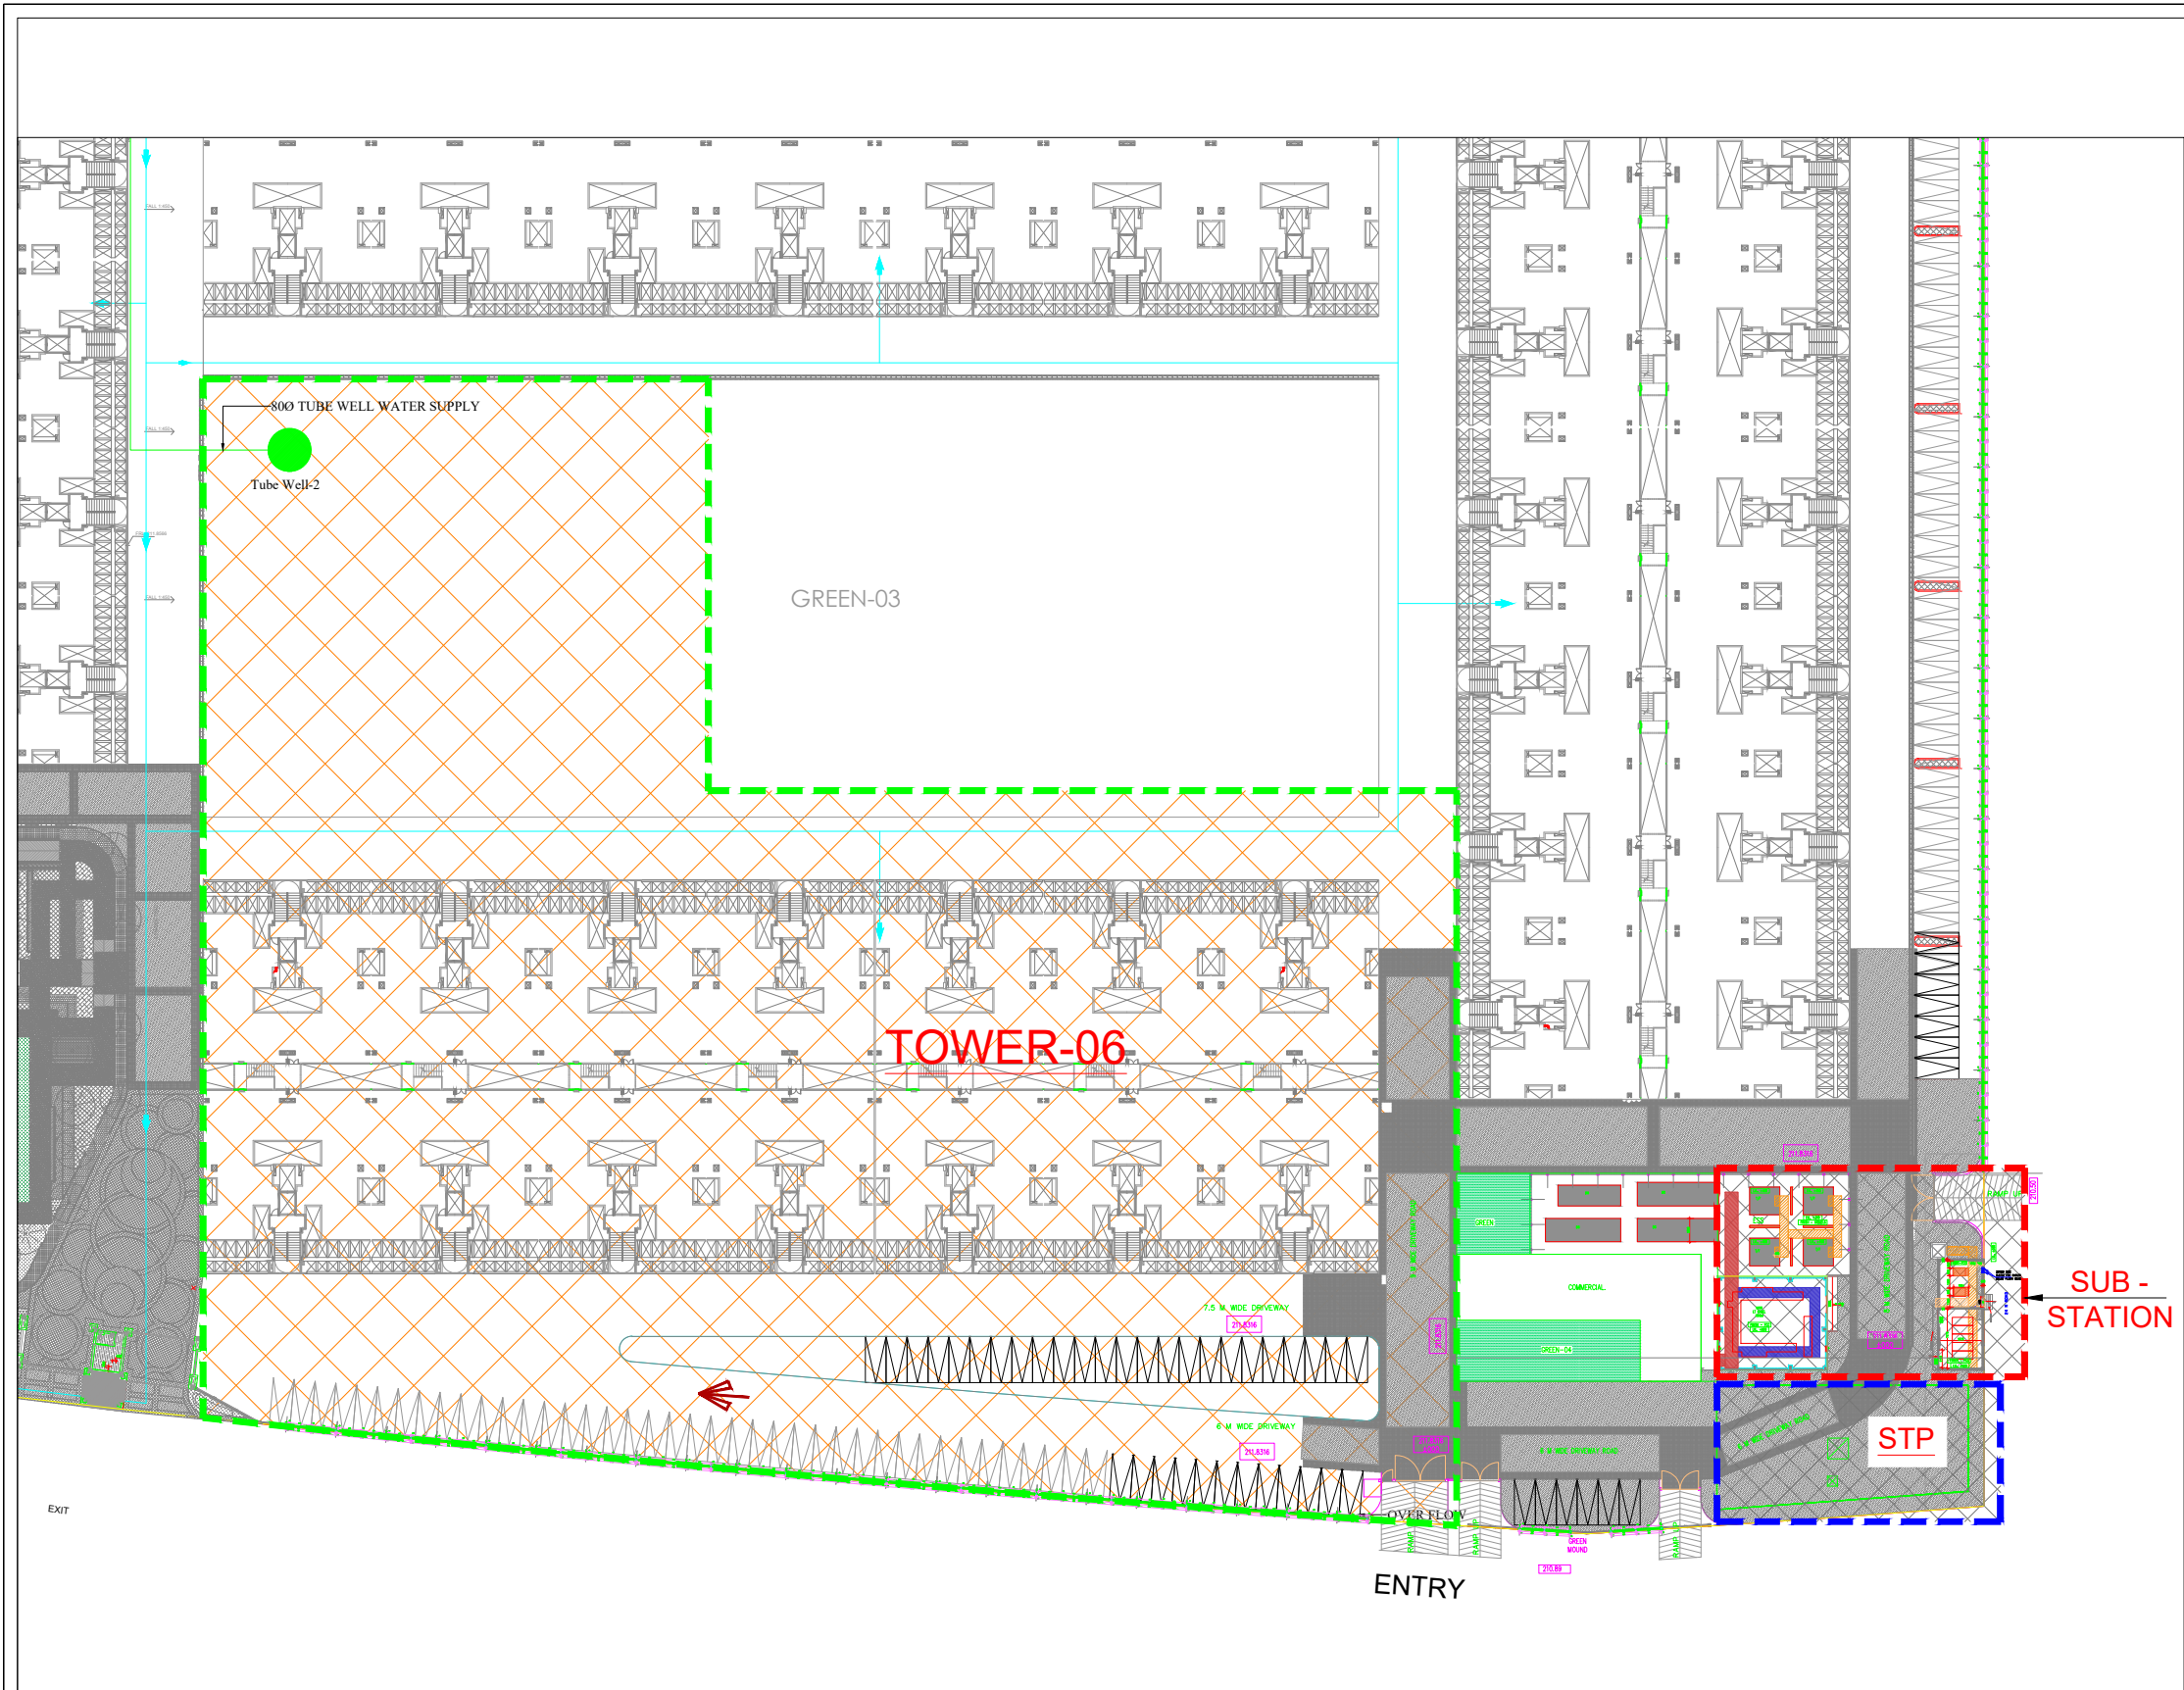


- KEY PLAN
- NOTES & Code Reference
- 1-ALL DIMENSION ARE IN MM UNLESS OTHERWISE SPECIFIED.
 - 2-MINOR MODIFICATIONS CAN BE DONE IN PIPE ROUTING TO SUIT SITE CONDITION
 - 3-ALL THE INSTALLATIONS SHALL BE DONE AS PER APPROVED & RECOMMENDED COMMENTS
 - 4-MATERIAL SPECIFICATION OF PIPES AND FITTINGS AS PER APPROVED DATA SHEET
 - 5-ALL SEWER AND DRAIN LINE SHALL BE LAID ON PCC BED.
 - 6-ALL BURIED PPES SHALL BE TESTED FOR LEAKAGES AND STRAIGHTNESS AS PER SPECIFICATION.
 - 7-TRENCH SHALL BE REFILLED ONLY AFTER PIPE TESTING.
 - 8-ALL DRAIN LINE SHALL BE LAID IN S & S RCC (NP2) PIPE CONFORMING TO IS : 458.
 - 9-ALL EXTERNAL SEWER LINE (MANHOLE TO MANHOLE CONNECTION) SHALL BE LAID IN Class-5N-4 DVC PIPE (PIPES AND FITTINGS AS PER IS : 16538)

REV.NO.	DATE	DESCRIPTION
---------	------	-------------

CLIENT:
WAVE INFRATECH PVT. LTD.

PROJECT:
VERIDIA AT OAKWOOD ENCLAVE
WAVE CITY

Architect :
Wave Infratech Pvt. Ltd.
C-1, Sector-3
Noida, U.P. 201301
TEL: +91 120 4180500

Structure Consultant
Consulting Structural Engineers
G-70, 2nd FLOOR, JASWANT PLAZA,
NEAR KALINDI KUNJ, OKHLA,
NEW DELHI-110025
PHONE NO.: +91-11-26940734/5/6/7/8
FAX: 26940738
E-Mail : nnc_consultants@hotmail.com
Web : www.nncdesigninternational.com

MEP CONSULTANT
PKV Consulting Engineers (P) Ltd.
C-815, DDA Flats, Loni Road, Delhi -110093
TELEFAX - 011-22816297
E-mail:- pramod@pkv.co.in
info@pkv.co.in

DRAWING TITLE:-
VERIDIA TOWER-6
DUAL PLUMBING ROUTE
EXTERNAL PLUMBING LAYOUT

STATUS	FOR APPROVAL	NORTH	REV NO.
DATE :	03-08-2022		R0
DEALT BY :	DK		
CHKD BY :	PKS		DRAWING NO.
SCALE :	1:325 @ A-0		SSA-PL-EXT-03a

S.NO.	DESCRIPTION	SYMBOL
6.	TUBE WELL SUPPLY PIPE LINE	
14.	MUNICIPAL WATER SUPPLY LINE	
10.	VALVE CHAMBER	
12.	WATER METER	

EXTERNAL SERVICES PIPE NOTE :-	
1.	PN-8 MDPE PIPE FOR DOMESTIC WATER SUPPLY LINES.
3.	PN-8 MDPE PIPE FOR TUBE WELL WATER SUPPLY LINES.
4.	PN-8 MDPE PIPE FOR MUNICIPAL WATER SUPPLY LINES.