



...
rev. no.	date	revision

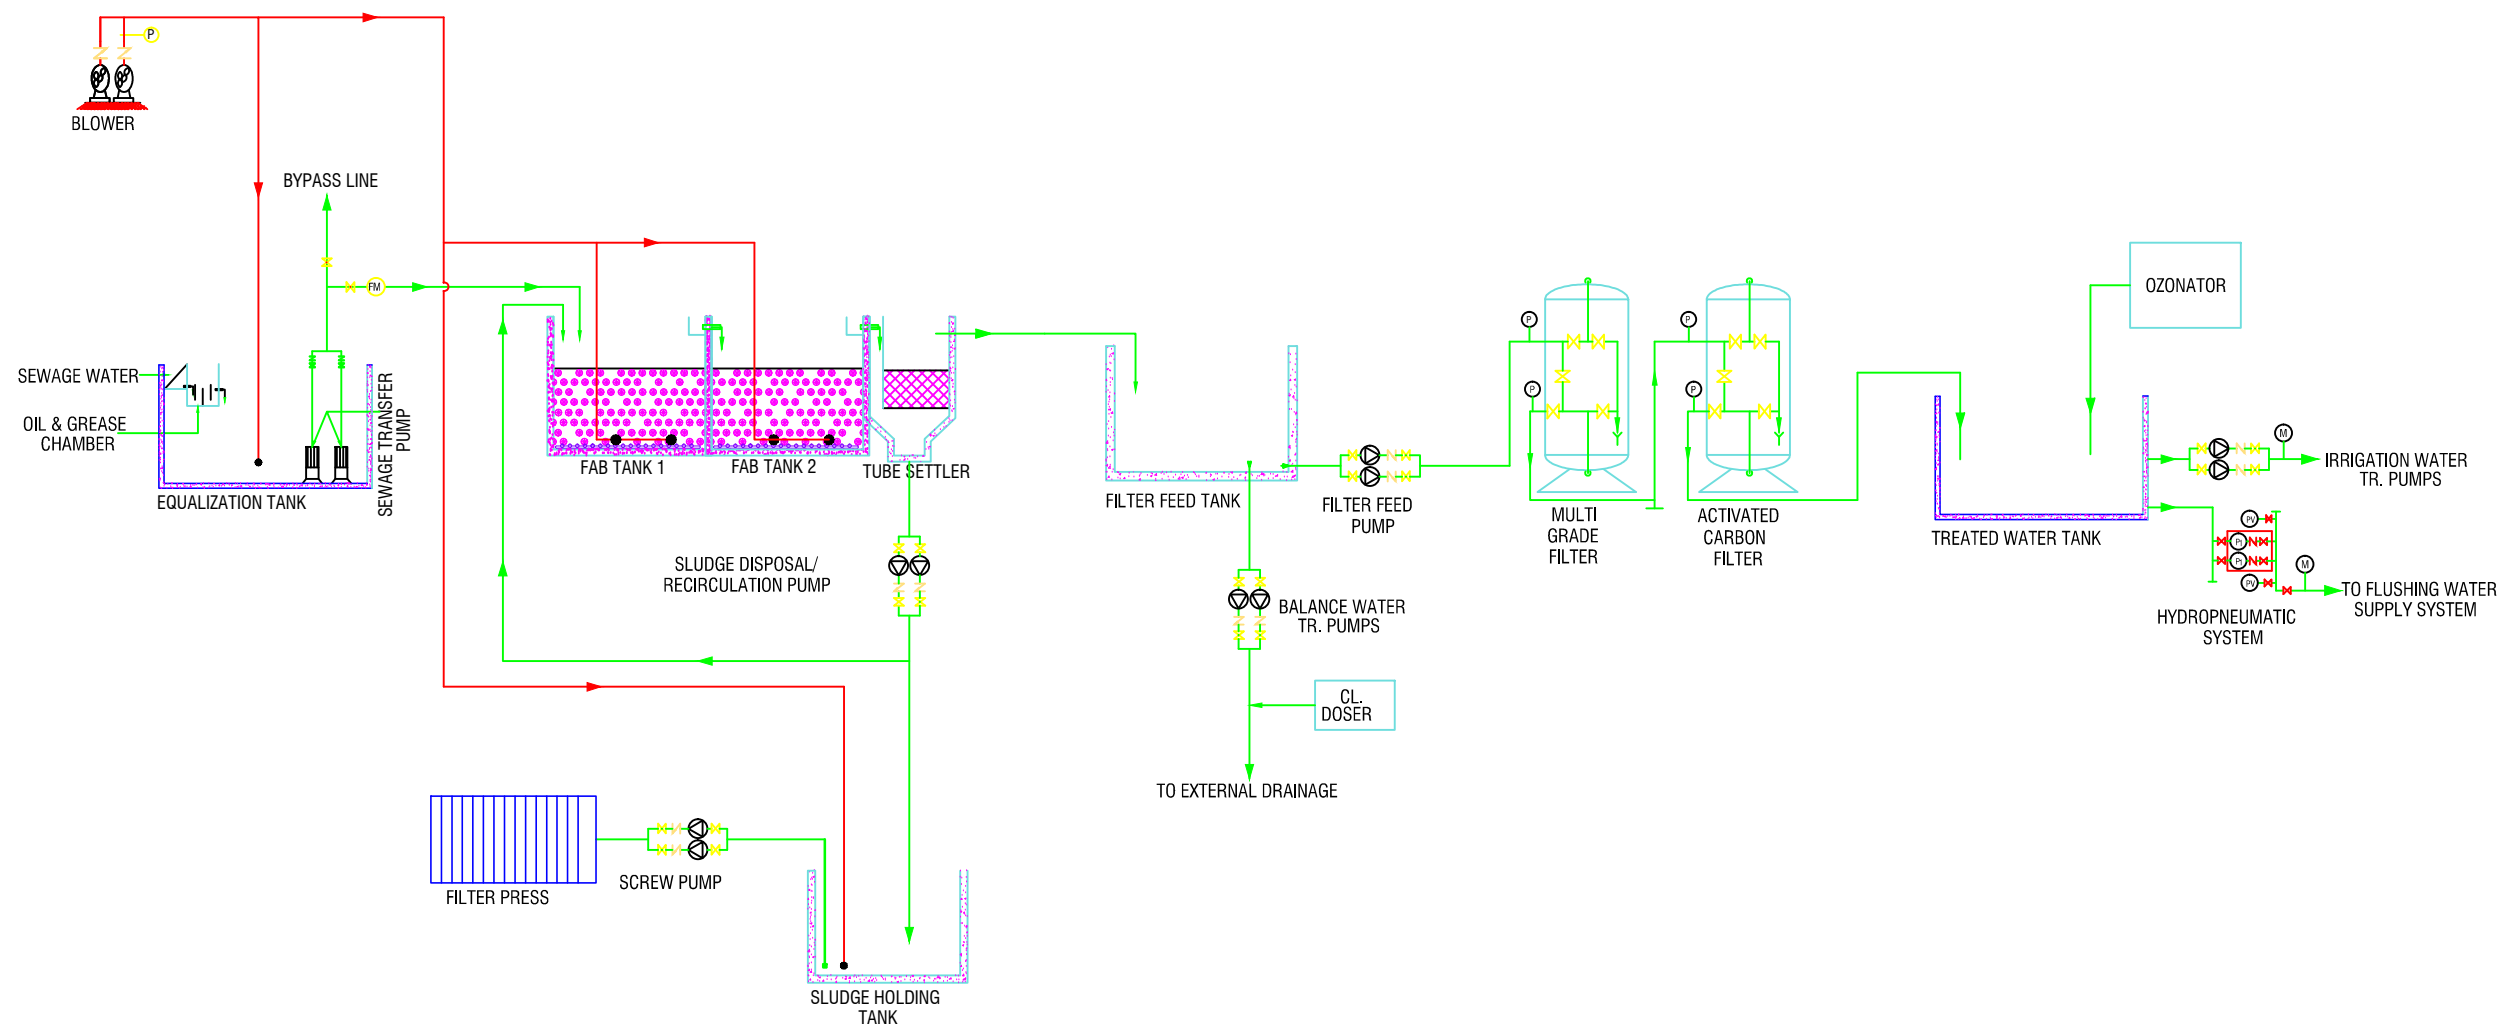

SEWAGE TREATMENT PLANT CAPACITY = 110 KLD

LEGEND :

- VALVE
- NON RETURN VALVE
- DIFFUSER
- PRESSURE GAUGE
- WATER METER
- FLOW METER

project Proposed Residential Building at plot No. SC-01/C-A8 Sector- 150 Noida U.P.	drg. no. STP-01	released for SUBMISSION	OWNER :- M/S - ABLT BUILDCON PVT. LTD.	services consultant Consummate Engineering Services (P) Ltd.  Noida Office : B - 67, Sector - 67, Noida - 201 301, Tel : (0120) 6943500 (23 Lines) Lko. Office : R 006, Rohtas Plumeria, Gomti Nagar, Lucknow, Tel : (0522) 6515455 e mail : mail@cespl.in, website : www.cespl.in
title SCHEMATIC FLOW DIAGRAM SEWAGE TREATMENT PLANT	date Nov 2016	drawn by SHIKHA		
scale N.T.S.	ckd by Anand Havelia			