


RCC Slab As Per Structure Design
The Top Slab Shown is 350 mm
Below FFL This Will be as Per
Arch. / Landscape / Site Requirement

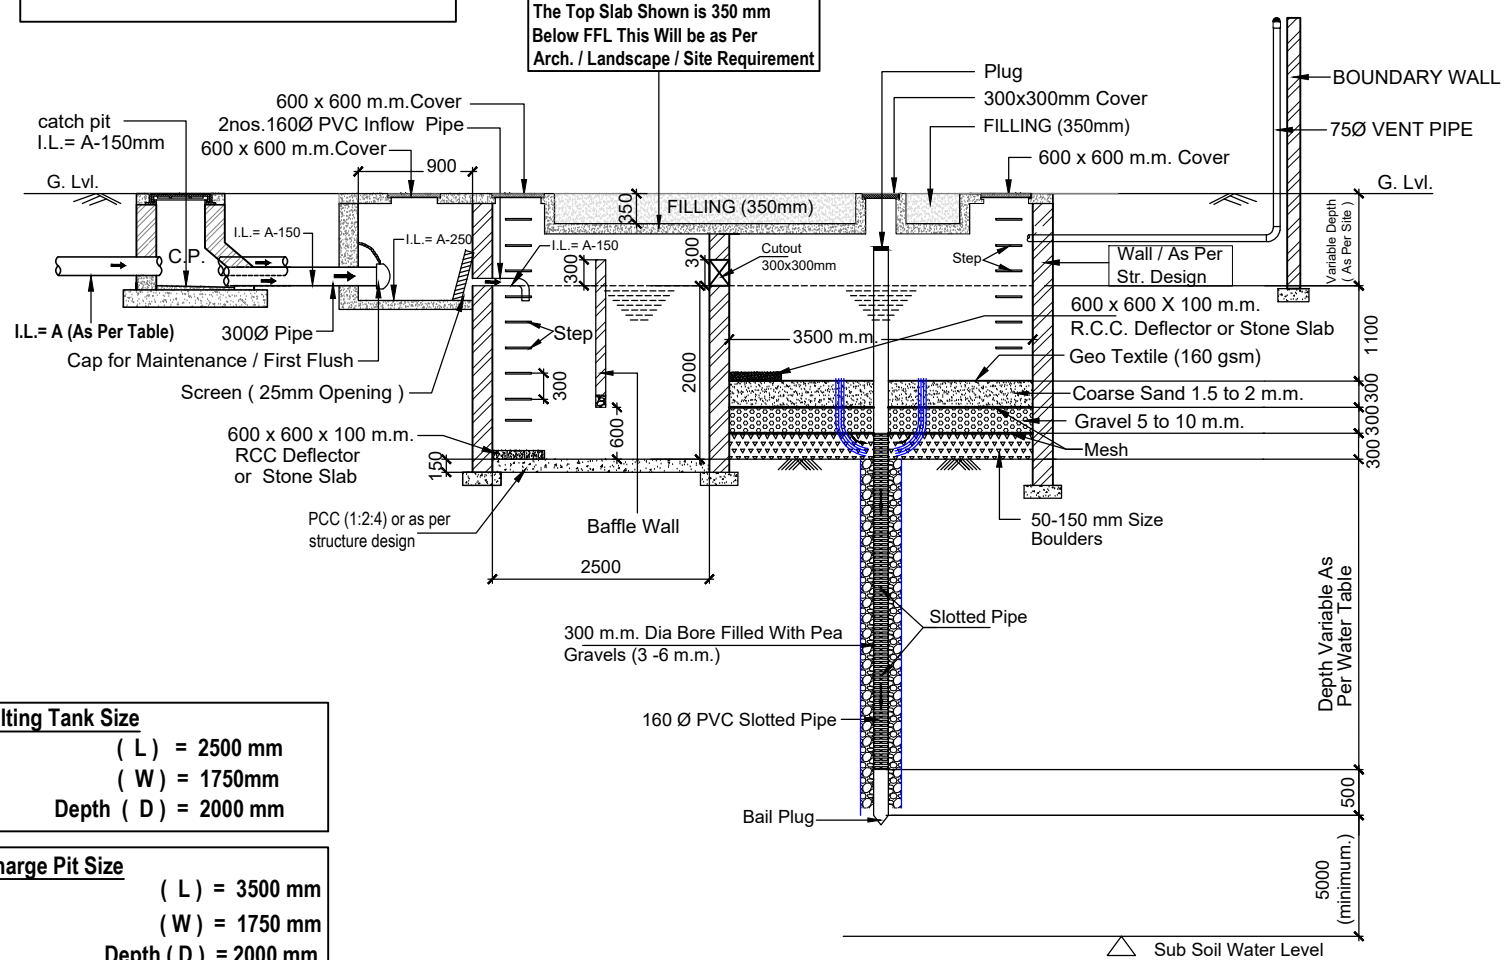

Section RWH Detail

(L) = 2500 mm
(W) = 1750mm
Depth (D) = 2000 mm

(L) = 3500 mm
(W) = 1750 mm
Depth (D) = 2000 mm

- 1) All Wall / Slab / Base of RWH Shall Be Strictly As Per Structure Consultants Design & Detail.
- 2) The Bore Well Pipe of Recharge Pit Should Be Left At Least 5 m Above The Known Highest Water Table To Avoid Any Possible Pollution To The Aquifer.
- 3) The Slots Shall Start Below The Level of Foundation.

..	..	..
Rev. No.	Date	Revision

Ckd By : Anand Havelia

cespl
Working Together To Create Value

Noida Office : B - 67, Sector - 67, Noida - 201 301
Lko. Office : R 006, Rohtas Plumeria, Gomti Nagar, Lucknow
Tel : (0120) 6943500 (30 Lines)
e mail : mail@cespl.in, website : www.cespl.in