


NOTE:-


- 1) THE DESILTING CHAMBER AND RECHARGE WELL SHALL BE CONSTRUCTED AS PER THE STRUCTURE DRAWINGS.
  - 2) THIS IS A GENERAL ARRANGEMENT DRAWING FOR PREPARATION OF STRUCTURAL DETAILING.

LEGEND:-

1. COARSE SAND (1.5 – 2MM SIZE).
  2. GRAVELS (5 – 10MM SIZE).
  3. BOULDERS (50-200MM SIZE).
  4. BRICK WORK IN 1:4.
  5. LEAN CONCRETE (1 : 4 : 8).
  6. PRECAST R.C.C. SLAB 150MM THICK.
  7. 40MM THICK BEARING LEVEL CONCRETE (1 : 2 : 4).
  8. 200MM $\phi$  uPVC BLIND PIPE AS PER 1.S.4985.
  9. 200MM $\phi$  uPVC. SLOTTED PIPE.
  10. GRAVEL PACKING (5-10MM) AROUND SLOTTED PIPE.
  11. 12MM THICK WATER PROOFING PLASTER IN C.M. 1 : 3.
  12. BITUMEN PAINTING @ 1.7KG / SQ.CM OVER 20MM THICK WATER PROOFING PLASTER IN C.M. 1 : 4.

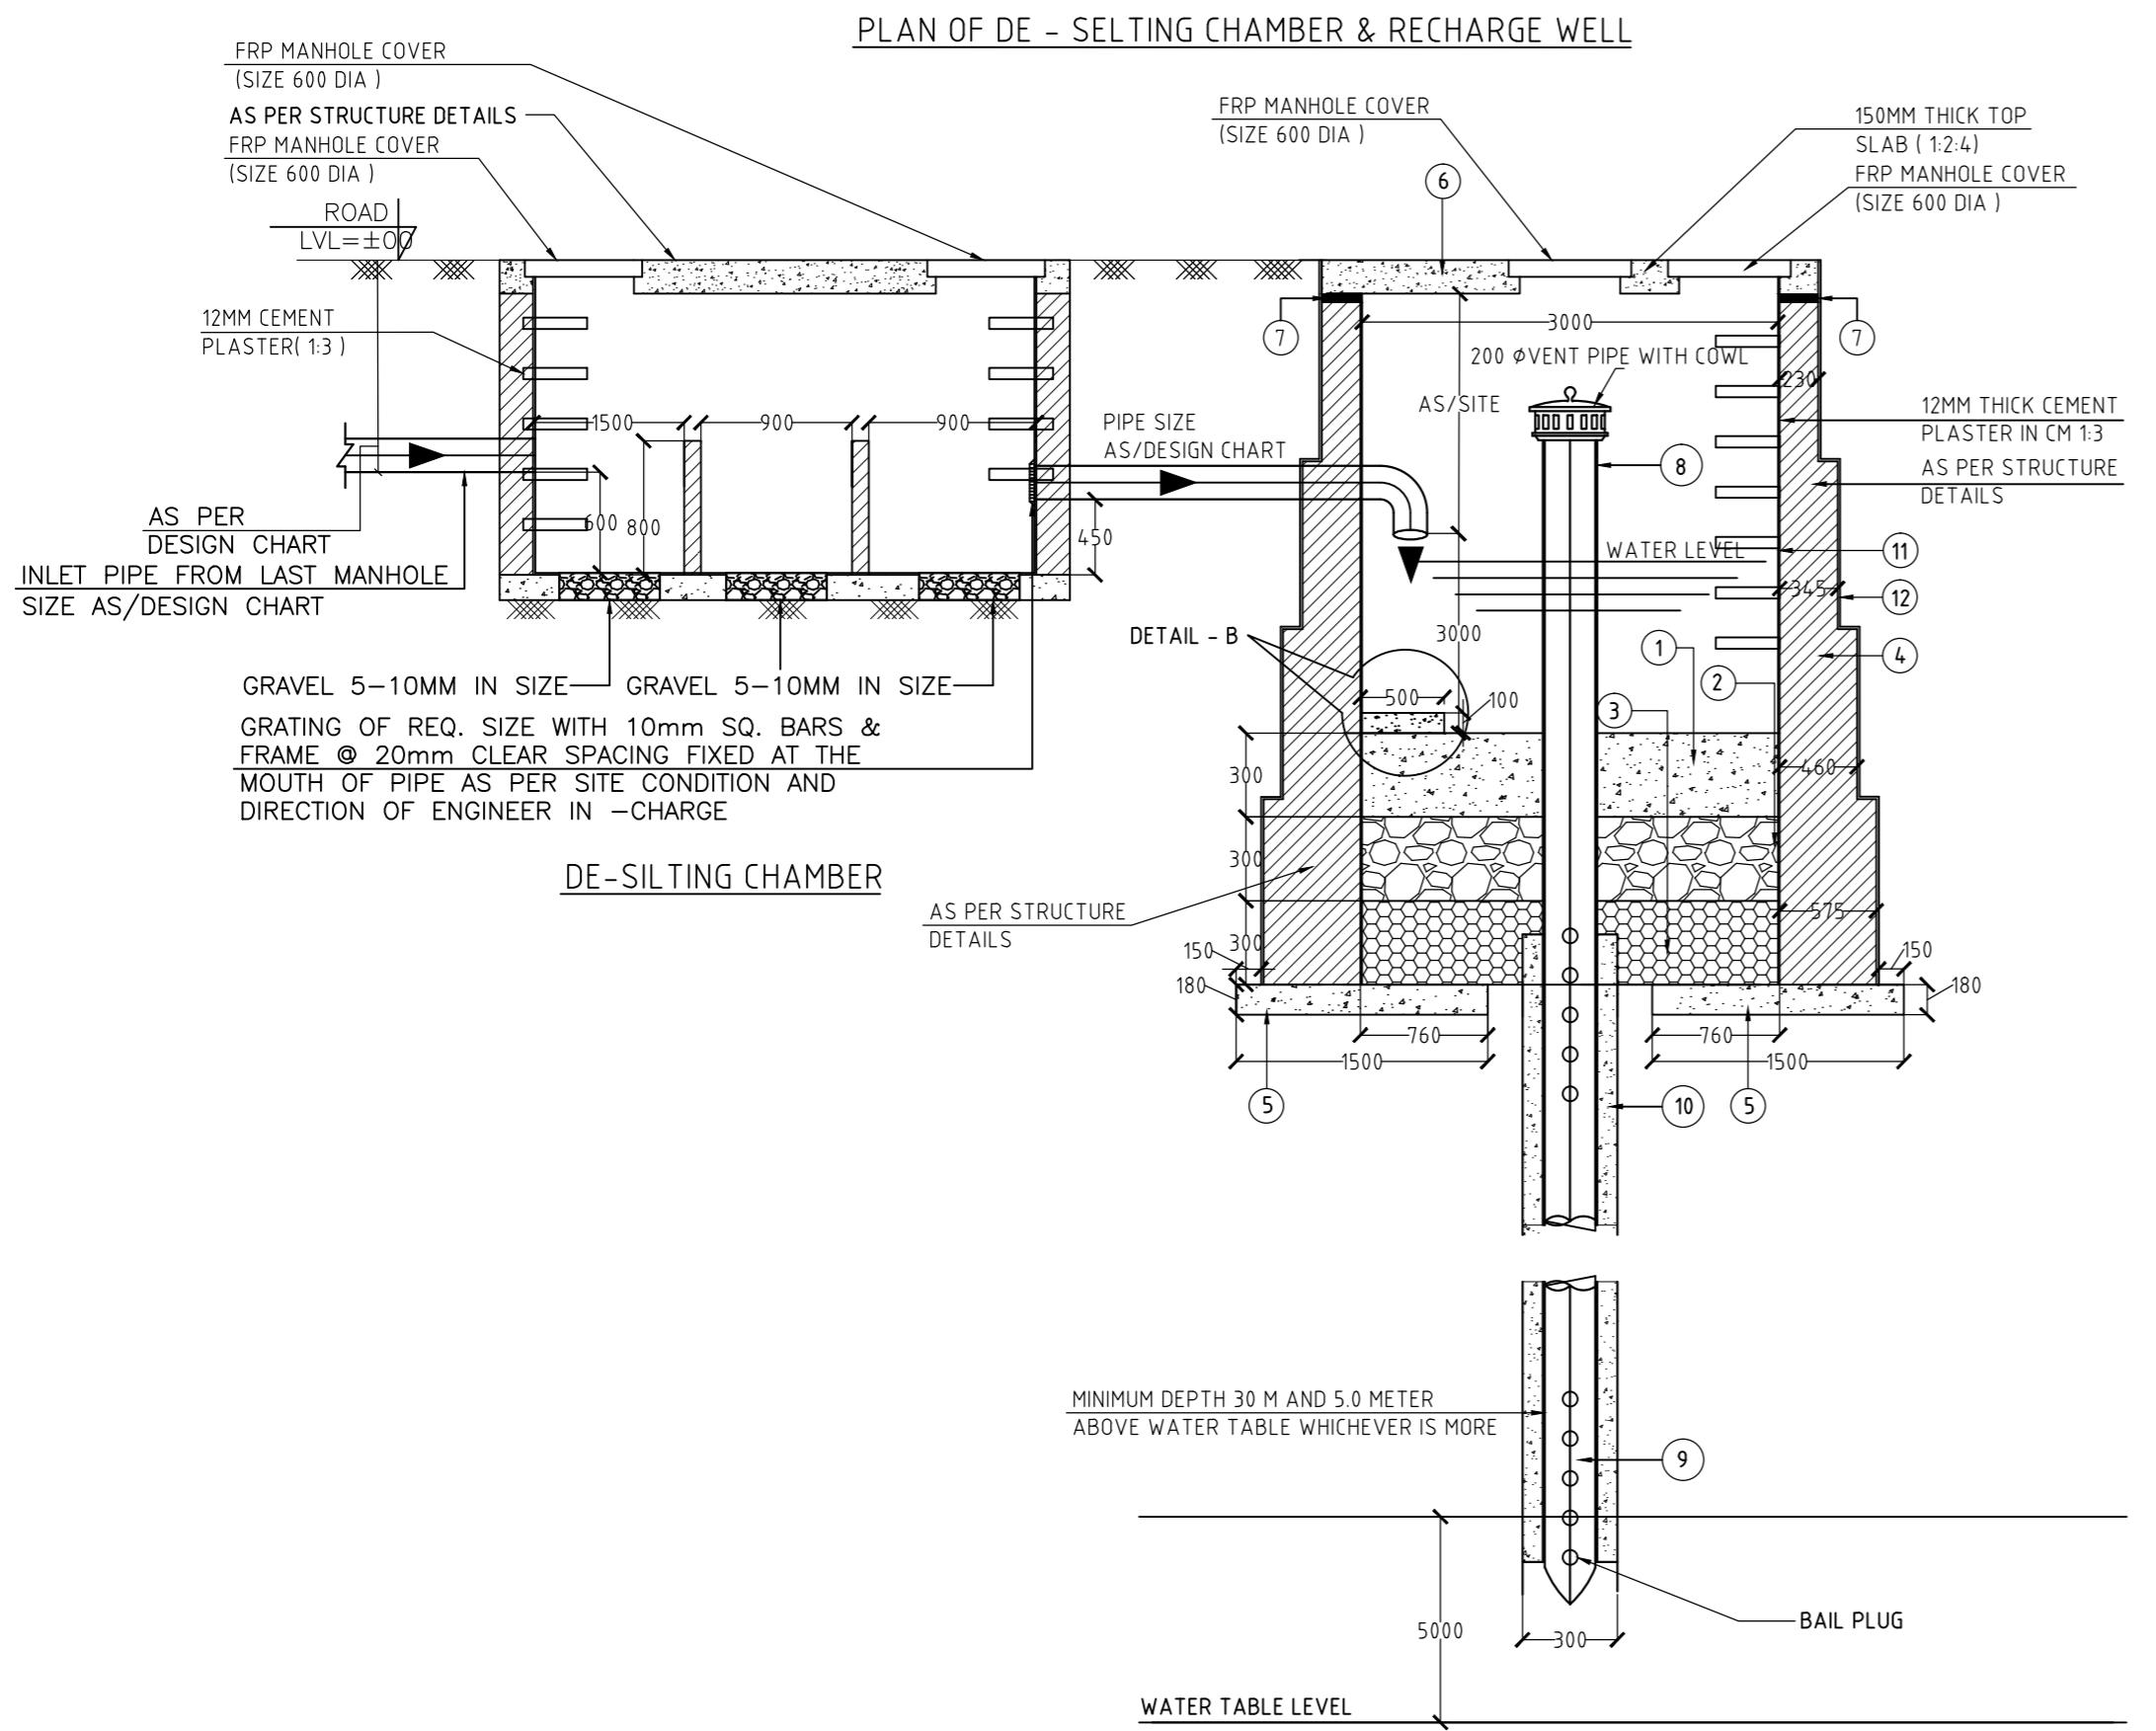

## SECTION A-A

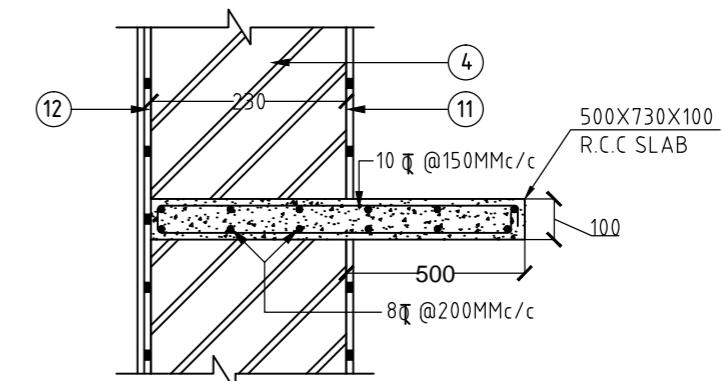

## DETAIL-B