

**FIRE HYDRANT CABINET (FHC)**  
 150 MM DIA FIRE FIGHTING WET RISER WITH FOLLOWING  
 a) 63 MM DIA SINGLE HEADED HYDRANT VALVE  
 b) ONE NOS. 20 MM DIA 30 M. LONG HOSE REEL  
 c) TWO NOS. 63 MM DIA 15 M. LONG FIRE HOSE PIPE  
 d) ONE BRANCH PIPE  
 e) ONE NO 4.5 Kg CO2 GAS TYPE FIRE EXTINGUISHER  
 f) ONE NO 6 Kg ABC TYPE FIRE EXTINGUISHER

LEGEND : ( Plumbing )		
S.No.	SYMBOL	DESCRIPTION
1.	(S)	1100 UPVC SOIL AND VENT PIPE
2.	(W)	1100 UPVC WASTE AND VENT PIPE
3.	(R110)	1100 UPVC RAIN WATER PIPE
4.	(B)	750 UPVC BALCONY / CORRIDOR DRAIN PIPE
5.	(V)	750 UPVC ANTI SYPHONAGE PIPE
6.	(C1)	DOMESTIC WATER SUPPLY DROP FROM TANK TO TOILET / KITCHEN FOR ALL FLOOR EXCEPT TOP THREE FLOOR
7.	(C2)	DOMESTIC WATER SUPPLY DROP FROM TANK TO TOILET / KITCHEN FOR TOP THREE FLOOR ONLY
8.	(H)	HOT WATER SUPPLY PIPE (FROM SOLAR SYSTEM)
9.	(F)	RECYCLED WATER SUPPLY DROP FROM O.H.T. TO W.C.
10.	(G)	GEYSER
11.	(W.M.)	WASHING MACHINE
12.	(P)	WATER PURIFIER
13.	(H.S.)	HEALTH SPRAY WITH ANGLE VALVE
14.	(M)	MIXTURE & SHOWER
15.	(CWS)	COLD WATER SUPPLY PIPE (CWS)
16.	(HWS)	HOT WATER SUPPLY PIPE (HWS)
17.	(SWS)	SOLAR HOT WATER SUPPLY PIPE (SWS)
18.	(RWS)	RECYCLED WATER SUPPLY PIPE (RWS)
19.	(D)	250 PVC AC DRAIN BRANCH CONNECTION
20.	(I)	ISOLATING VALVE
21.	(DP)	DRAIN POINT
22.	(MFT)	MULTI FLOOR TRAP - 6" deep (50 mm seal)
23.	(PT)	P TRAP (110 X 110 MM) - long type (50 mm seal)
24.	(ST)	S TRAP (110 X 110 MM) (50 mm seal)
25.	(E)	EUROPEAN W. C.
26.	(F)	FLAT BACK WASH BASIN
27.	(C)	COUNTER WASH BASIN
28.	(S)	SINK WITH DRAIN BOARD
29.	(S)	SINK WITHOUT DRAIN BOARD
30.	(A)	650 AC DRAIN PIPE UPVC (6 Kg/Sqcm) as per IS-4985

rev. no.	date	revision
...	...	...

project  
**PROP. GR. HOUSING "ARIHANT ONE"**  
 AT PLOT GH-01, GREATER NOIDA.

title  
**WASTE DISPOSAL / PLUMBING (TOWER-A2)**

subtitle  
**TYPICAL FLOOR PLAN (2B+G+26)**

drawing released for  
 APPROVAL  RERA SUBMISSION  
 ADVANCE COPY  CONSTRUCTION


drg. no. **ARIHANT ONE / TOWER - A2 / P - 01** drawn by **Baldev**

scale **1 : 65** designed by **Sanjay Goel**

date **August - 2022** checked by **Anand Havelia**

architects  
 B-421, NFC Ph: +91-11-46130600 ccs@inconfuence.com Member of IGCBC  
 N.D-65, INDIA Ph: +91-11-49564768 www.inconfuence.com ISO - 9001 : 2000  
 architecture urban design hospitality interiors

services consultant  
**Consummate Engineering Services (P) Ltd.**  
 Noida Office : B - 87, Sector - 67, Noida - 201 301  
 Tel : (0120) 2303590 (24 Lines)  
 Lko. Office : R 006, Rohlas Ploveria, Gomti Nagar, Lucknow  
 e mail : mail@cespl.in, website : www.cespl.in

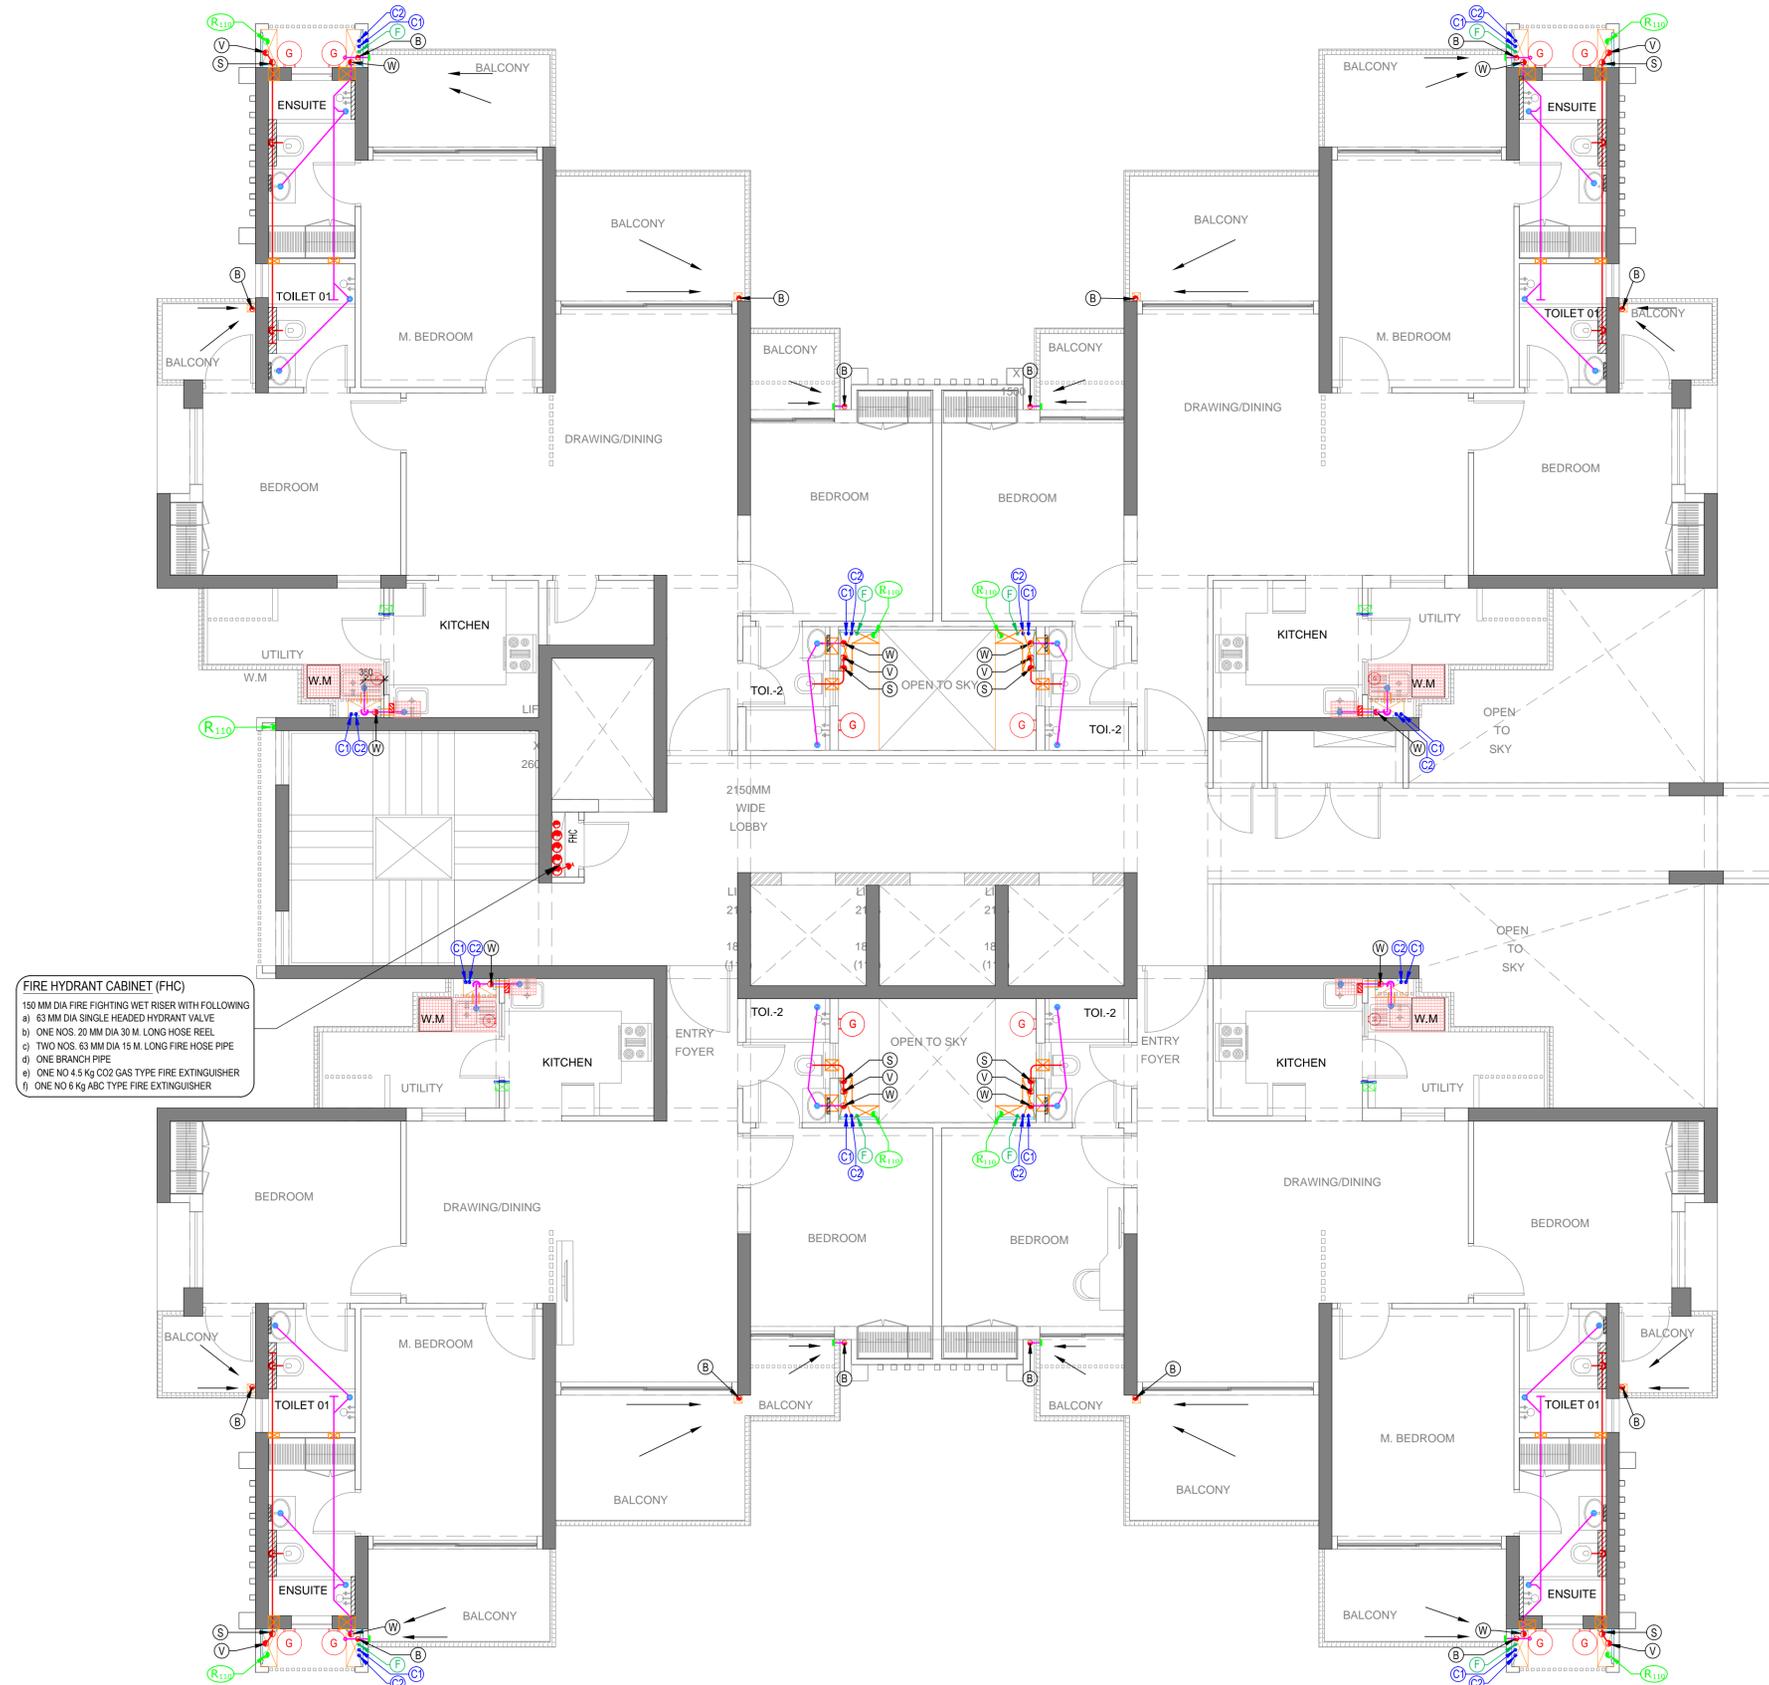

**FIRE HYDRANT CABINET (FHC)**  
 150 MM DIA FIRE FIGHTING WET RISER WITH FOLLOWING  
 a) 63 MM DIA SINGLE HEADED HYDRANT VALVE  
 b) ONE NOS. 20 MM DIA 30 M. LONG HOSE REEL  
 c) TWO NOS. 63 MM DIA 15 M. LONG FIRE HOSE PIPE  
 d) ONE BRANCH PIPE  
 e) ONE NO 4.5 Kg CO2 GAS TYPE FIRE EXTINGUISHER  
 f) ONE NO 6 Kg ABC TYPE FIRE EXTINGUISHER

LEGEND : (Plumbing)		
S.No.	SYMBOL	DESCRIPTION
1.	(S)	1100 UPVC SOIL AND VENT PIPE
2.	(W)	1100 UPVC WASTE AND VENT PIPE
3.	(R110)	1100 UPVC RAIN WATER PIPE
4.	(B)	750 UPVC BALCONY / CORRIDOR DRAIN PIPE
5.	(V)	750 UPVC ANTI SYPHONAGE PIPE
6.	(C1)	DOMESTIC WATER SUPPLY DROP FROM TANK TO TOILET / KITCHEN FOR ALL FLOOR EXCEPT TOP THREE FLOOR
7.	(C2)	DOMESTIC WATER SUPPLY DROP FROM TANK TO TOILET / KITCHEN FOR TOP THREE FLOOR ONLY
8.	(H)	HOT WATER SUPPLY PIPE (FROM SOLAR SYSTEM)
9.	(F)	RECYCLED WATER SUPPLY DROP FROM O.H.T. TO W.C.
10.	(G)	GEYSER
11.	(W.M.)	WASHING MACHINE
12.	(W.P.)	WATER PURIFIER
13.	(H.S.)	HEALTH SPRAY WITH ANGLE VALVE
14.	(M.S.)	MIXTURE & SHOWER
15.	(---)	COLD WATER SUPPLY PIPE (CWS)
16.	(---)	HOT WATER SUPPLY PIPE (HWS)
17.	(---)	SOLAR HOT WATER SUPPLY PIPE (SWS)
18.	(---)	RECYCLED WATER SUPPLY PIPE (RWS)
19.	(---)	250 PVC AC DRAIN BRANCH CONNECTION
20.	(---)	ISOLATING VALVE
21.	(DP)	DRAIN POINT
22.	(MFT)	MULTI FLOOR TRAP - 6" deep (50 mm seal)
23.	(PT)	P TRAP (110 X 110 MM) - long type (50 mm seal)
24.	(ST)	S TRAP (110 X 110 MM) (50 mm seal)
25.	(W.C.)	EUROPEAN W. C.
26.	(F.B.W.B.)	FLAT BACK WASH BASIN
27.	(C.W.B.)	COUNTER WASH BASIN
28.	(S.W.D.B.)	SINK WITH DRAIN BOARD
29.	(S.W.O.D.B.)	SINK WITHOUT DRAIN BOARD
30.	(A)	650 AC DRAIN PIPE UPVC (6 Kg/Sqcm) as per IS-4985

rev. no.	date	revision
...	...	...

project  
**PROP. GR. HOUSING "ARIHANT ONE"**  
 AT PLOT GH-01, GREATER NOIDA.

title  
**WASTE DISPOSAL / PLUMBING (TOWER-A3)**

subtitle  
**TYPICAL FLOOR PLAN (2B+G+26)**

drawing released for  
 APPROVAL       RERA SUBMISSION  
 ADVANCE COPY       CONSTRUCTION

drg. no. **ARIHANT ONE / TOWER - A3 / P - 01**      drawn by **Baldev**

scale **1 : 65**      designed by **Sanjay Goel**

date **August - 2022**      checked by **Anand Havelia**

architects  
 B-421, NFC Ph: +91-11-46130600 ccs@inconfluence.com Member of IGCBC  
 N.D-65, INDIA Ph: +91-11-49564768 www.inconfluence.com ISO - 9001 : 2000  
 architecture urban design hospitality interiors

services consultant  
**Consummate Engineering Services (P) Ltd.**  
 Noida Office : B - 87, Sector - 67, Noida - 201 301  
 Tel : (0120) 2303500 | 24 Lines |  
 Lko. Office : R 606, Rohlas Puri, Gomti Nagar, Lucknow  
 e mail : mail@cespl.in, website : www.cespl.in