


-646.49

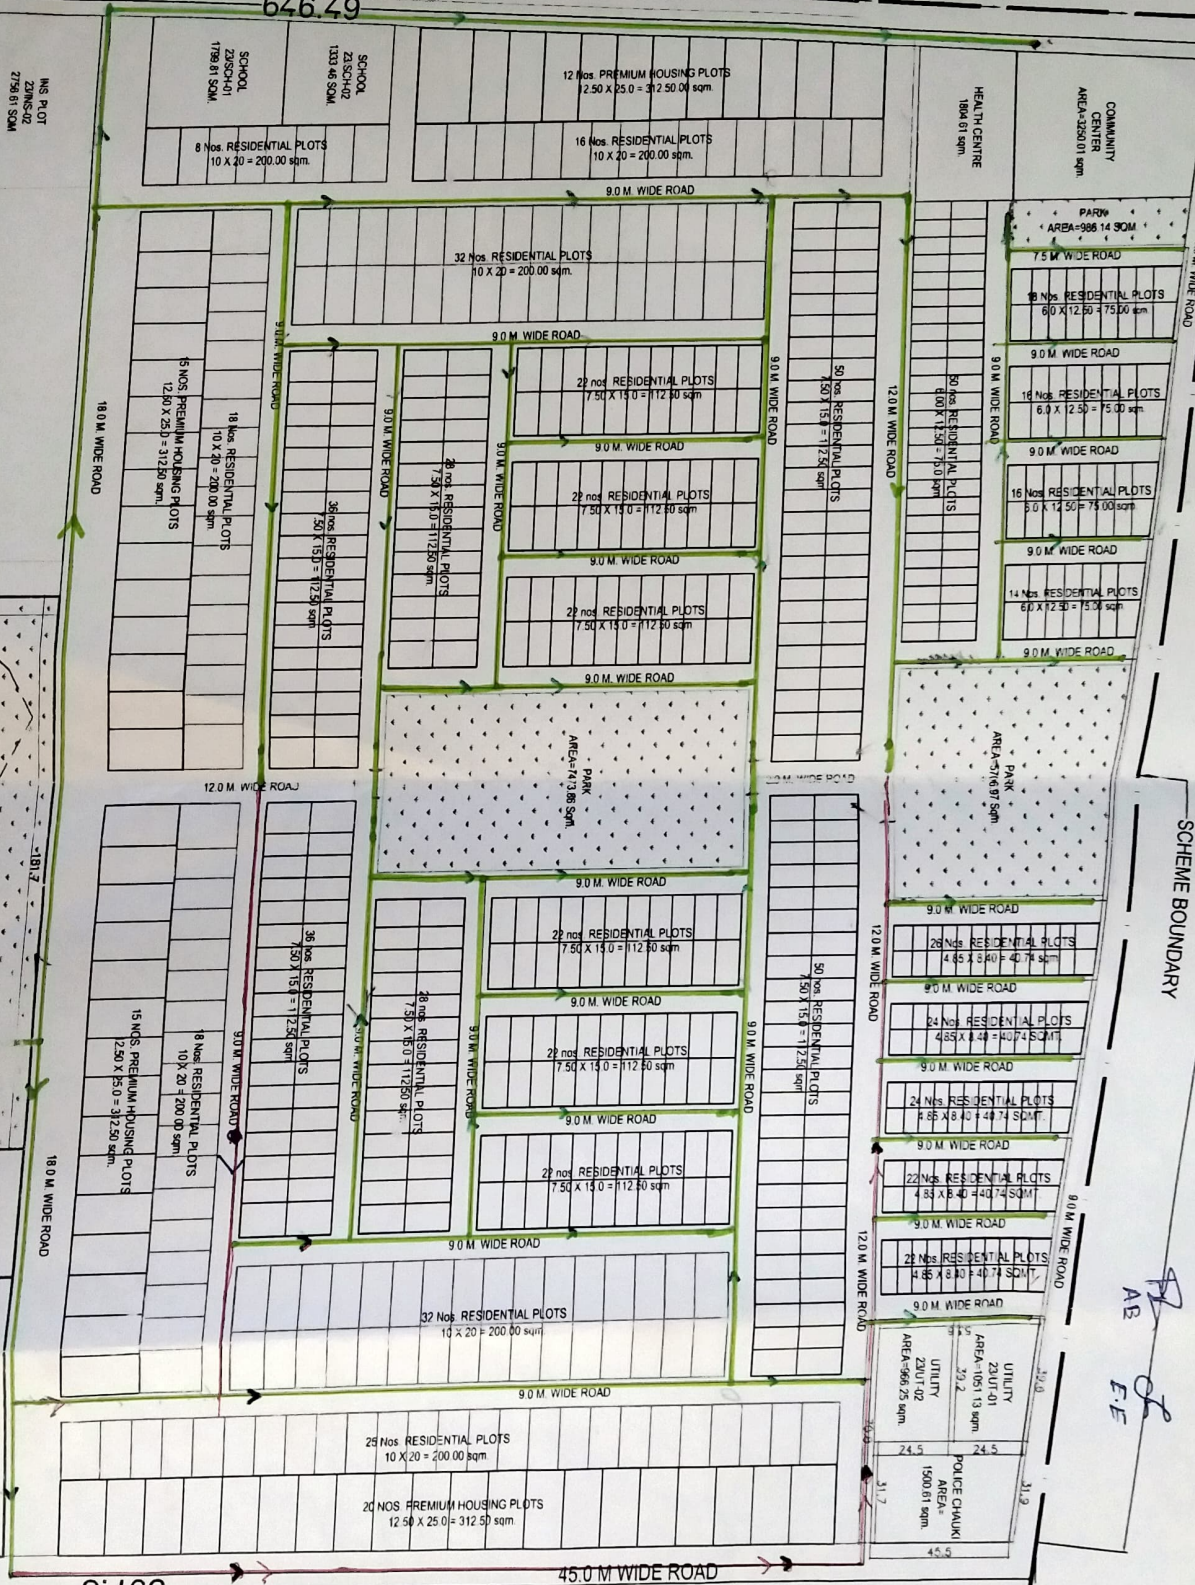

497.78

SCHEME BOUNDARY

AB E.E

INDEX:

Proposed Internal water supply system

(2) 125 mm. Dia P.V.C Pipe line.

