

DATE	REV NO.	BRIEF RECORD
15.09.15	01	APPROVED

CONSULTANTS	SAJAG CONSULTANTS
NEAR MAHARANI BAGH CROSS	
NEW DELHI-110014	
TELEPHONE-26343059, 9868848	
DIVISION	DRAWN
PL. FF	VIKRAM
DRG. NO.	193.5.3.00.03A

SCHEME:
AWADH VIHAR YOJNA, LUCKNOW

DRG. TITLE:
EXTERNAL WATER
SUPPLY LAYOUT

PROJECT:
GROUP HOUSING IN
MANDAKINI (SECTOR 2)

SCALE:
DATE: 05.12.2013



GOOD FOR EXECUTION
S E (P.C.)

LEGEND:

- FGL FORMED GROUND LEVEL
- BT(H) BP TAP (HORSE ADAPTER)
- BT BALL VALVE
- POTABLE WATER PIPELINE FROM PUMP ROOM TO DUCT --UPVC SCHEDULE-80
- POTABLE WATER PIPELINE FROM PUMP ROOM TO GARDENING TAP POINTS --UPVC SCHEDULE-80

NOTES:-

- ALL DIMENSIONS AND LEVELS ARE IN MM UNLESS STATED OTHERWISE
- ALL WATER PIPELINES TO BE SUSPENDED FROM BASEMENT CEILING LEVEL WITH HANGER RODS OF 8MM DIA. AT 1M C/C OR LESS DEPENDING ON SITE CONDITION
- THIS DRAWING SHALL NOT BE SCALED AND WRITTEN DIMENSIONS TO BE FOLLOWED.
- ALL PIPELINES SHALL BE LAID STRAIGHT AND IN GOOD WORKMANSHIP MANNER.

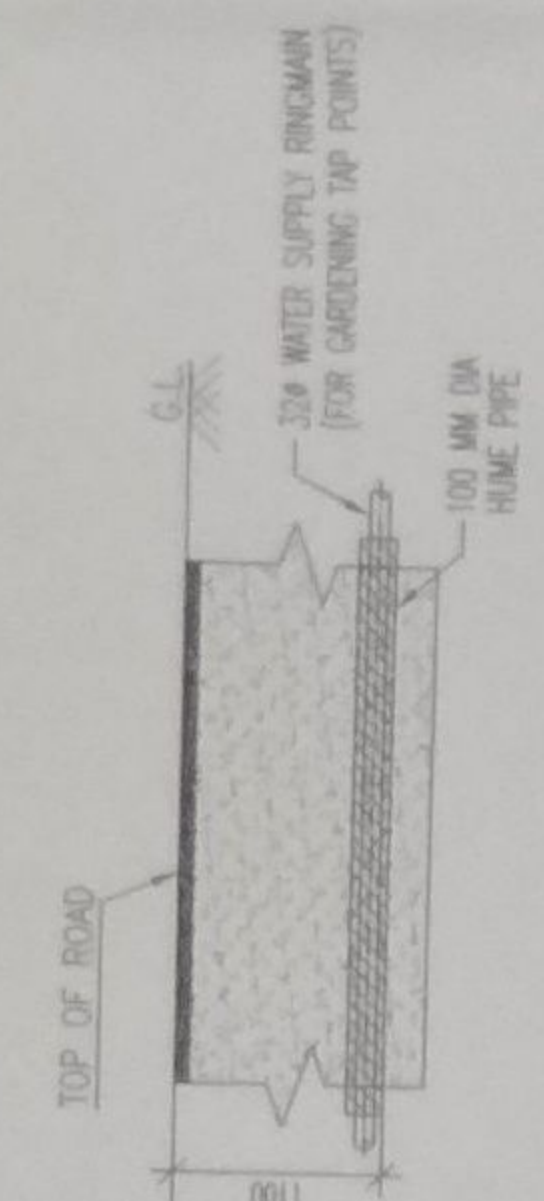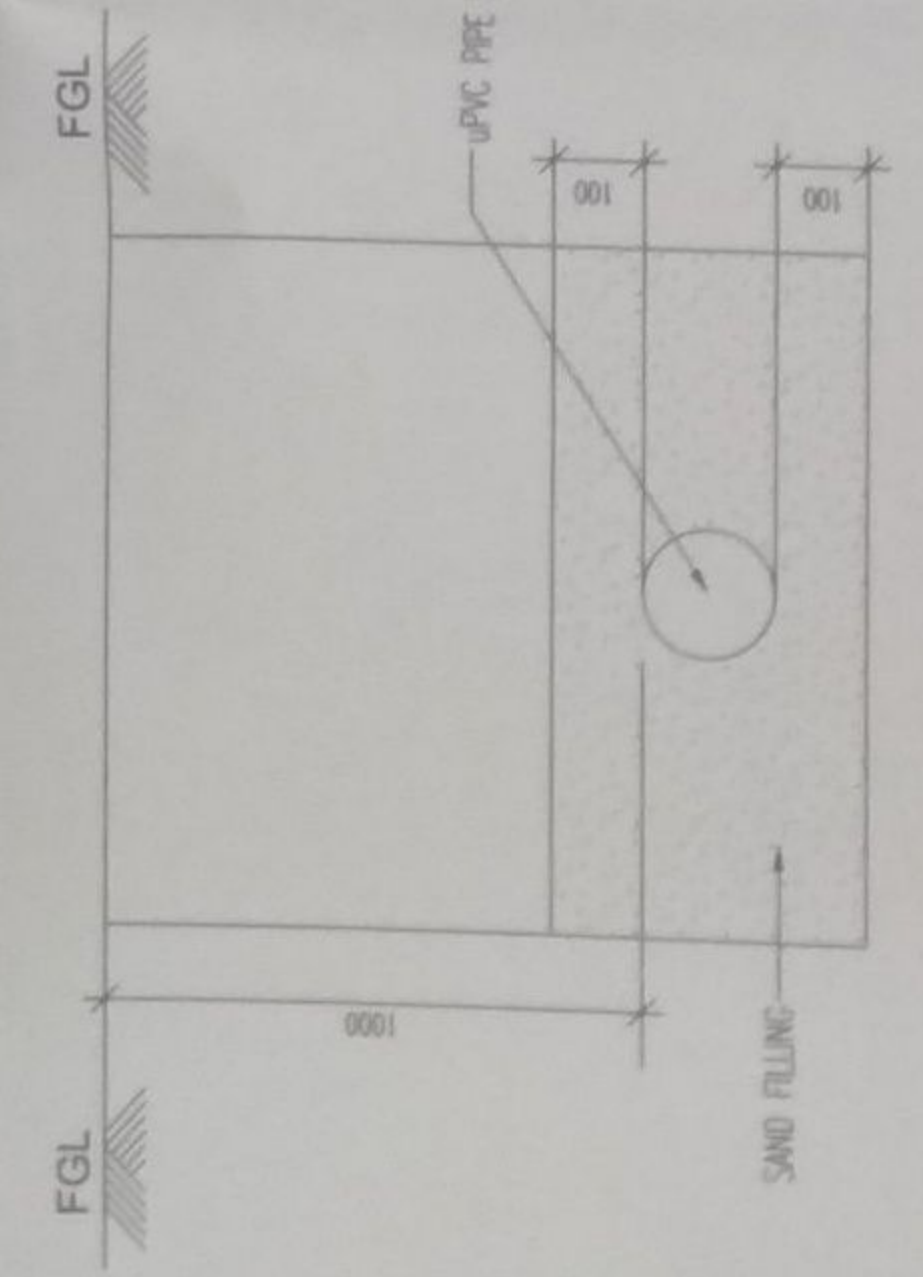

PIPE DETAIL-ROAD CROSSING AREA
(TYPICAL DETAIL FOR WATER SUPPLY PIPES)
(SCALE - NTS)

TYPICAL CROSS SECTION OF
WATER MAIN
(SCALE - NTS)

