


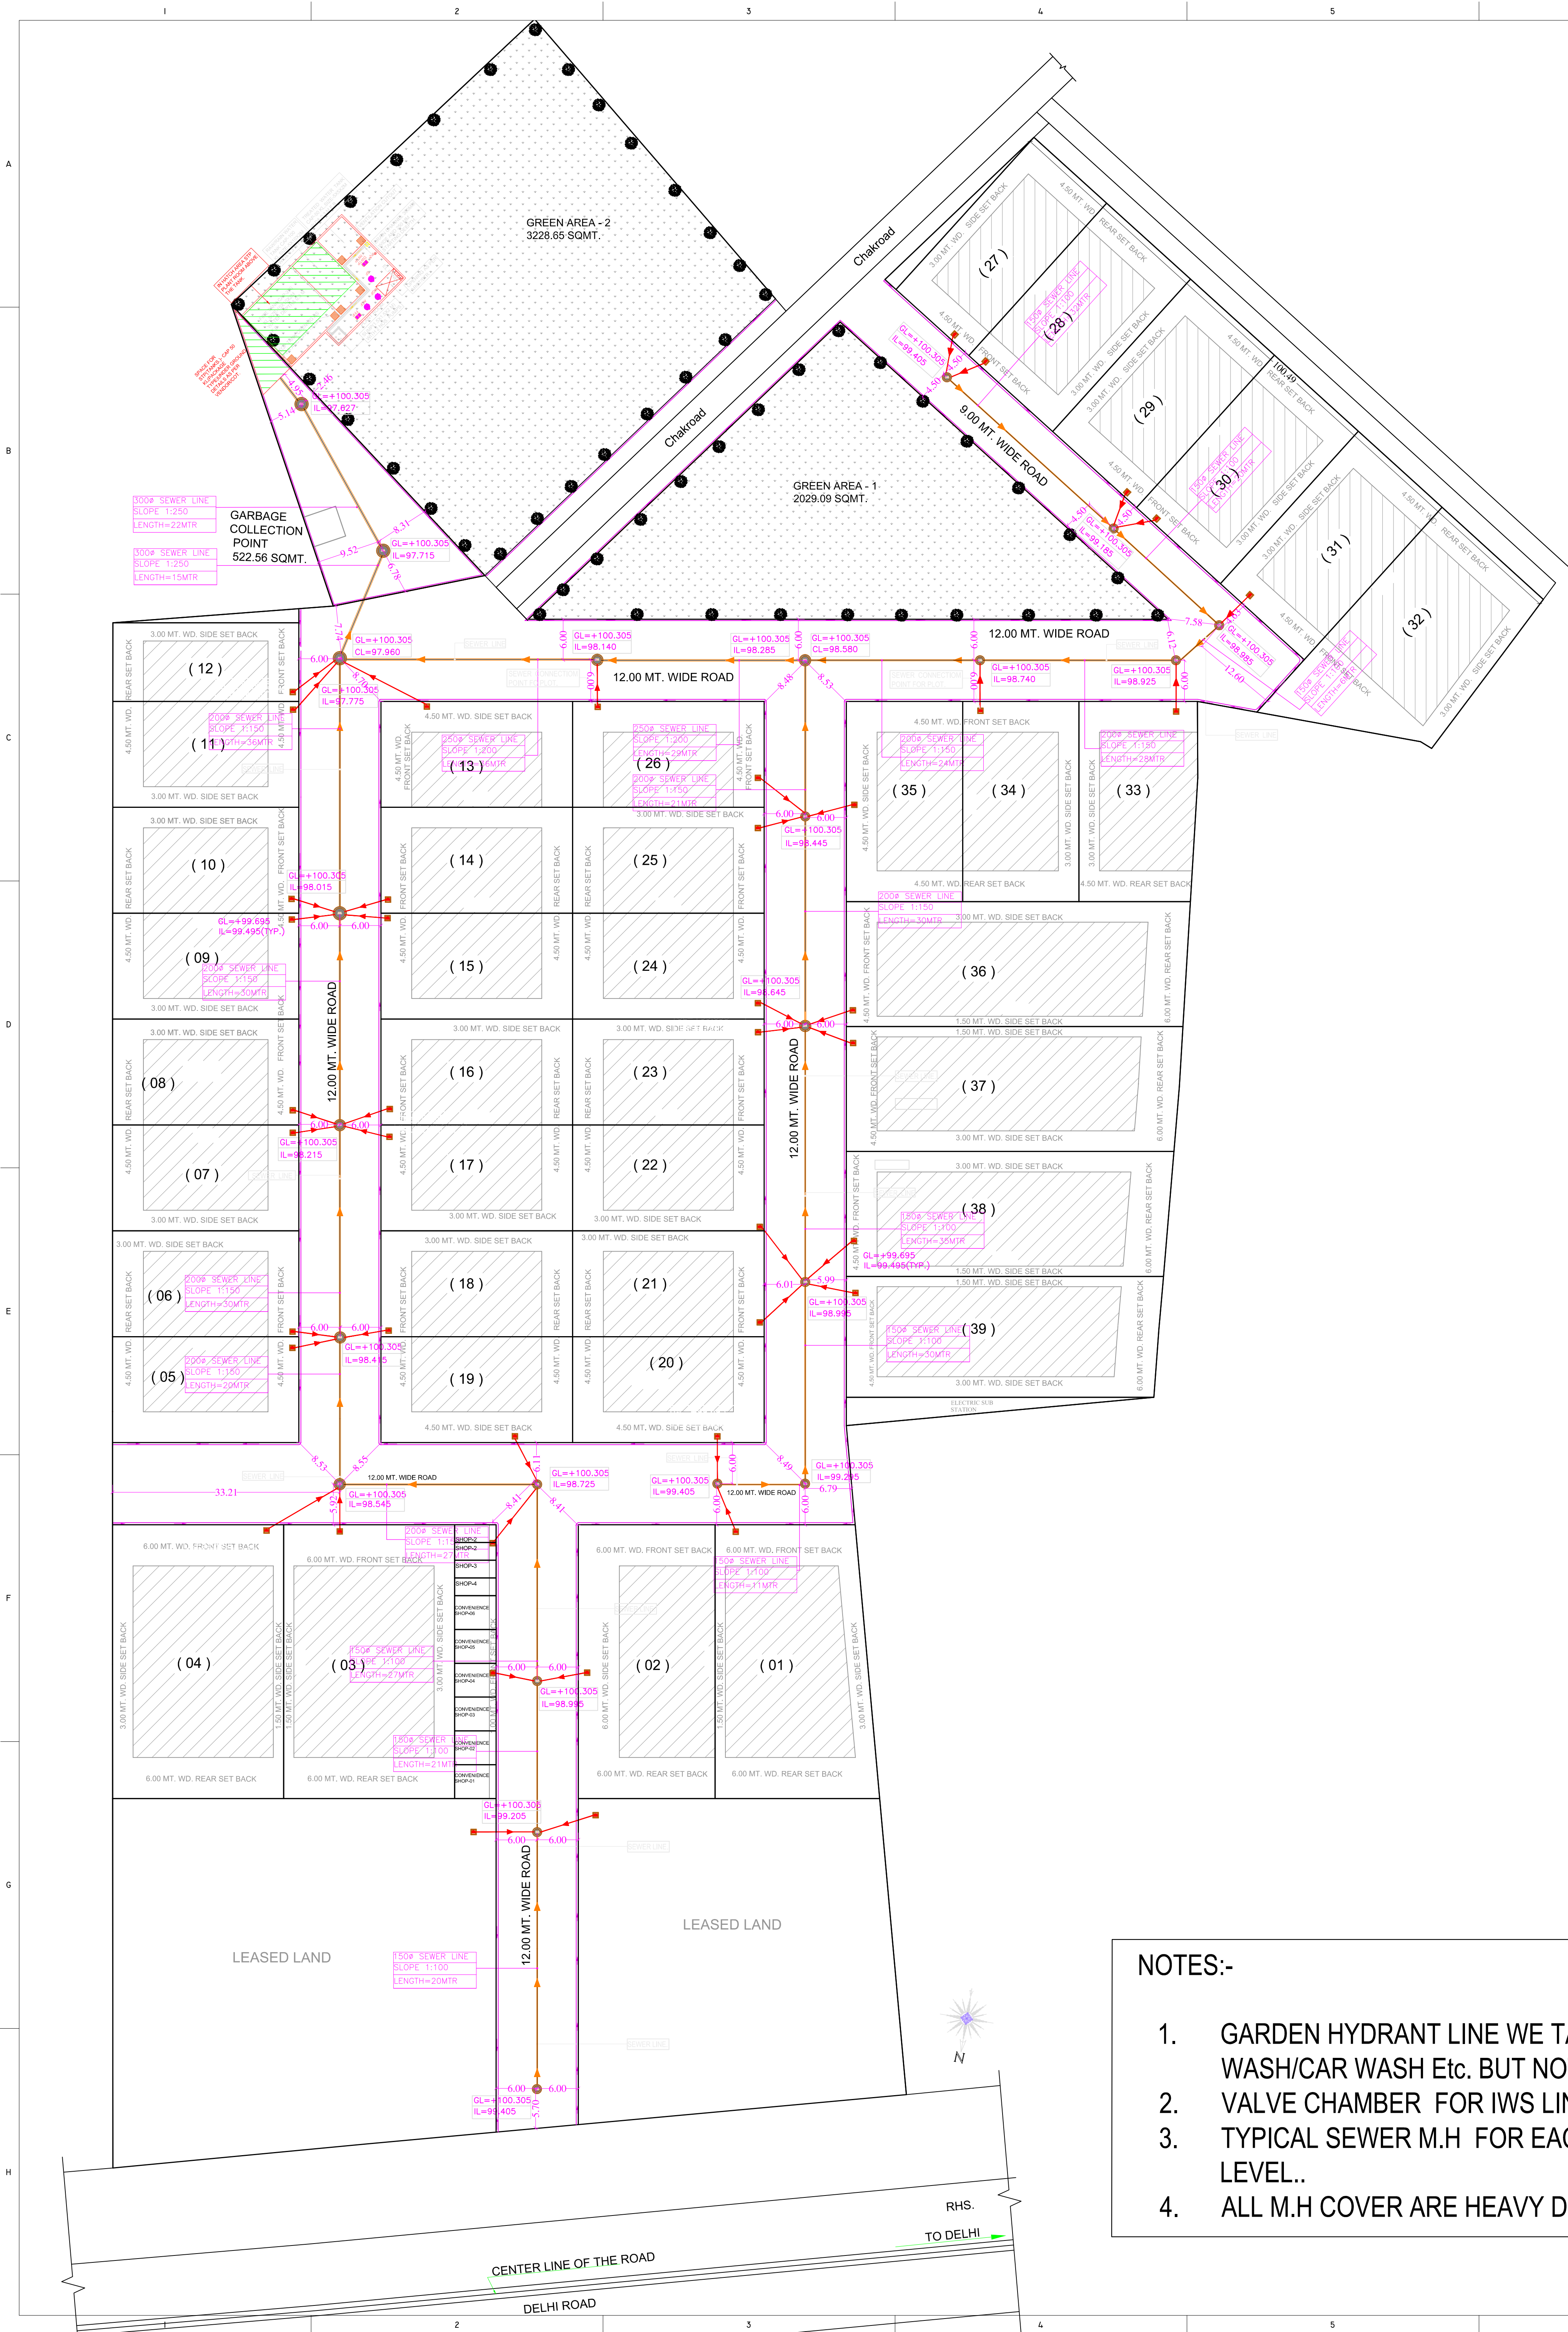


- NOTES:-
- GARDEN HYDRANT LINE WE TAKE A POINT AT EVERY 50M FOR ROAD WASH/CAR WASH Etc. BUT NOT USED FOR DOMISTIC PURPOSE.
 - VALVE CHAMBER FOR IWS LINE AT EVERY JUNCTION OF PIPE .
 - TYPICAL SEWER M.H FOR EACH PLOTS WITH 150Ø PIPE AND +99.495 LEVEL..
 - ALL M.H COVER ARE HEAVY DUITY EXCEPT PLOTS TAPING MH.

SIZE OF MANHOLE WITH
REFERENCE TO DEPTH


DEPTH	SIZE OF M.H.
0.90m TO 1.60m	900mm DIA
1.61m TO 2.20m	1200mm DIA
2.21m TO 9.00m	1500mm DIA
9.01m TO 13.90m	1800mmDIA

PLUMBING LEGEND- EXTERNAL


SEWER MANHOLE




STORM MANHOLE




CATCH BASIN SIZE 450X500 MM




SEWER LINE



STORM LINE




IRREGTION LINE




VALVE WITH CHAMBER 500X500MM




HARVESTING PIT- 4M DIA.,2M W.D




DESELTING CHAMBER- 1.5 X1 M




NON RETURN VALVE



VALVE



GARDEN HYDRANT.



PRE GFC...

NO.	DATE	DESCRIPTION

REVISION / ADDITION

CLIENT	
PROJECT	

SHEET TITLE
SEWAGE DRAINAGE
LAYOUT

JOB NO:	SCALE	DATE
DRAWN	CHECKED BY	STATUS
REVISION NO:	DRAWING NO:	
SHEET SIZE	PL-SD-04	