

HANDING OVER MEMO

Name of work - External Electrification work of Sector-5 Jagriti Vihar (extension) Sch-11 Meerut


NOTE-
 1- THIS LAY OUT PLAN HAS BEEN PREPARED ON THE BASIS OF INFORMATION GIVEN BY EX. EN. C.D.-5 VIDE HIS LETTER NO. 255/DT-21.02.2019 & RECOMMENDATION GIVEN BY SE-II WIDE HIS LETTER NO-1564/D1-03-05-2019
 2- THIS LAY OUT PLAN HAS BEEN FINALIZED ON BASIS OF FEASIBILITY GIVEN BY Ex. En. C.D. - 8 VIDE HIS LETTER NO. 889/Y - 8/20 ON DATED - 2706019
 3- THIS LAY OUT PLAN HAS BEEN FINALIZED ON BASIS OF FEASIBILITY GIVEN BY Ex. En. C.D. - 8 VIDE HIS LETTER NO. 1129/Y - 8/28 ON DATED - 09-08-2019

UPAVP
 ARCHITECTURE AND PLANNING UNIT-I
 NEELGIRI COMPLEX
 INDRA NAGAR, LUKHNOW

DWG. NO.

INDEX:

SN.	PARTICULARS	SYMBOL
1.	EXISTING 11KV H.T. LINE, D/CKT.	—
2.	S.T. POLE, SP-55, 11M LONG	•
3.	D.P. STRUCTURE (S/D.E.), SP-55, 11M LONG	••
4.	H.T. COMPOSITE LINE WITH DOG ACR COND. L.T. WITH ABC CABLE, 3x120+1x95+1x16mm ²	—
5.	H.T. COMPOSITE LINE (D.CKT.) WITH ACSR DOG COND. & L.T. WITH ABC 3x120+1x95+1x16mm ²	—
6.	H.T. CABLE, 3x300mm ²	—
7.	SUB-STM. D.P. STRUCTURE SP-55, 11M LONG	••
8.	DISTRIBUTION TRANSFORMER 400KVA	■
9.	L.T. LINE (D.CKT.) WITH ABC CABLE 3x120+1x95+1x16mm ²	—
10.	P.C.C. POLE, 8.5M LONG	•
11.	L.T. LINE WITH ABC CABLE, 3x120+1x95+1x16mm ²	—

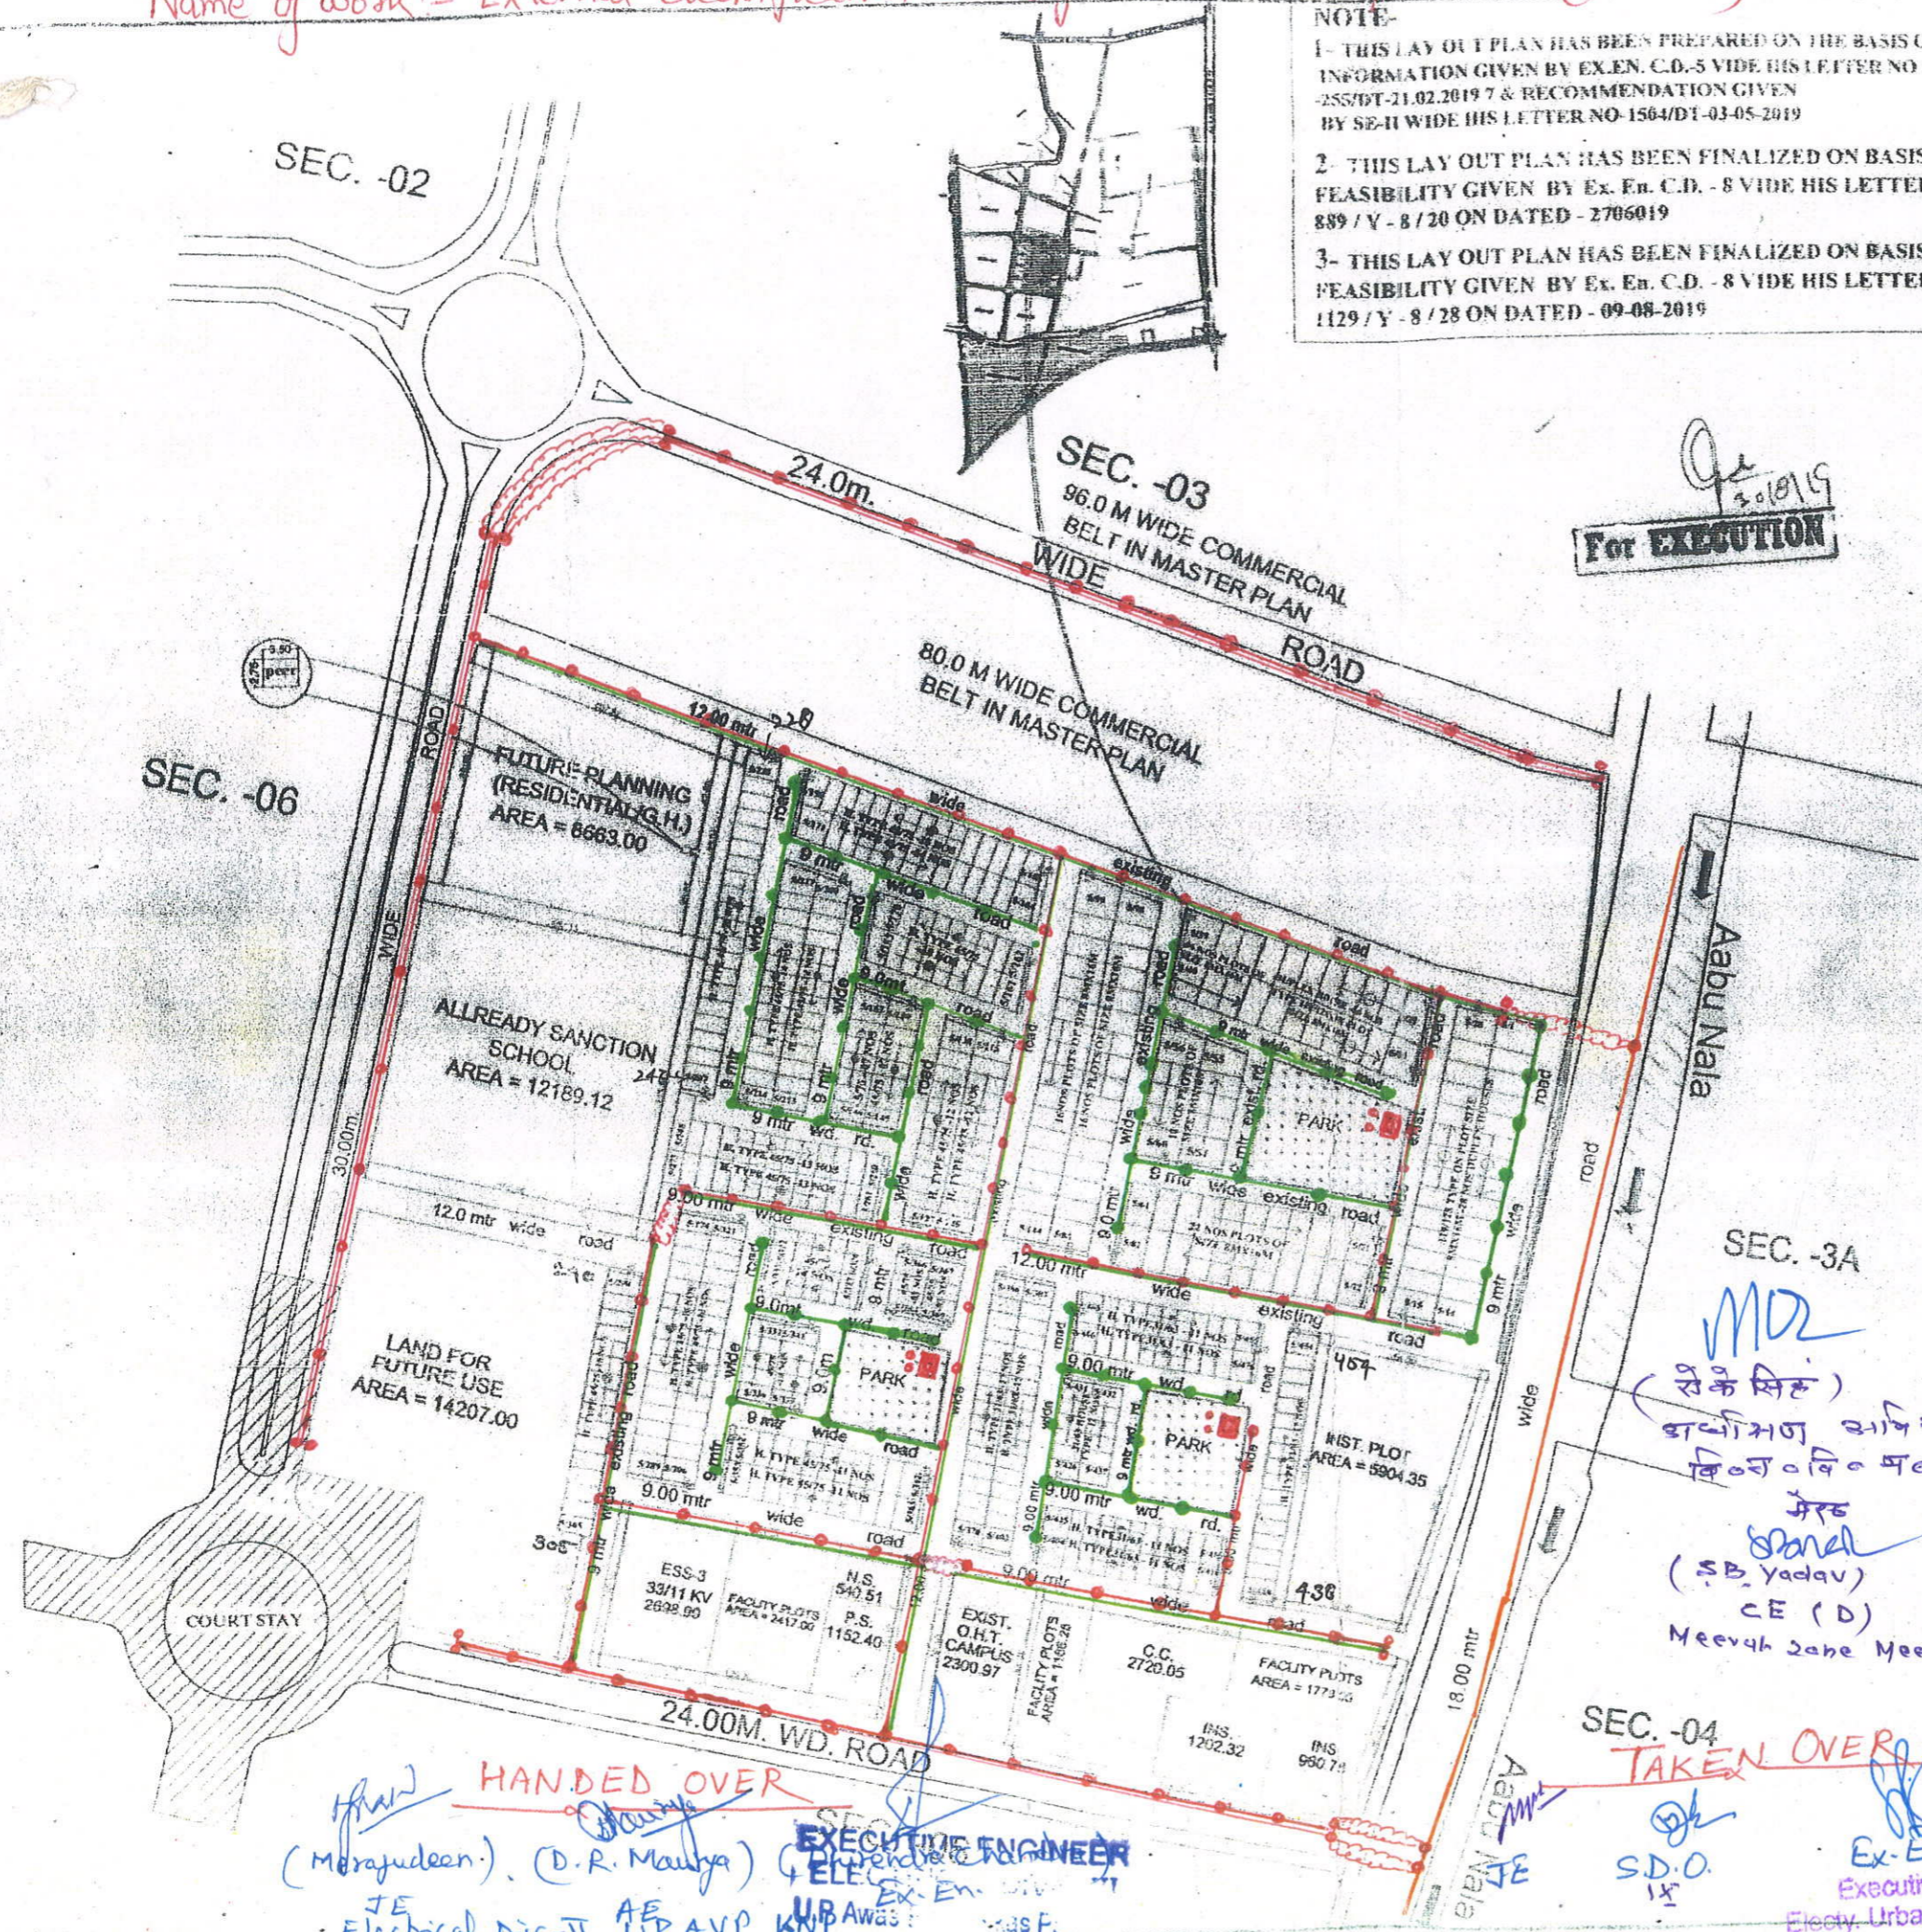

30/8/19
For EXECUTION

LEGEND
 REVISED
 PROPOSED
 COURT STAY
 SCHEME
JAGRITI VIHAR YOJNA NO. 11, MEERUT
 PROJECT:
 REVISED AND PROPOSED LAY OUT AND
 NUMBTING DEVELOPMENT CONTROL
 PLAN OF SECTOR - 5 SCHEME NO - 11,
 JAGRITI VIHAR, MEERUT

SCALE:

DATE: 02-08-2019

R.H. JAISWAL
 ARCH. ASSISTANT

R.H. Jaiswal
 20-8-19

ASST. ARCHITECT PLANNER

S. YADAV
 ARCHT.

S. Yadav
 27/8/19

ARCHITECT PLANNER

S.P.N. SINGH

CHIEF ARCHITECT PLANNER

WAY CHAUDHARY

Way Chaudhary
 27/8/19

HANDLED OVER
 (Mansujdeen), (D.R. Maurya) **EXECUTIVE ENGINEER**
 Electrical Div-II AE UPAVP KNP
 UPAVP KNP
 Ex-En. C.D. - 5
 UPAVP KNP
 KNP

TAKEN OVER
 S.D.O.
 Ex-Engineer
 Executive Engineer
 Elec. Urban Dist. Division-II
 Meerut