


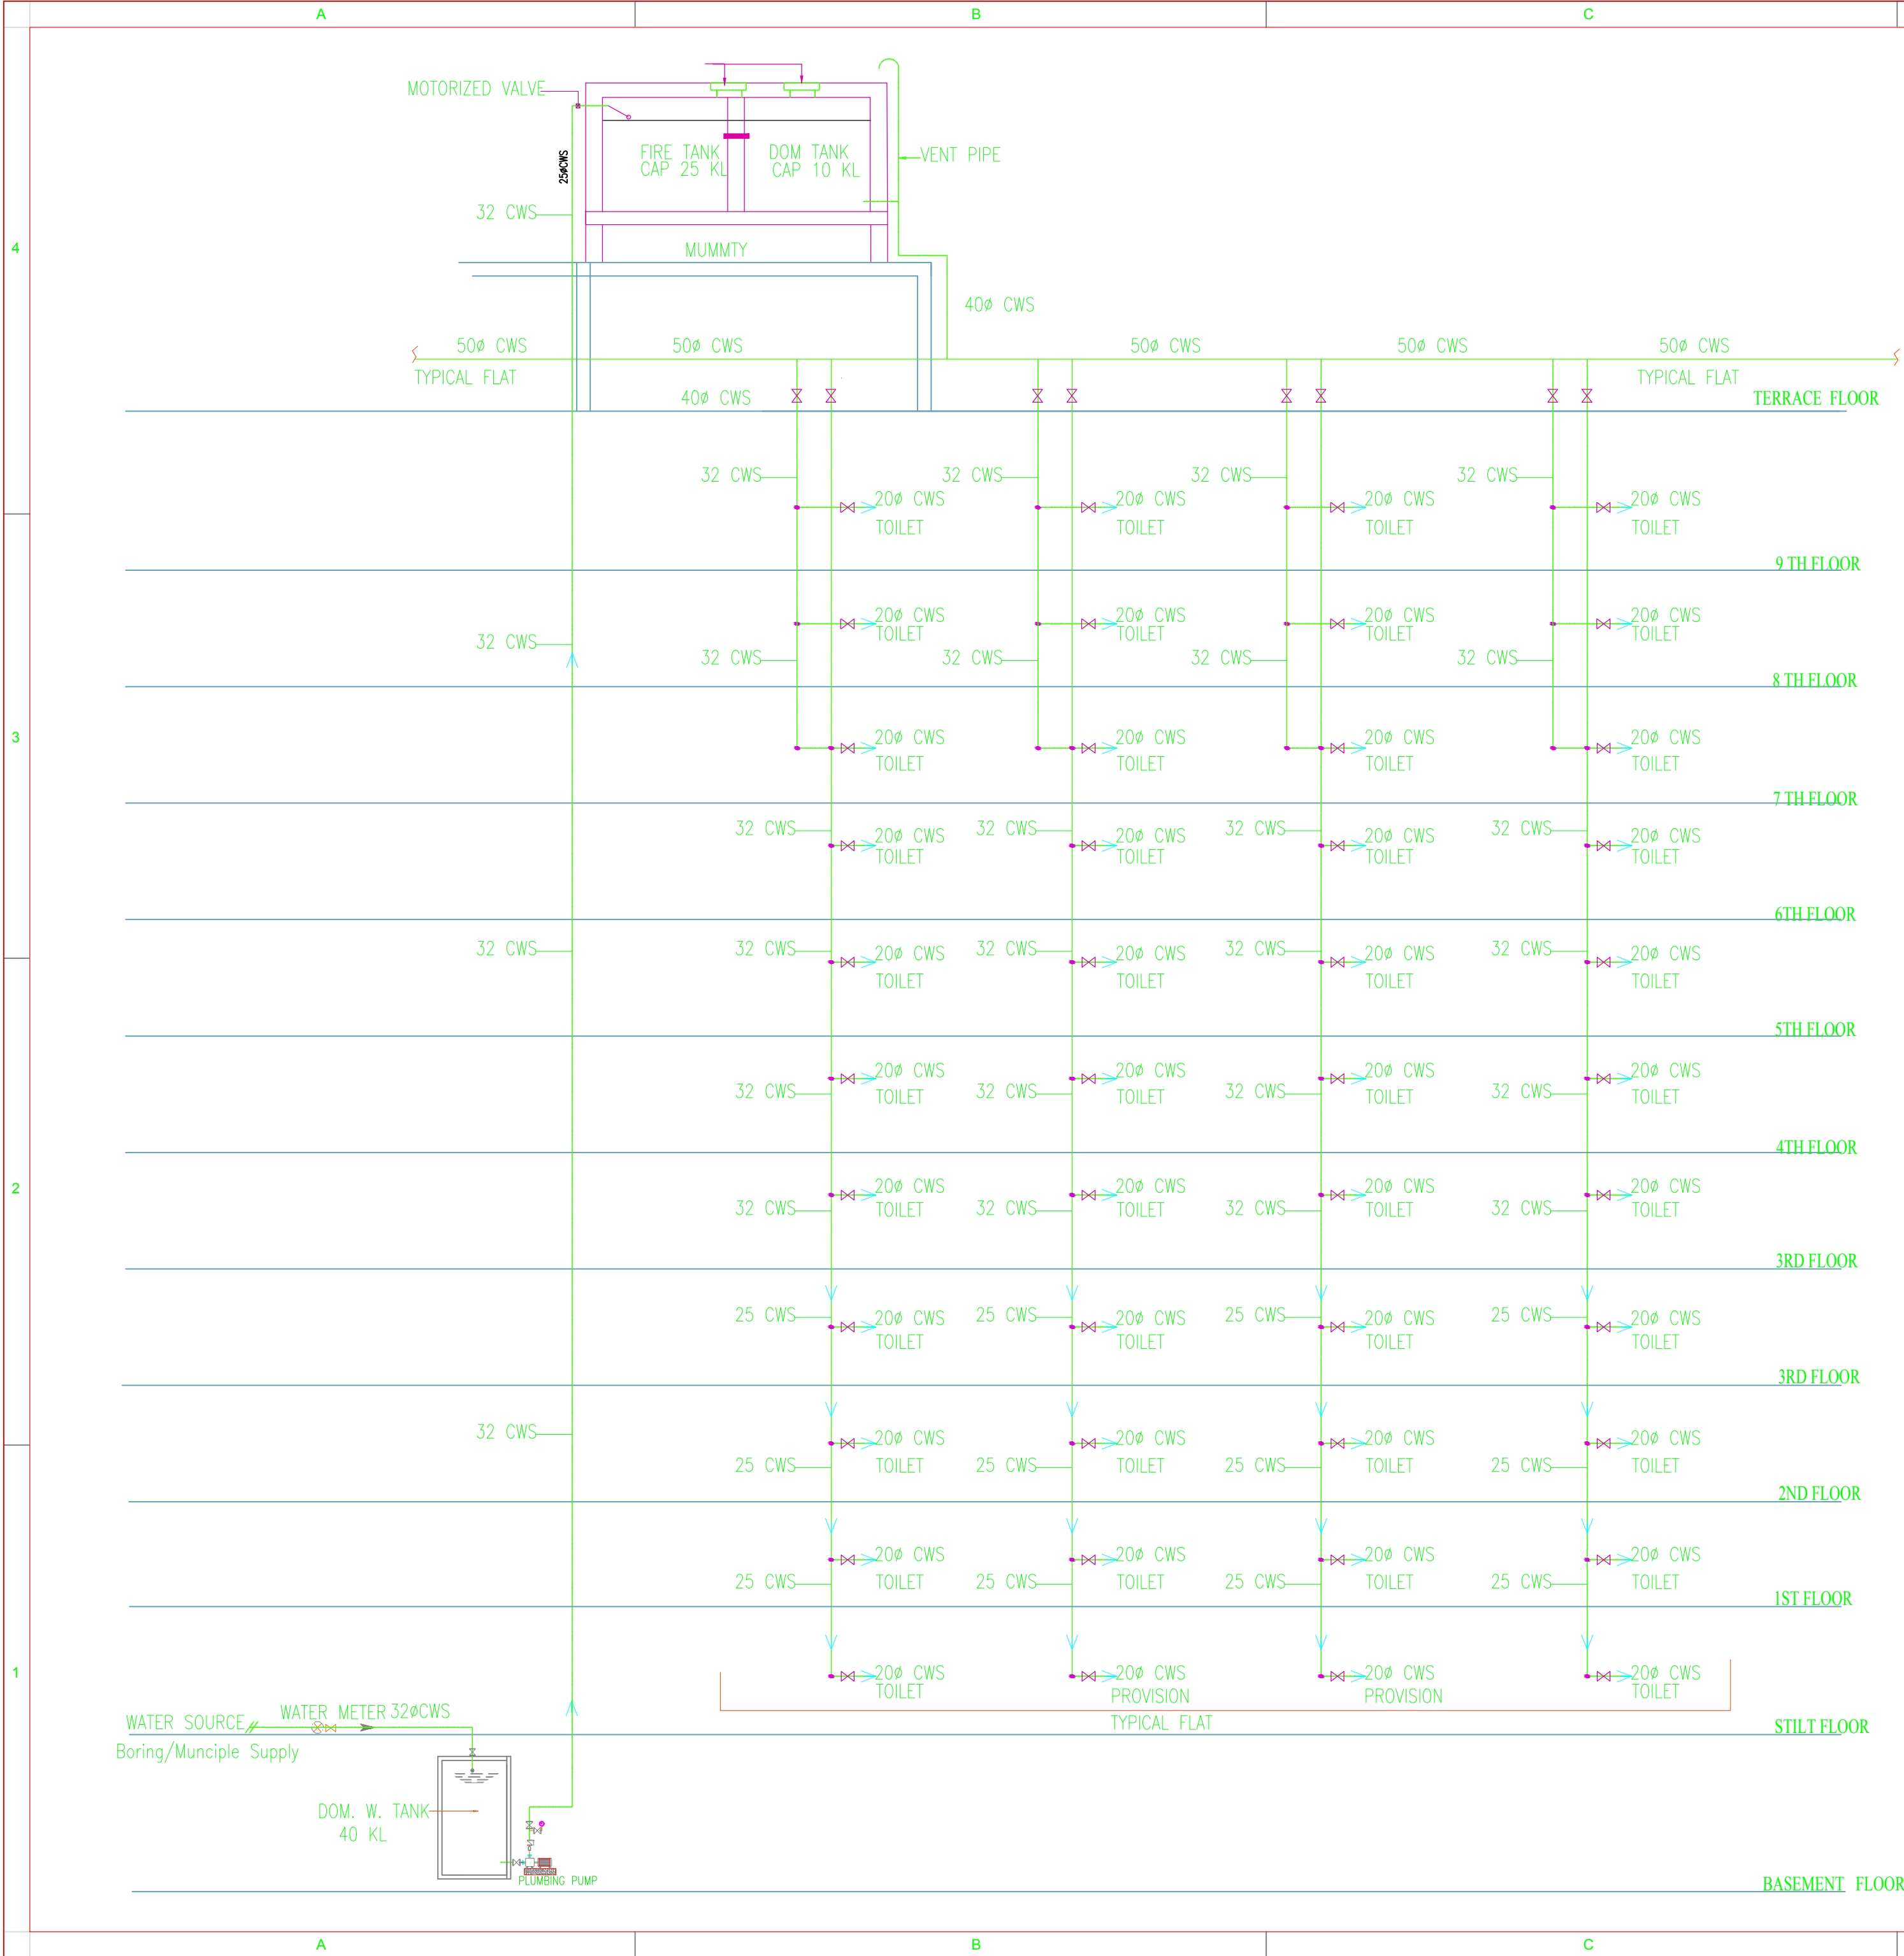

DESCRIPTION	SYMBOL
110 OD uPVC SOIL PIPE	①
110 OD uPVC WASTE PIPE	②
DOMESTIC WATER D/N PIPE AS PER SCHEMATIC DIAGRAM	③
160 OD RAIN WATER PIPE	Ⓡ
40 MM DIA DOMESTIC RISER PIPE	⑥
75 OD BALCONY WASTE PIPE	ⓓ
FLOOR TRAP	■ FT
FLOOR DRAIN	■ FD
CLEANOUT PLUG	⊗ COP
SEWER LINE	— — — — —
STORM WATER LINE	— — — — —
DOMESTIC WATER SUPPLY LINE	— — — — —

S.NO.	DESCRIPTION	SIZE
1.	PIPE DIA FROM WC TO HORIZONTAL STACK	110 OD
2.	PIPE DIA FROM FT TO HORIZONTAL STACK	110 OD
3.	PIPE DIA FROM FD TO FT	63 OD
4.	PIPE DIA FROM WB TO FD AND FT	40 OD

- NOTES:-
- ALL PIPE DIAMETERS ARE IN MM.
 - THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTURAL AND STRUCTURAL DRAWINGS.
 - MANHOLES SHALL BE CONSTRUCTED AS PER STANDARD DETAILS.
 - SOIL,WASTE & VENT PIPE WORK :
SOIL,WASTE & VENT PIPE WORK SHALL BE CARRIED OUT IN uPVC PIPE AND FITTINGS TYPE-B CONFORMING TO IS:13592
 - ALL HORIZONTAL SOIL AND WASTE PIPES SHALL BE LAID TO A SLOPE NOT FLATTER THAN 1:50 AND NOT STEEPER THAN 1:10 UNLESS SPECIFIED OTHERWISE
 - WATER SUPPLY PIPE WORK :
WATER SUPPLY PIPE WORK SHALL BE CARRIED OUT IN CPVC (SDR-11) CONFORMING TO ASTM STANDARDS. ALL PIPE FITTINGS SHALL BE OF CPVC OF CLASS SAME AS PIPE CONFORMING TO ASTM STANDARDS SUTABLE FOR SOLVENT CEMENT JOINTS AS PER MFR.
 - NO PIPE WORK SHALL BE CONCEALED IN WALLS OR BURIED IN FLOORS WITHOUT BEING SUBJECTED TO WATER TESTING AS PER THE DIRECTION OF THE SITE ENGINEER.
 - ALL WATER SUPPLY PIPES IN TOILETS SHALL RUN AT SKIRTING LEVEL UNLESS SPECIFIED OTHERWISE. NO WATER SUPPLY SHALL BE BURIED IN THE TOILET FLOOR
 - WATER INLETS AND WASTE OUTLETS FROM SANITARYWARE SHALL BE ARRSANGED TO SUIT REQUIREMENTS OF SELECTED MAKES AND MODELS.
 - ALL STONEWARE PIPES SHALL BE ENCASED IN 150 MM. THICK 1:5:10 CEMENT CONCRETE ALL AROUND.
 - FLOOR TRAPS:
ALL FLOOR TRAPS SHALL BE FORMED OF 100X100 MM. DIA 'S' TRAP WITH 110 MM. DIA UPVC PIPE EXTENSION PIECE FOR SIDE INLETS.
 - FLOOR DRAIN:
DRAIN POINTS SHALL BE FORMED OF 75X75 MM. DIA UPVC ELBOW WITH 75 MM. DIA C.P. GRATING WITH FRAME.
 - WASTE PIPES:
ALL WASTE PIPE WORK FROM WASH BASINS,SINKS,URINALS AND DRAIN POINTS SHALL BE IN UPVC PIPES AND FITTINGS OF 8KG/CM PRESSURE RATING.

ANVAYA associates
W-45, First Floor, wood stock,
Gurgaon - 120019

PRISTINE IDEAS
40/221, Lower Ground Floor, C.R. park,
New Delhi - 110019

MEP BUILDDESIGN
H.No-5, Roshan Garden-II, Kakrola Road,
Najafgarh, New Delhi - 110043

SAR Friends Builders - AGRA

Bhadhawar Residency
- Residential Tower

Plumbing Drawings

WATER SUPPLY - SLD

1:100
25/06/2018
RAVI
P.ARYA
A0