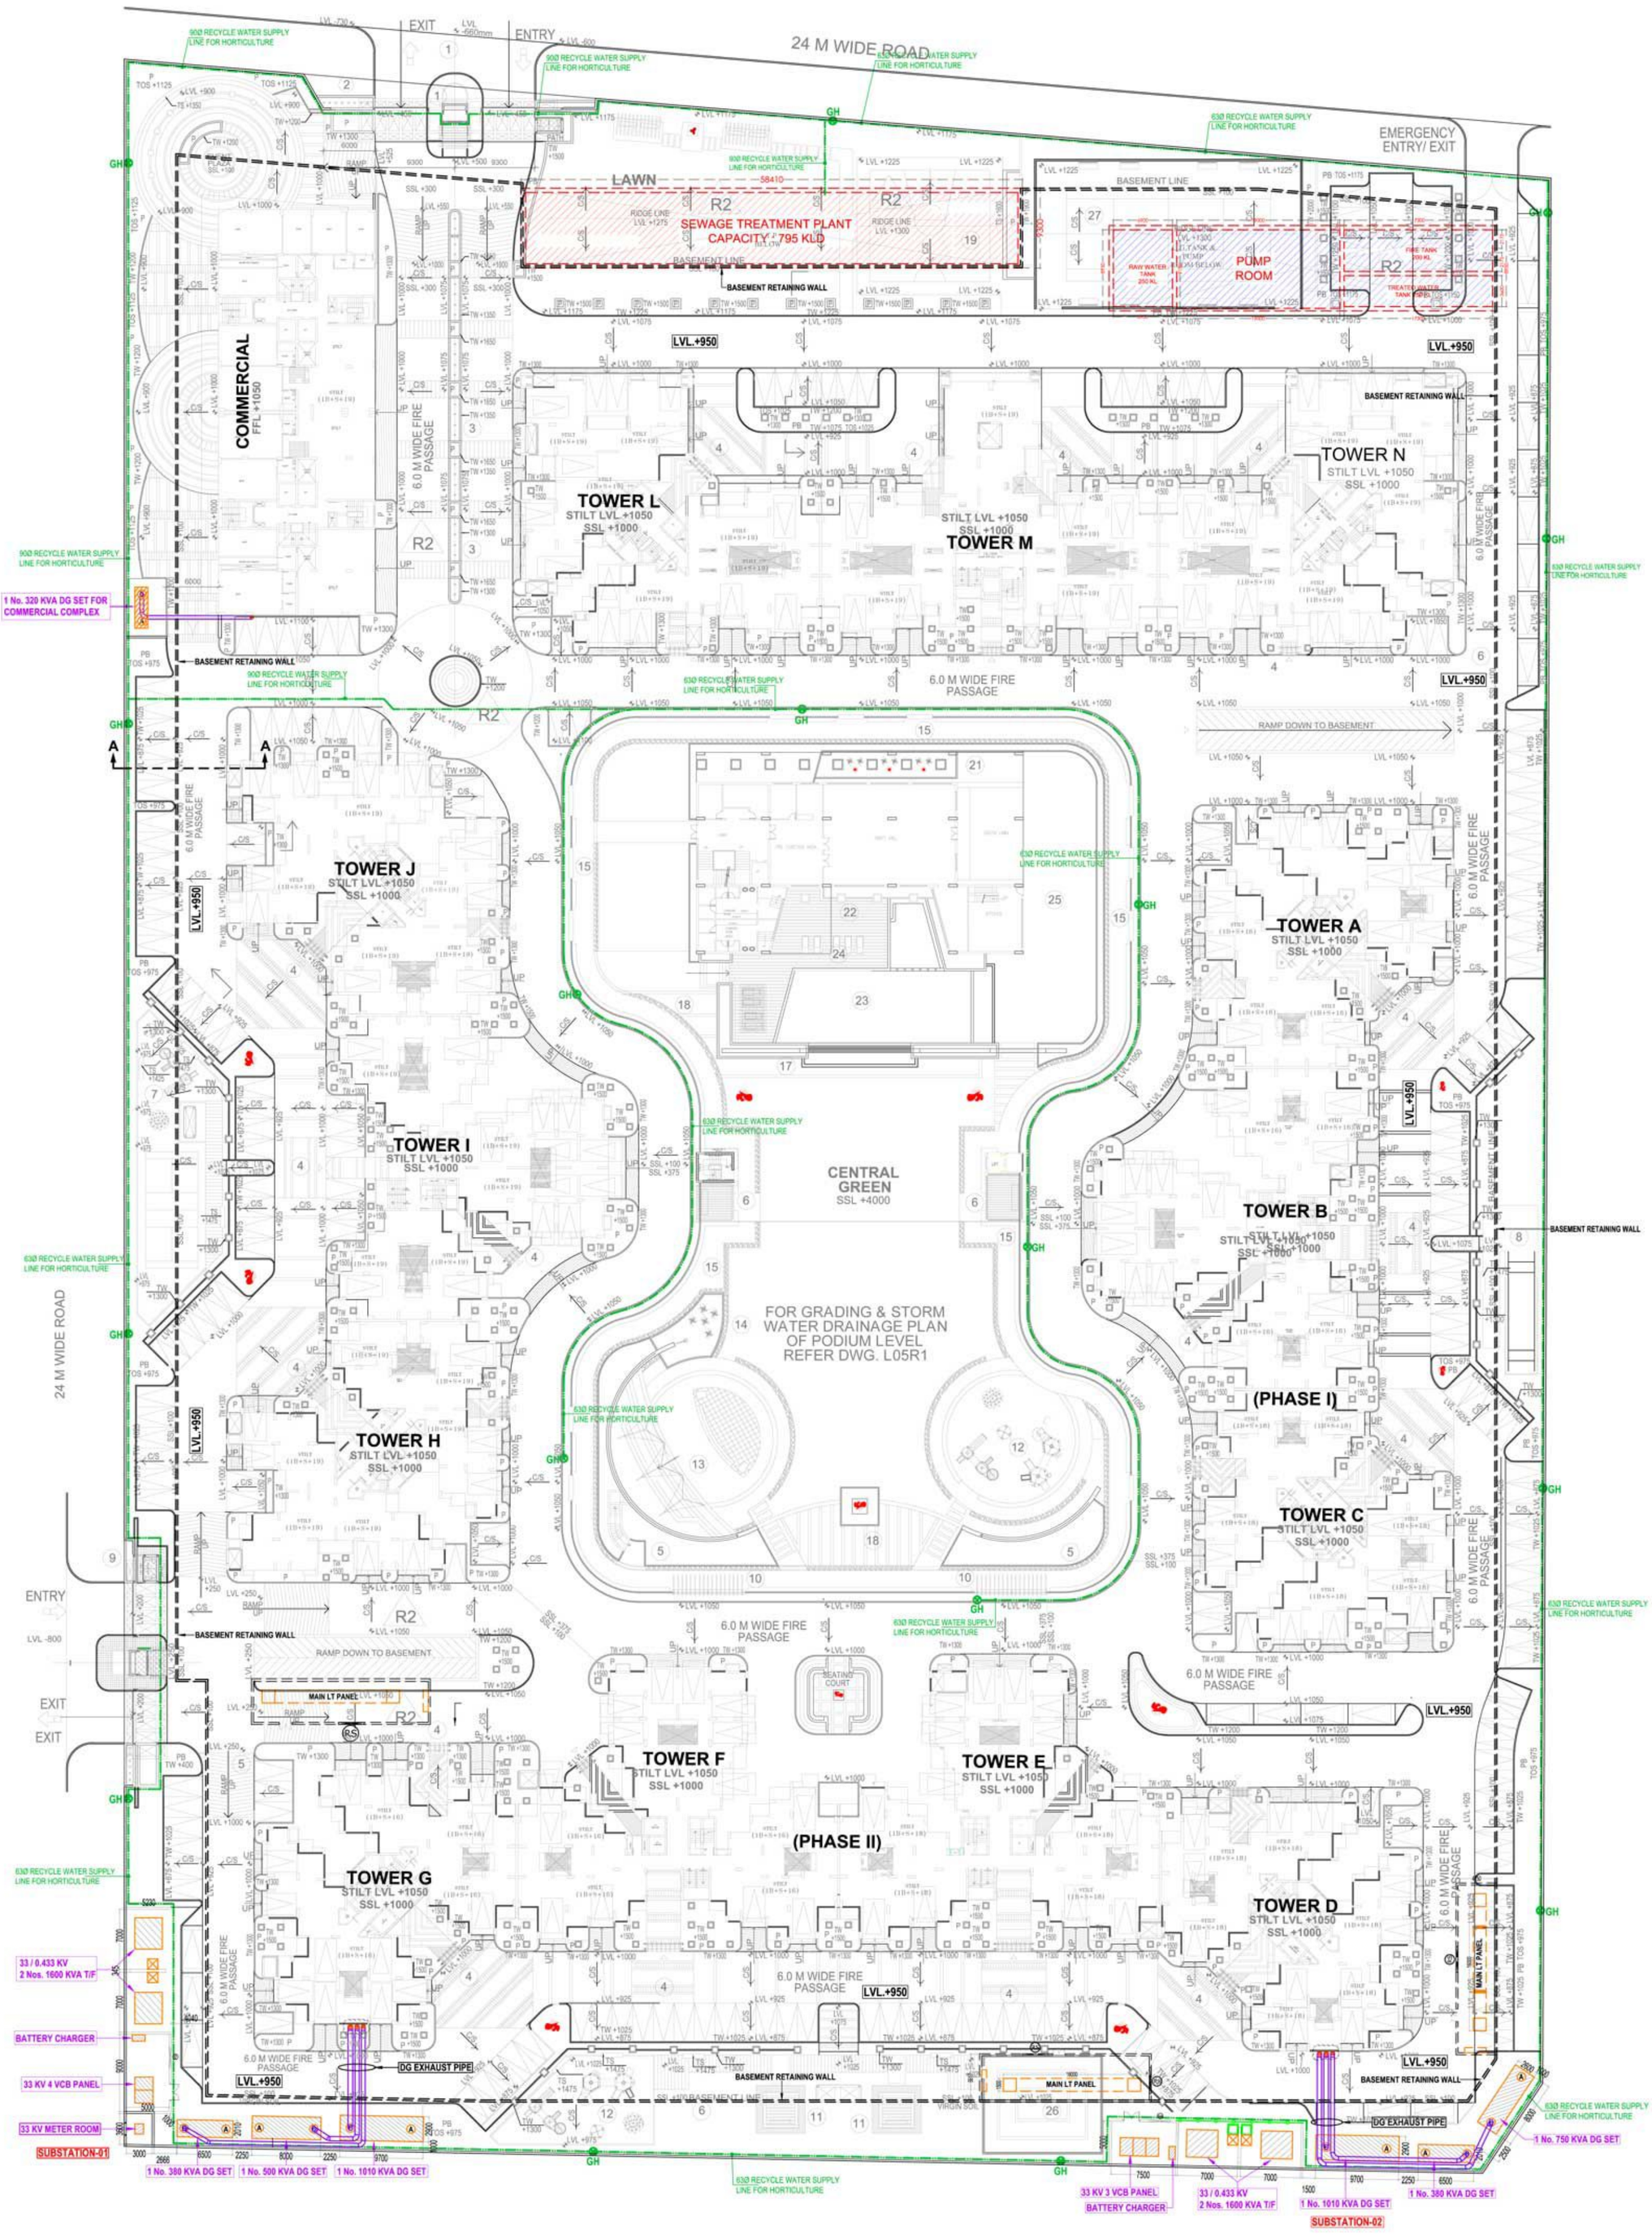

LEGEND :

S. No.	SYMBOL	DESCRIPTION
1.		RECYCLED WATER SUPPLY PIPE LINE.
2.	GH	GARDEN HYDRANT
3.		MASONRY CHAMBER FOR ISOLATING VALVE
4.		BASEMENT RETAINING WALL

NOTES : WATER SUPPLY

1. THE DEPTH OF RECYCLE WATER SUPPLY MAIN SHALL BE -1000 MM
2. THE DEPTH OF RISING MAIN SHALL BE - 1000 MM
3. PIPE MATERIAL FOR EXTERNAL WATER SUPPLY - RECYCLE / TUBE WELL RISING MAIN / MUNICIPAL LINE SHALL BE HDPE (PE100) PN8
4. FIRE WATER SUPPLY LINE TO BE IN M.S. PIPE CLASS 'C' HEAVY DUTY AS PER IS: 1239 UPTO 150 Ø

project
PROPOSED ARIHANT ARDEN AT
PLOT NO.-GH-O7,SECTOR- 01,GREATER NOIDA.

title
LAYOUT PLAN

subtitle
EXTERNAL WATER SUPPLY SYSTEM

drawing released for
- ☐ APPROVAL
- ☐ ADVANCE COPY
- ☐ SUBMISSION
- ■ CONSTRUCTION

drg. no. ARDEN / ES / P - 04
scale 1 : 400
date December 2014
drawn by Jagdish
designed by Nitesh Kuamr
checked by Anand Havelia

architects
DEEPAK MEHTA & ASSOCIATES
ARCHITECTS, PLANNERS, VALUERS, LANDSCAPE & INTERIORS
PLOT NO. 16 ABHISHEK PLAZA L.S.C. MAYUR VIHAR PH II DELHI 91
PH: 65272180 TELEFAX: 22770180

services consultant
Consummate Engineering Services (P) Ltd.
cespl
Noida Office : B - 67, Sector - 67, Noida - 201 301
Tel : (0120) 2593500 (30 Lines)
Lko. Office : R 006, Rohtas Plumeria, Gomti Nagar, Lucknow
Tel : (0522) 6515455
e mail : mail@cespl.in, website : www.cespl.in