


45.00 meter wide proposed master plan road

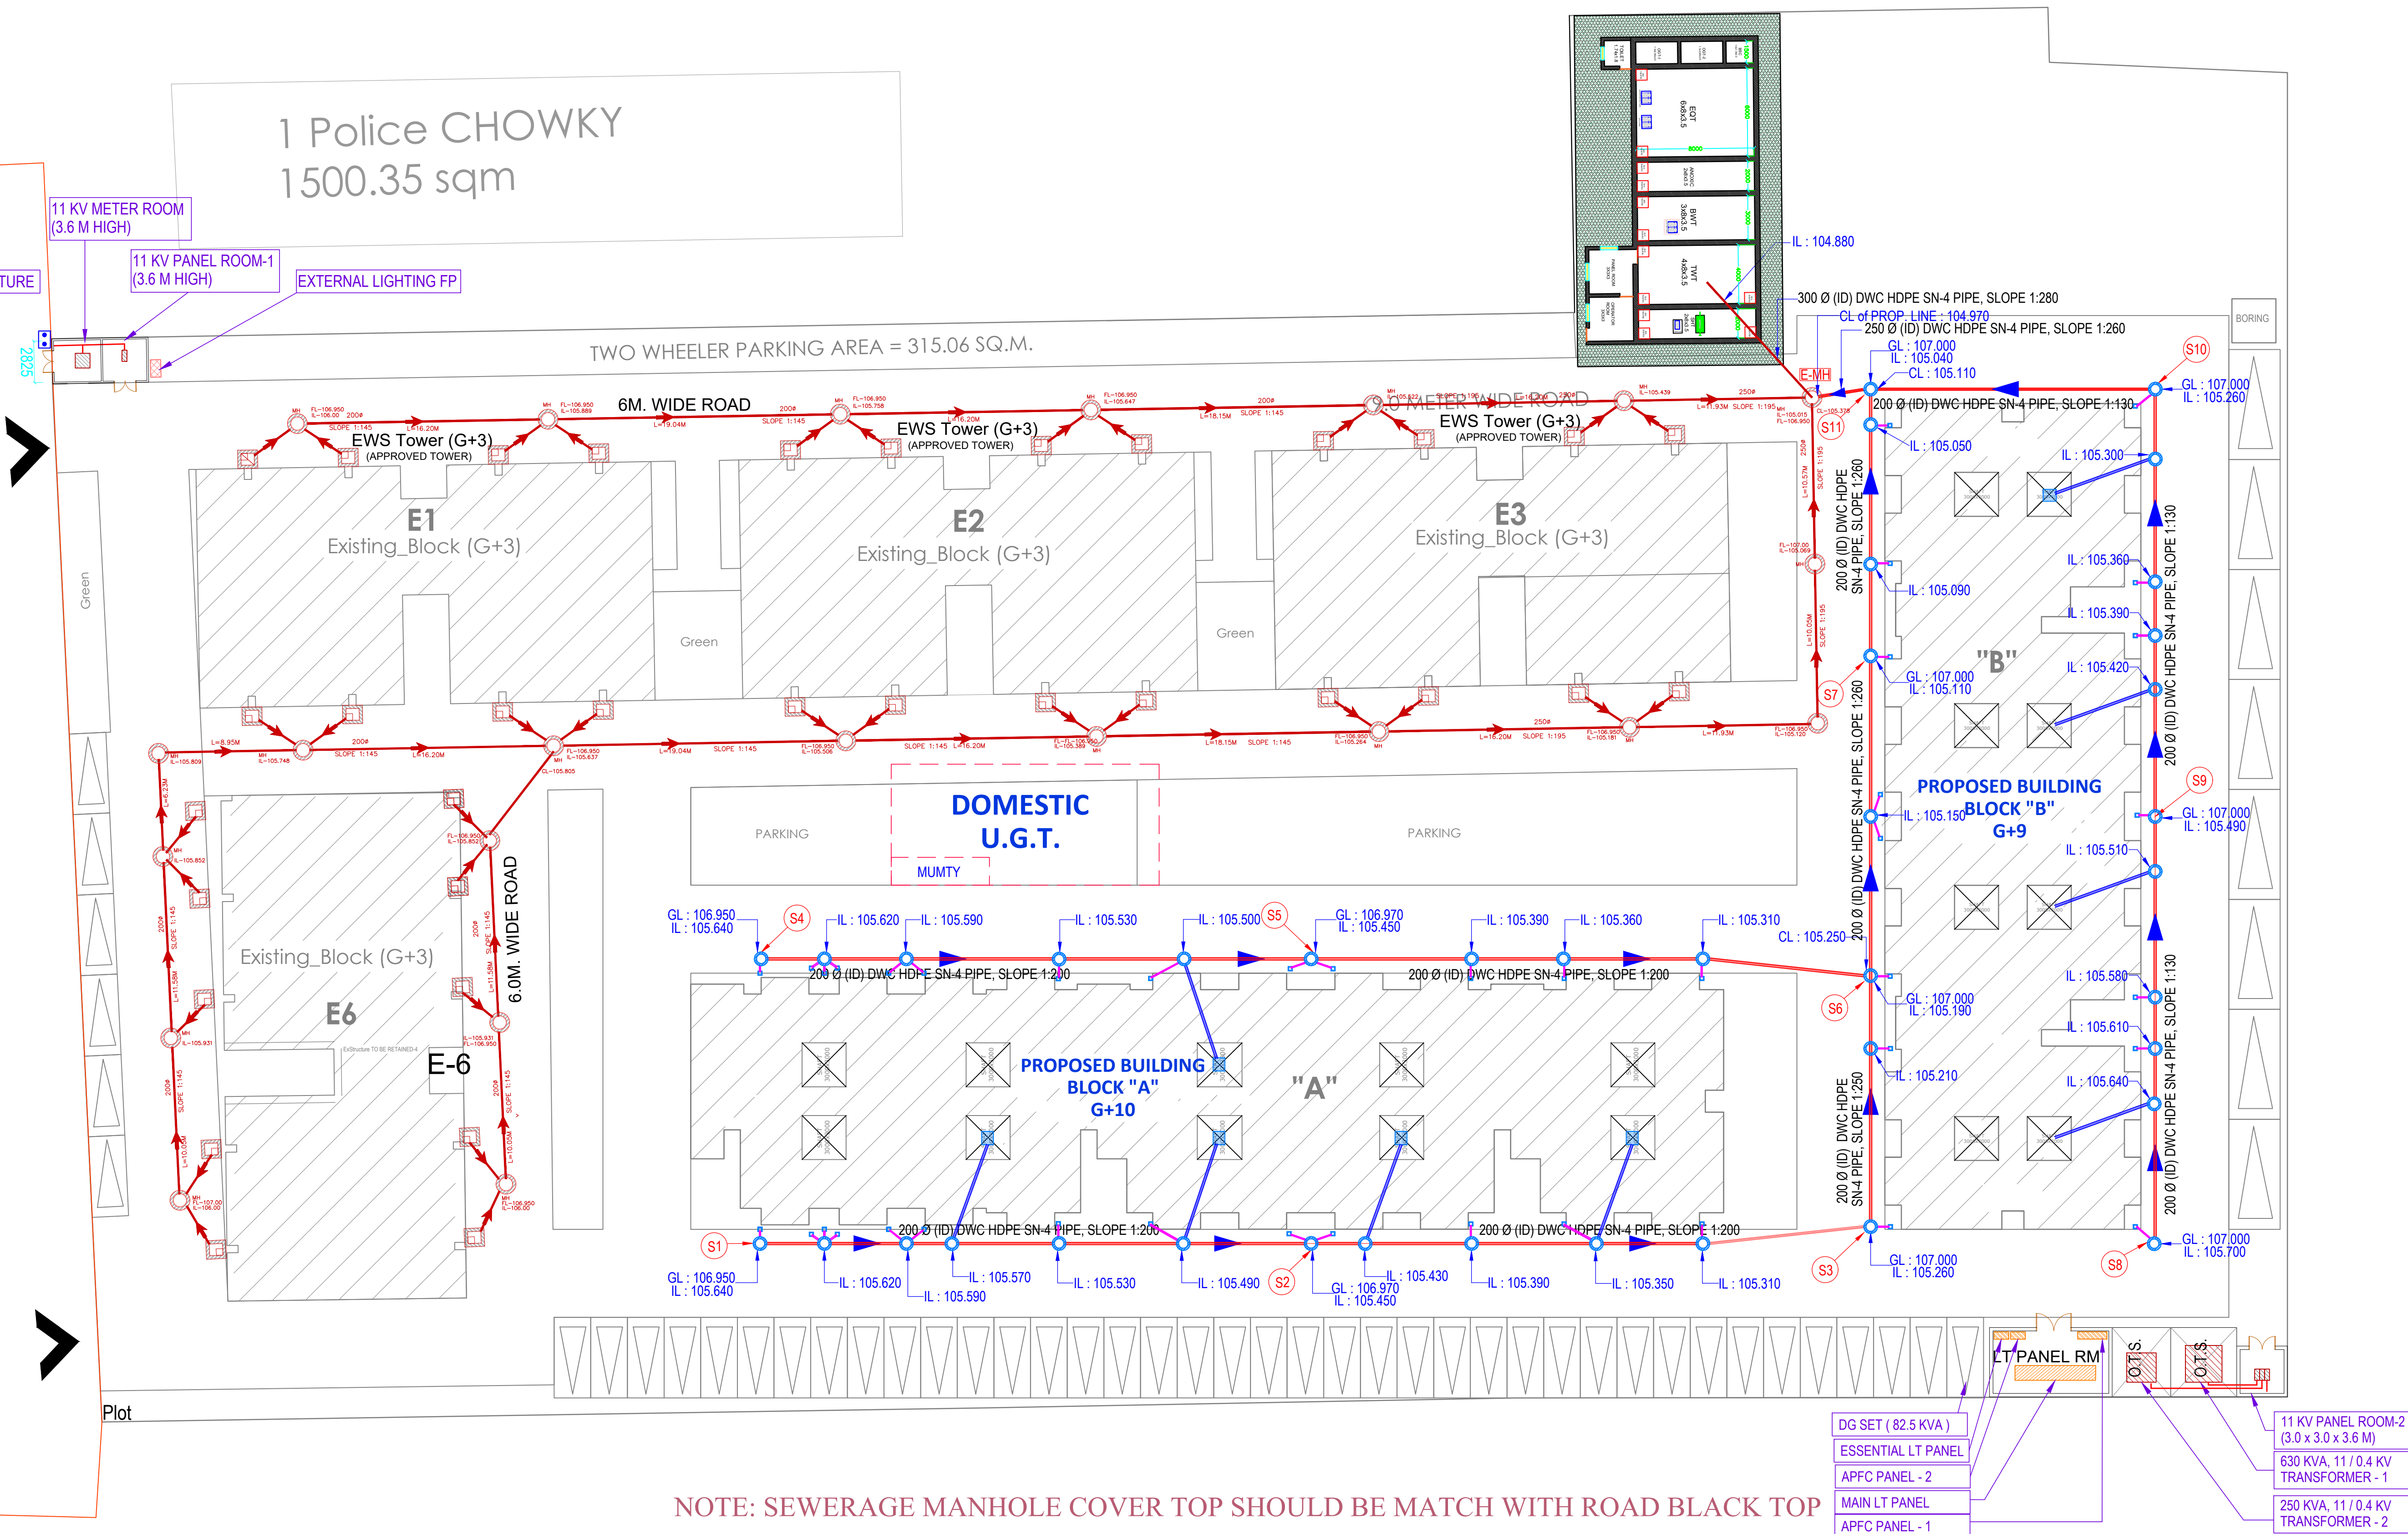

NOTE: SEWERAGE MANHOLE COVER TOP SHOULD BE MATCH WITH ROAD BLACK TOP

NOTES :

- THE SIZE OF MANHOLE SHALL BE AS UNDER (INNER SIZES)
 - UPTO 1670 M.M. DEEP 910 M.M. DIA.
 - 1680 TO 2290 M.M. DEEP 1220 M.M. DIA.
 - 2300 M.M. & ABOVE 1520 M.M. DIA.
- M. S. RUNGS SHALL BE PROVIDED IN EACH MANHOLE WHICH IS DEEPER THAN 800 M.M.
- THE LEVELS OF SEWER LINES HAS BEEN WORKED OUT ON THE BASIS OF CERTAIN GROUND LEVEL AND FOR CERTAIN PIPE LENGTHS BETWEEN TWO MANHOLES. THE INVERT LEVELS HAS TO BE STRICTLY FOLLOWED.
- FOR ANY DESCRIENCY / OMISSION THE MATTER REFER TO THE CONSULTANTS BEFORE EXECUTION.


NOTES :

- MANHOLE SHALL BE PROVIDED AT FOLLOWING PLACES :-
 - AT THE START OF EACH SEWER LINE.
 - AT EVERY JUNCTION AND POSITION WHERE THERE IS CHANGE OF SIZE, GRADIENT AND ALIGNMENT.
 - AT NOT MORE THAN 30 METER INTERVAL IN STRAIGHT LENGTH.
- WHERE THE DIAMETER OF PIPE IS INCREASED THE CROWN OF THE PIPE SHALL BE FIXED AT THE SAME LEVEL AND NECESSARY SLOPE SHALL BE GIVEN IN THE INVERT OF THE MANHOLE CHAMBER.
- THE STRUCTURAL DESIGN OF MANHOLES / PIPE BEDDING HAS TO BE DONE FOR LOCAL FIELD CONDITIONS SUCH AS FILLED UP SOIL / BLACK COTTON SOIL / HIGH SUB SOIL CONDITIONS.

NOTES :

- THIS DRAWING SHALL BE READ ALONG WITH THE GROUND FLOOR PLAN OF RESPECTIVE BUILDING FOR EXACT LOCATION OF APPUTENANCES / MAN HOLES ETC.
- SEWER LINE UNDER THE ROAD SHALL BE ENCASED WITH 150 TH, PCC 1:2:4 ALLROUND.
- MANHOLE COVER SHOULD BE FINISHED WITH FINISHED FORMATION LEVEL AS PER LANDSCAPE DRAWING.
- THIS DRAWING SHALL BE COORDINATED WITH OTHER DRAWING i.e. ARCHITECTURE, STRUCTURAL, ELECTRICAL, LANDSCAPE & OTHER RELEVANT DRAWING.
- SEWER LINE AROUND THE PROPOSED BLOCK ie A & B HAS BEEN TAKEN IN THIS PHASE. SEWER LINE AROUND THE EXISTING BLOCK IS ALREADY LAID.

North



PROJECT
**PROPOSED/EXISTING E.W.S.&
L.I.G.
GROUP HOUSING**
EMAAR MGF LAND Ltd.
AT
"GOMTI GREENS" TOWNSHIP
KH. NO. 167,168,169 & 174
(PART)
LUCKNOW

EXTERNAL SEWERAGE
NETWORK LAYOUT

services consultant

**Shiv Sunder Constructions &
Consultants (P) Ltd.**
5/763, Vikas Khand,Gomti Nagar,
Lucknow.
Mob No -9415195823 / 9450375372

VASTULIPI
PUNIT SRIVASTAV
ARCHITECTS & INTERIOR DESIGNERS
VASTU SHASTRA CONSULTANTS
5/171, VIRAM KHAND, GOMTI NAGAR,
LUCKNOW
PH. NO.- 9415418151, 9935590999
email - vastulipi@gmail.com
web- site - www.vastulipi.com