


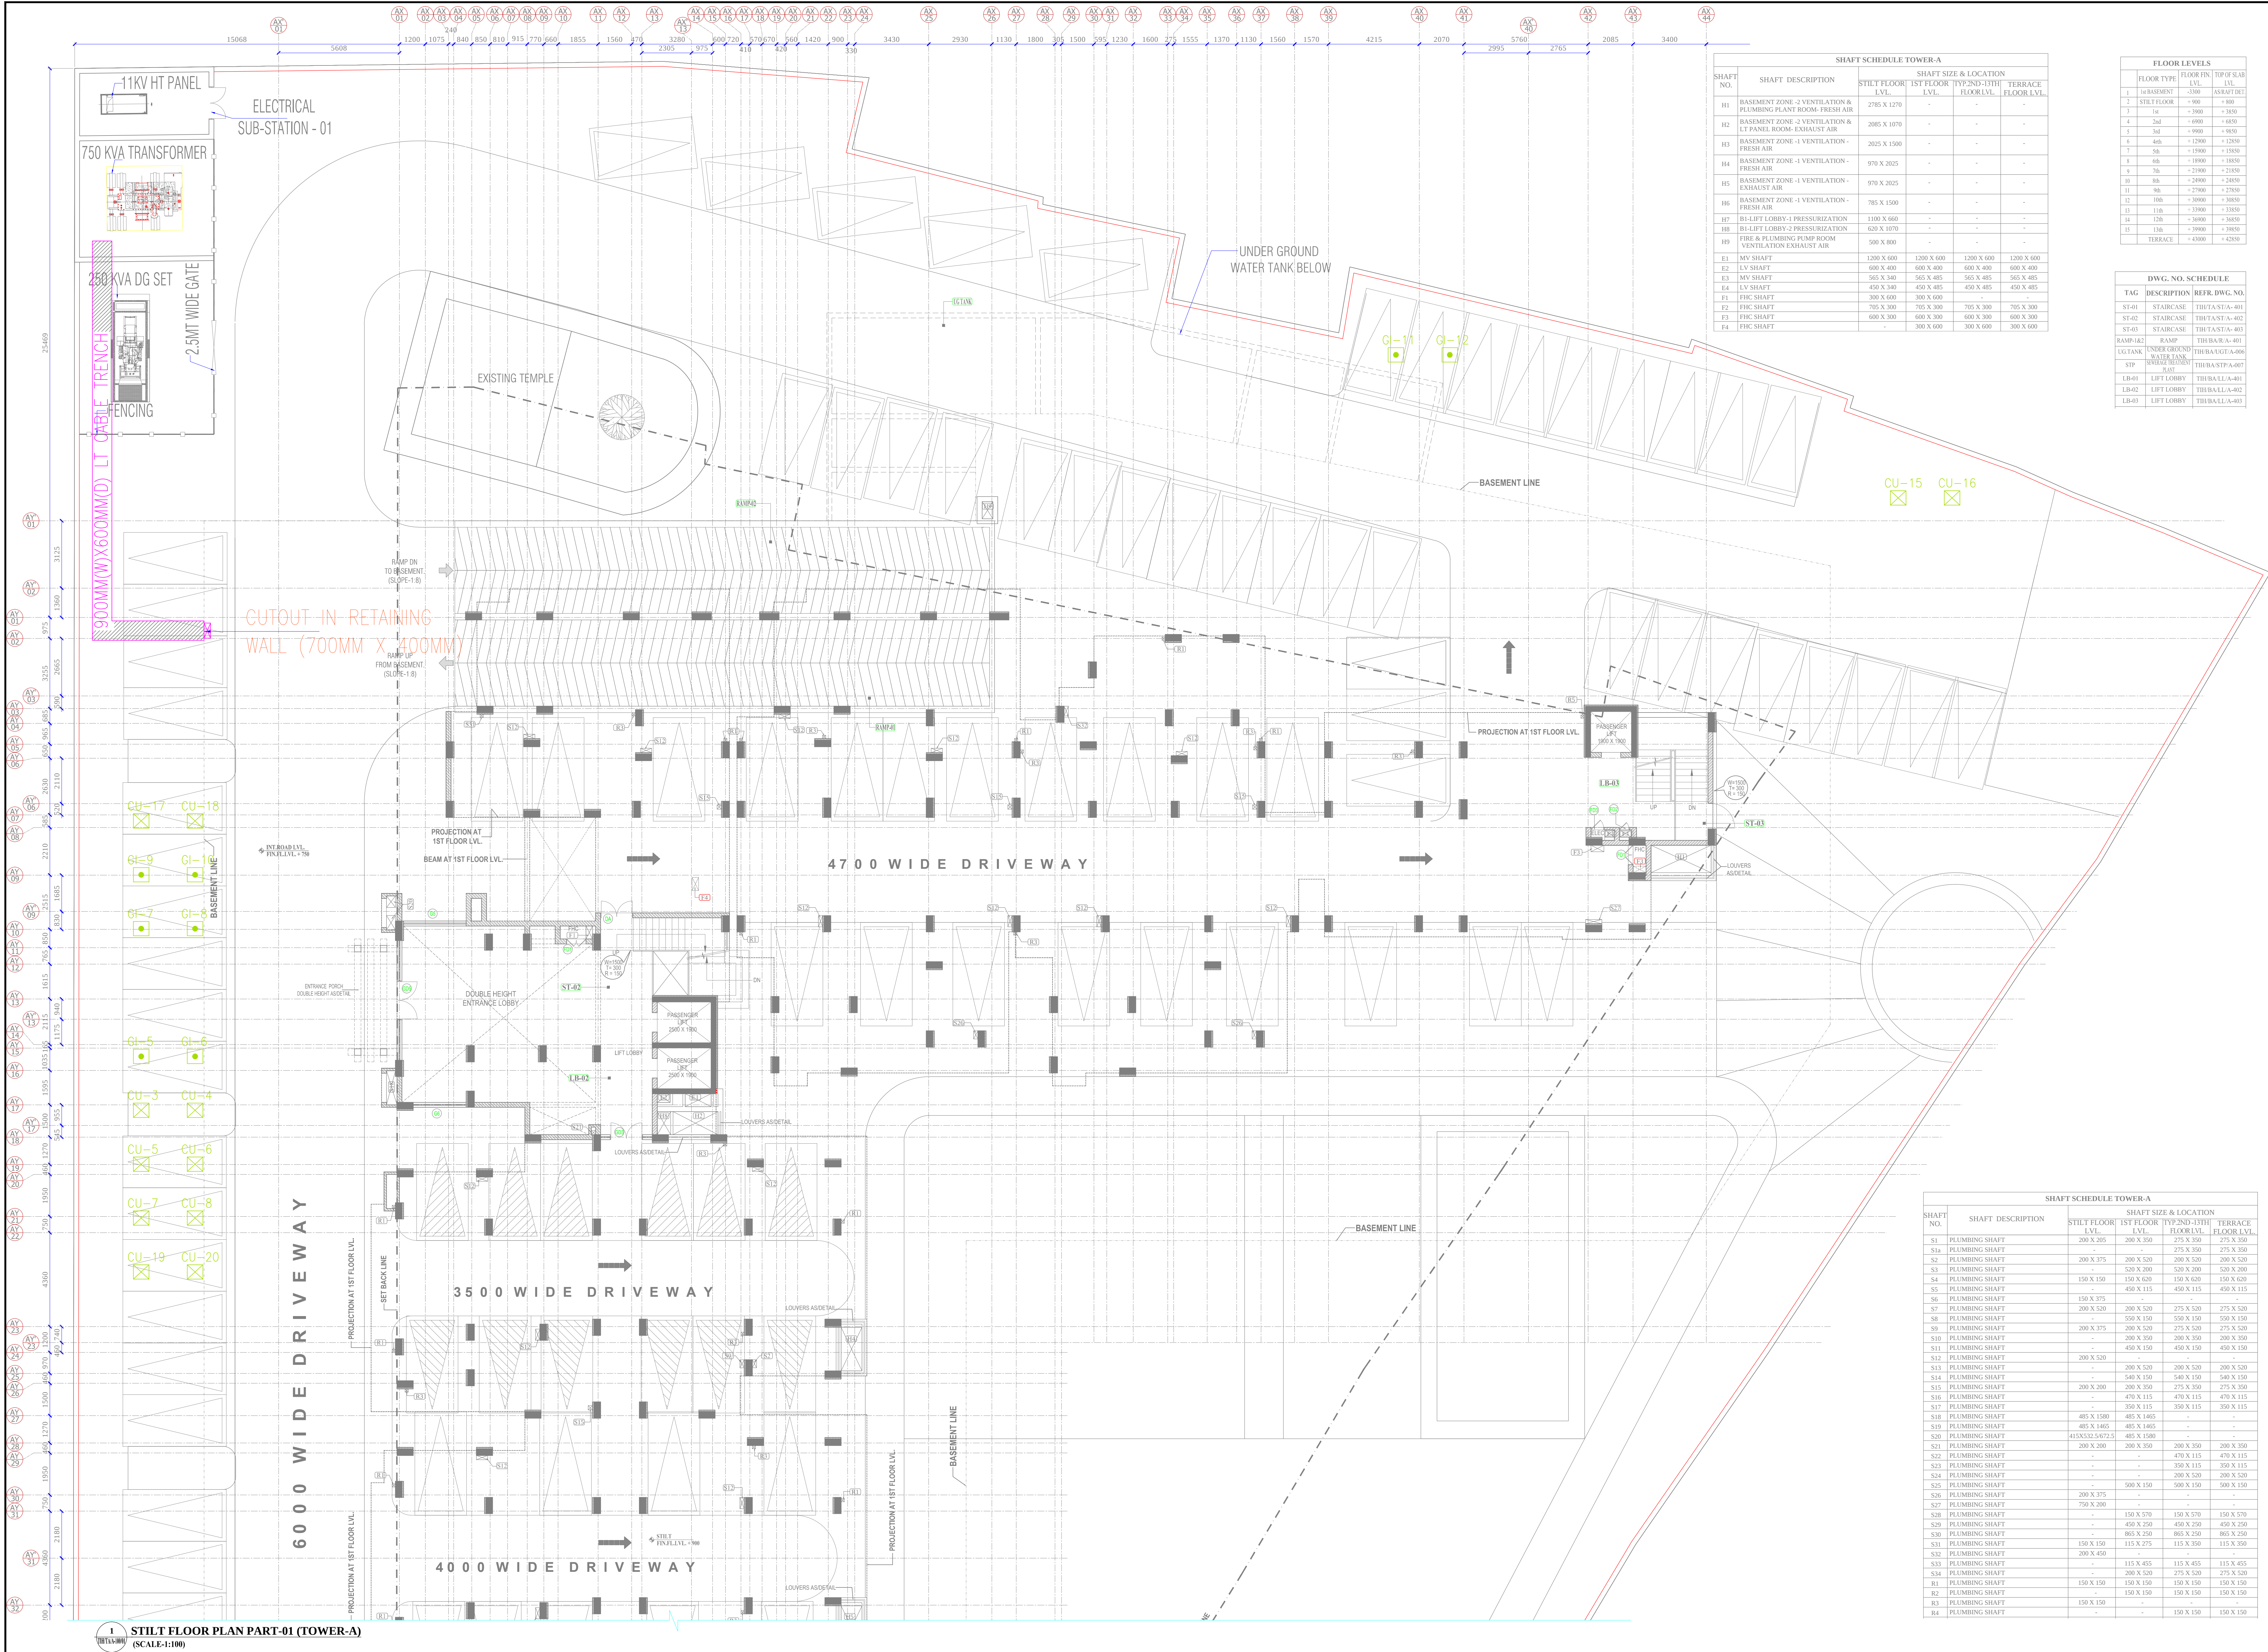

SHAFT SCHEDULE TOWER-A						
SHAFT NO.	SHAFT DESCRIPTION	SHAFT SIZE & LOCATION				
		STILT FLOOR LVL.	1ST FLOOR LVL.	TYPEND-13TH FLOOR LVL.	TERRACE FLOOR LVL.	TERRACE FLOOR LVL.
H1	BASEMENT ZONE-2 VENTILATION & PLUMBING PLANT ROOM FRESH AIR	2785 X 1270	-	-	-	-
H2	BASEMENT ZONE-2 VENTILATION & PLUMBING PLANT ROOM EXHAUST AIR	2085 X 1070	-	-	-	-
H3	BASEMENT ZONE-1 VENTILATION - FRESH AIR	2025 X 1500	-	-	-	-
H4	BASEMENT ZONE-1 VENTILATION - FRESH AIR	970 X 2025	-	-	-	-
H5	BASEMENT ZONE-1 VENTILATION - EXHAUST AIR	970 X 2025	-	-	-	-
H6	BASEMENT ZONE-1 VENTILATION - FRESH AIR	785 X 1500	-	-	-	-
H7	BU-LIFT LOBBY-2 PRESSURIZATION	1100 X 660	-	-	-	-
H8	BU-LIFT LOBBY-2 PRESSURIZATION	620 X 1070	-	-	-	-
H9	FIRE & PLUMBING PUMP ROOM VENTILATION EXHAUST AIR	500 X 800	-	-	-	-
E1	MY SHAFT	1200 X 600	1200 X 600	1200 X 600	1200 X 600	1200 X 600
E2	LV SHAFT	600 X 400	600 X 400	600 X 400	600 X 400	600 X 400
E3	MY SHAFT	565 X 340	565 X 485	565 X 485	565 X 485	565 X 485
E4	LV SHAFT	400 X 340	400 X 485	400 X 485	400 X 485	400 X 485
F1	FHC SHAFT	300 X 600	300 X 600	-	-	-
F2	FHC SHAFT	705 X 300	705 X 300	705 X 300	705 X 300	705 X 300
F3	FHC SHAFT	600 X 300	600 X 300	600 X 300	600 X 300	600 X 300
F4	FHC SHAFT	-	300 X 600	300 X 600	300 X 600	300 X 600

FLOOR LEVELS			
	FLOOR TYPE	FLOOR FIN LVL	TOP OF SLAB LVL
1	1st BASEMENT	-3300	ASRAFT DET
2	STILT FLOOR	+900	+800
3	1st	+3900	+3850
4	2nd	+6900	+6850
5	3rd	+9900	+9850
6	4th	+12900	+12850
7	5th	+15900	+15850
8	6th	+18900	+18850
9	7th	+21900	+21850
10	8th	+24900	+24850
11	9th	+27900	+27850
12	10th	+30900	+30850
13	11th	+33900	+33850
14	12th	+36900	+36850
15	13th	+39900	+39850
	TERRACE	+41000	+42850