ARINEM

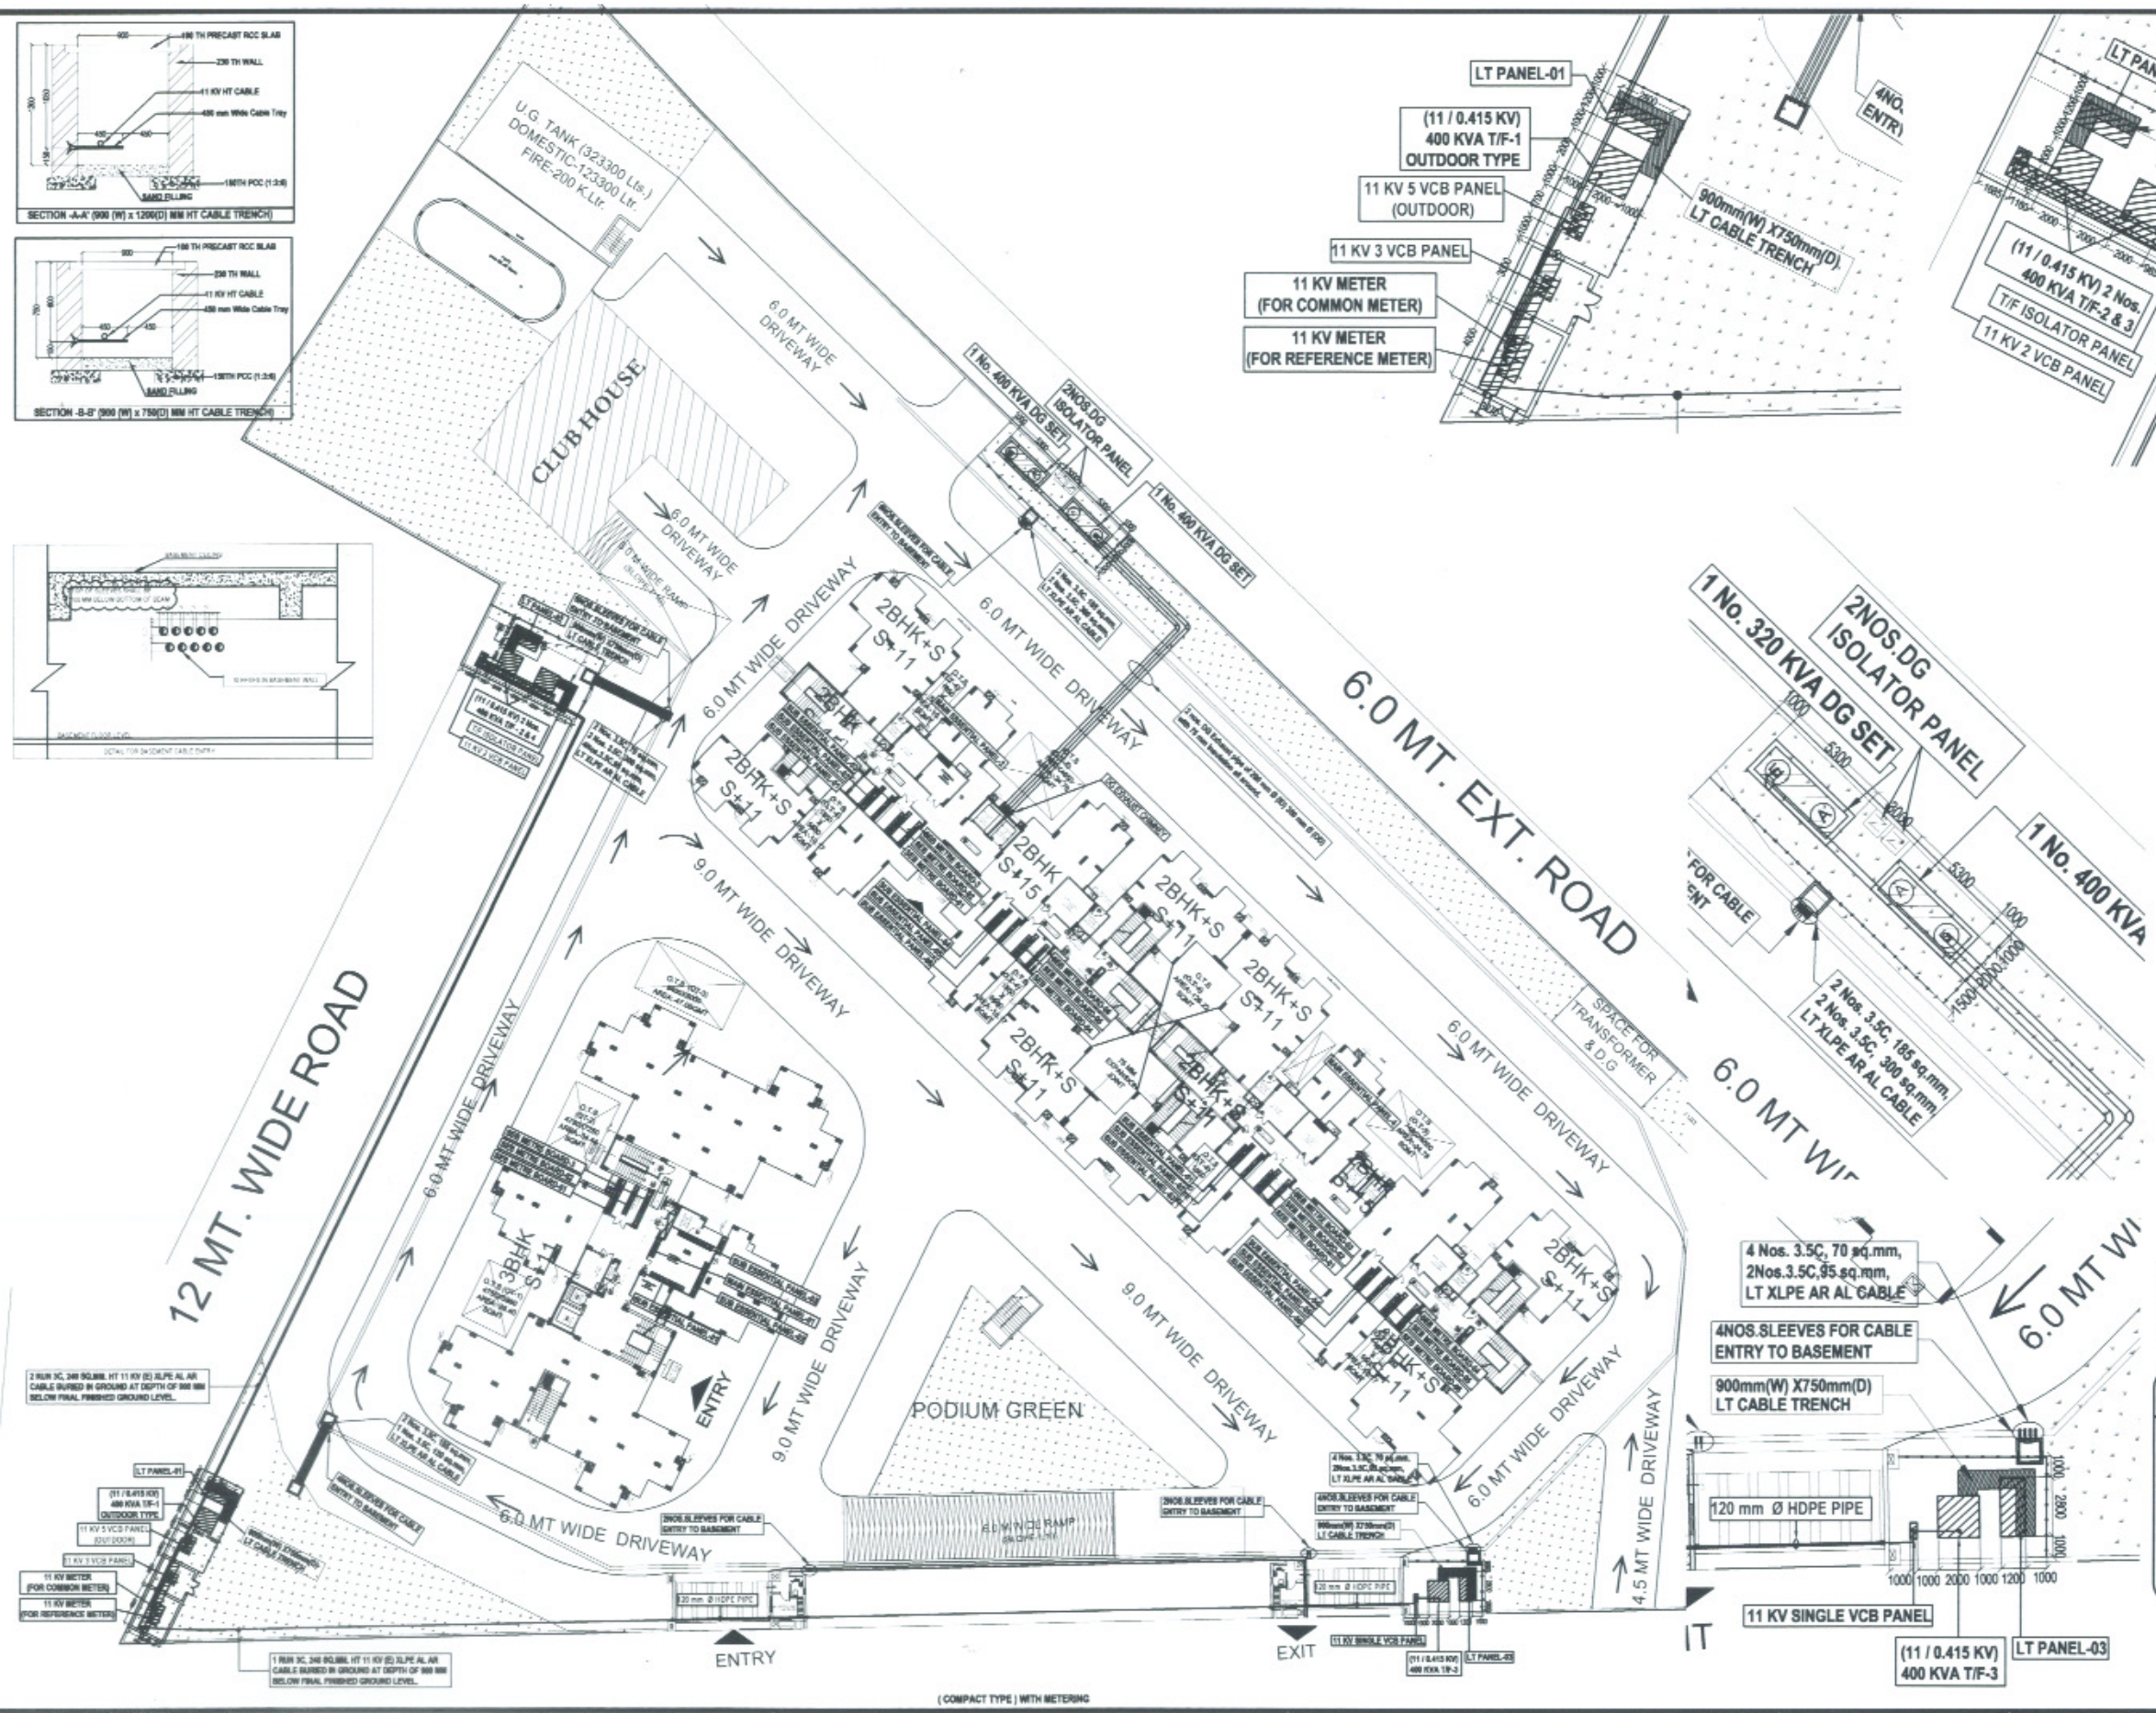

IMPORTANT NOTES :

1. VCB & DG SETS FOUNDATION SHALL BE GIVEN BY VENDOR.
2. EXACT LOCATION OF CABLE TRENCH SHALL BE FINALIZE AFTER GETTING THE DETAIL OF GLAND PLATE IN HT PANEL.

NOTES : FOR HT, LT & VCB ROOM

1) Clear height of 11 KV Meter room shall be minimum 3.6 mtr. below clear beam.
2) Plinth Level of Meter room & VCB room shall be 450 mm above final finished ground level.
3) Trench detail shall be finalized after receiving foundation detail of HT Meter Panel & 11 KV VCB Panel.
4) Ventilation is to be planned as per architecture surrounding level.

KEY PLAN:-

services consultant
Consummate Engineering Services (P) Ltd.

REV	DRAWN BY & DATE	APPROVED BY & DATE	STATUS
05			
04			
03			
02			
01			
00	Narender	Anand Havelia	RELEASED FOR EXECUTION

REF	DRAWING NO.
06	
05	
04	
03	
02	
01	

NOTES :
1. No dimensions to be scaled off the drawing.
2. Only written dimensions in Millimeters to be followed
3. Any discrepancy found in the drawing to be immediately got clarified with the Architect or his representative at site
4. All drawings are interrelated and shall be read in conjunction with other drawings

This drawing is the property of ARINEM Consultancy Services Pvt. Ltd. and is not to be reproduced, copied, handed over to a third party or used for any other purpose other than for which it has been loaned.

PROJECT TITLE: PROPOSED GROUP HOUSING FOR GANGA ENCLAVE AT AMBEDKAR PURAM YOJANA , PANKI ROAD, KANPUR.

DRAWING TITLE: ELECTRICAL DRAWING (METER ROOM LAYOUT)

DRAWING NO. 0161R-RG-01-EXE-00L03(c) REV 00

DATE	NORTH	SCALE
APR. '19		

ARCHITECTS: ARINEM CONSULTANCY SERVICES PVT. LTD.

CLIENT: AWAS EVAM VIKAS PARISHAD

CONSTRUCTION AGENCY: AASHRAY DESIGN CONSULTANTS PVT. LTD.