

वी गई अनुज्ञा स्वीकृति के दि० ०३/११/२०२१ से पाँच वर्ष के लिए मान्य होगी।




10 कंठ एवं अधिक निर्माण लागत आने पर प्राधिकरण द्वारा अनुमानित निर्माण लागत का शासननदेश के तहत से 1% लेन से का 10% भाग अधिक रूप से जमा कराया जा रहा है। धरेश लेन से का की धरेशी सीधे श्रम किया में एकीकरण करते हुए उनके यहाँ जाम करानी होगी।

श्रीने सत्यम मानचित्र का नली भाँति परीक्षण कर लिया है। मानचित्र पर 80 नगर योजना एवं विकास अधिनियम 1973 की धारा 32 समन उपविधि के अनुसार है।

जोड़ २९५/२०२०-२१
सह स्वीकृति उत्तर प्रदेश योजना और विकास अधिनियम 1973 (राष्ट्रपति अधिनियम संख्या-11-1973) की धारा 15 उपधारा 3 एवं इस विषय में सम्बन्धित नियमों/उपविधियों के अनुसार की गई है। इस स्वीकृति से आपको कोई विशेष अधिकार प्राप्त नहीं होगा। इस स्वीकृति का कोई प्रभाव सम्पत्ति सम्बन्धी किसी अधिकार पर नहीं पड़ेगा और न ही कोई कामकाज रोकट होगा।
सचिव
समुद्रा-सुन्दारन विकास प्राधिकरण, धरेशी
दिनांक ०३/११/२०२१



सीट नं० 1/3 पर चरसा सभी शर्त मान्य होगी।

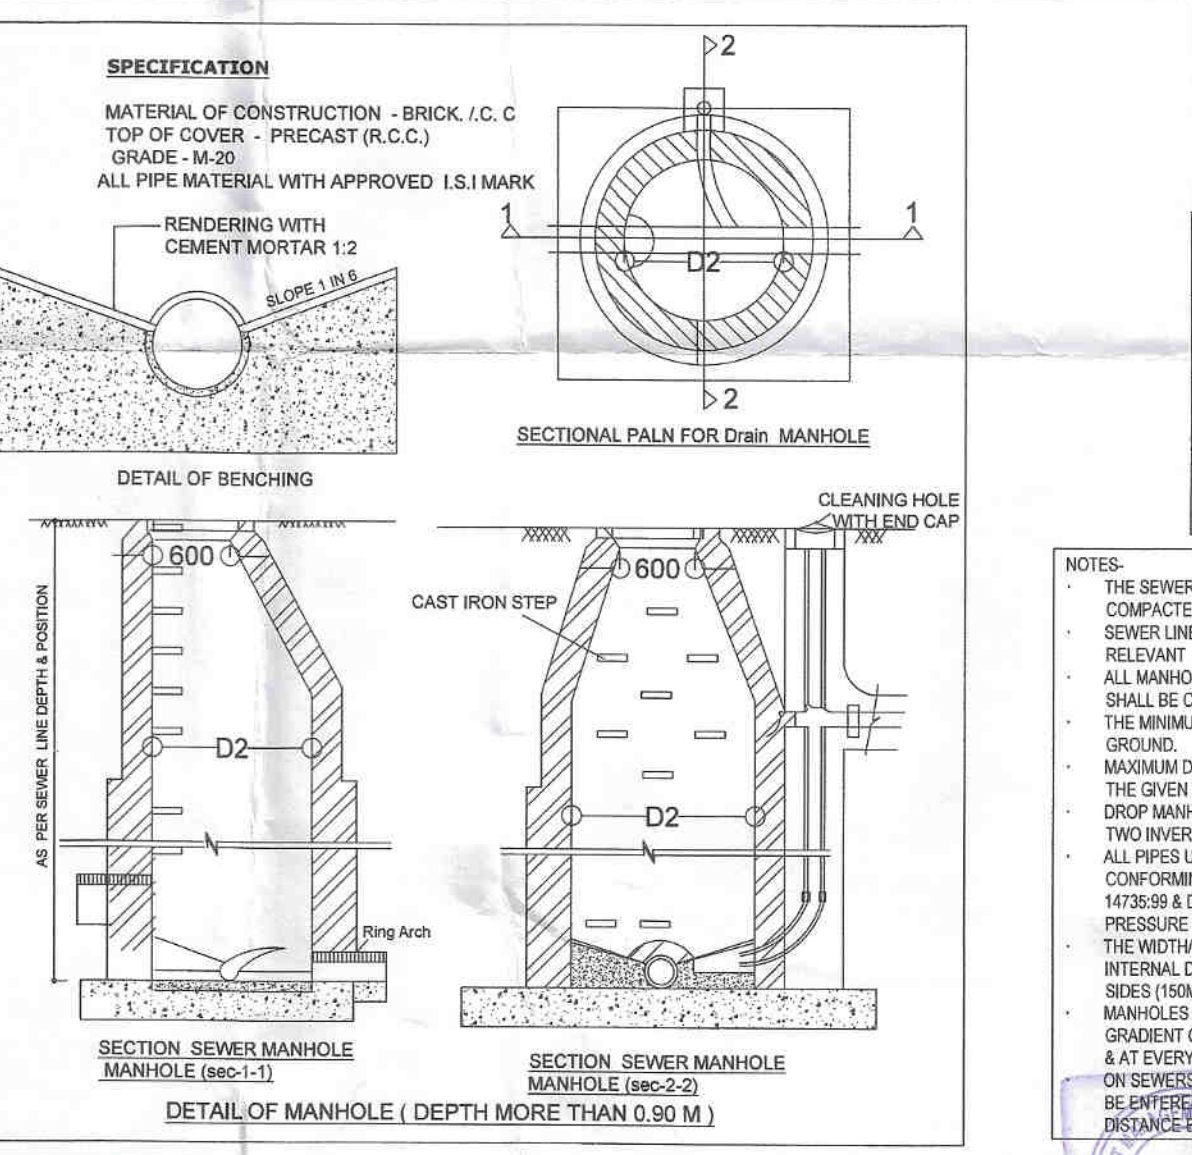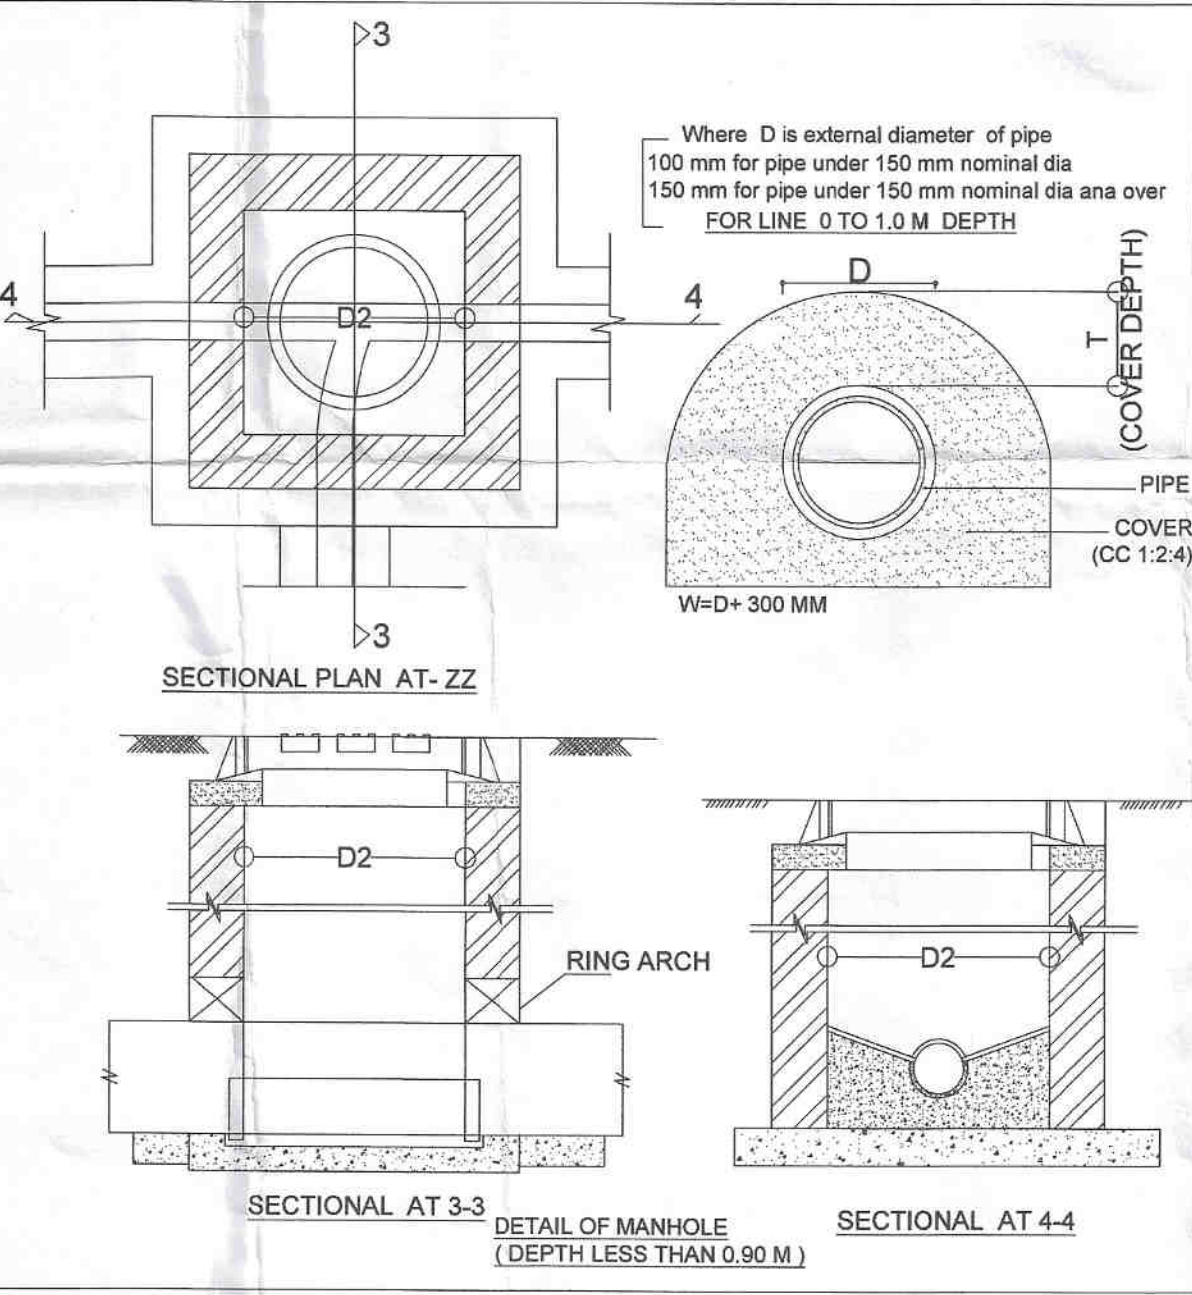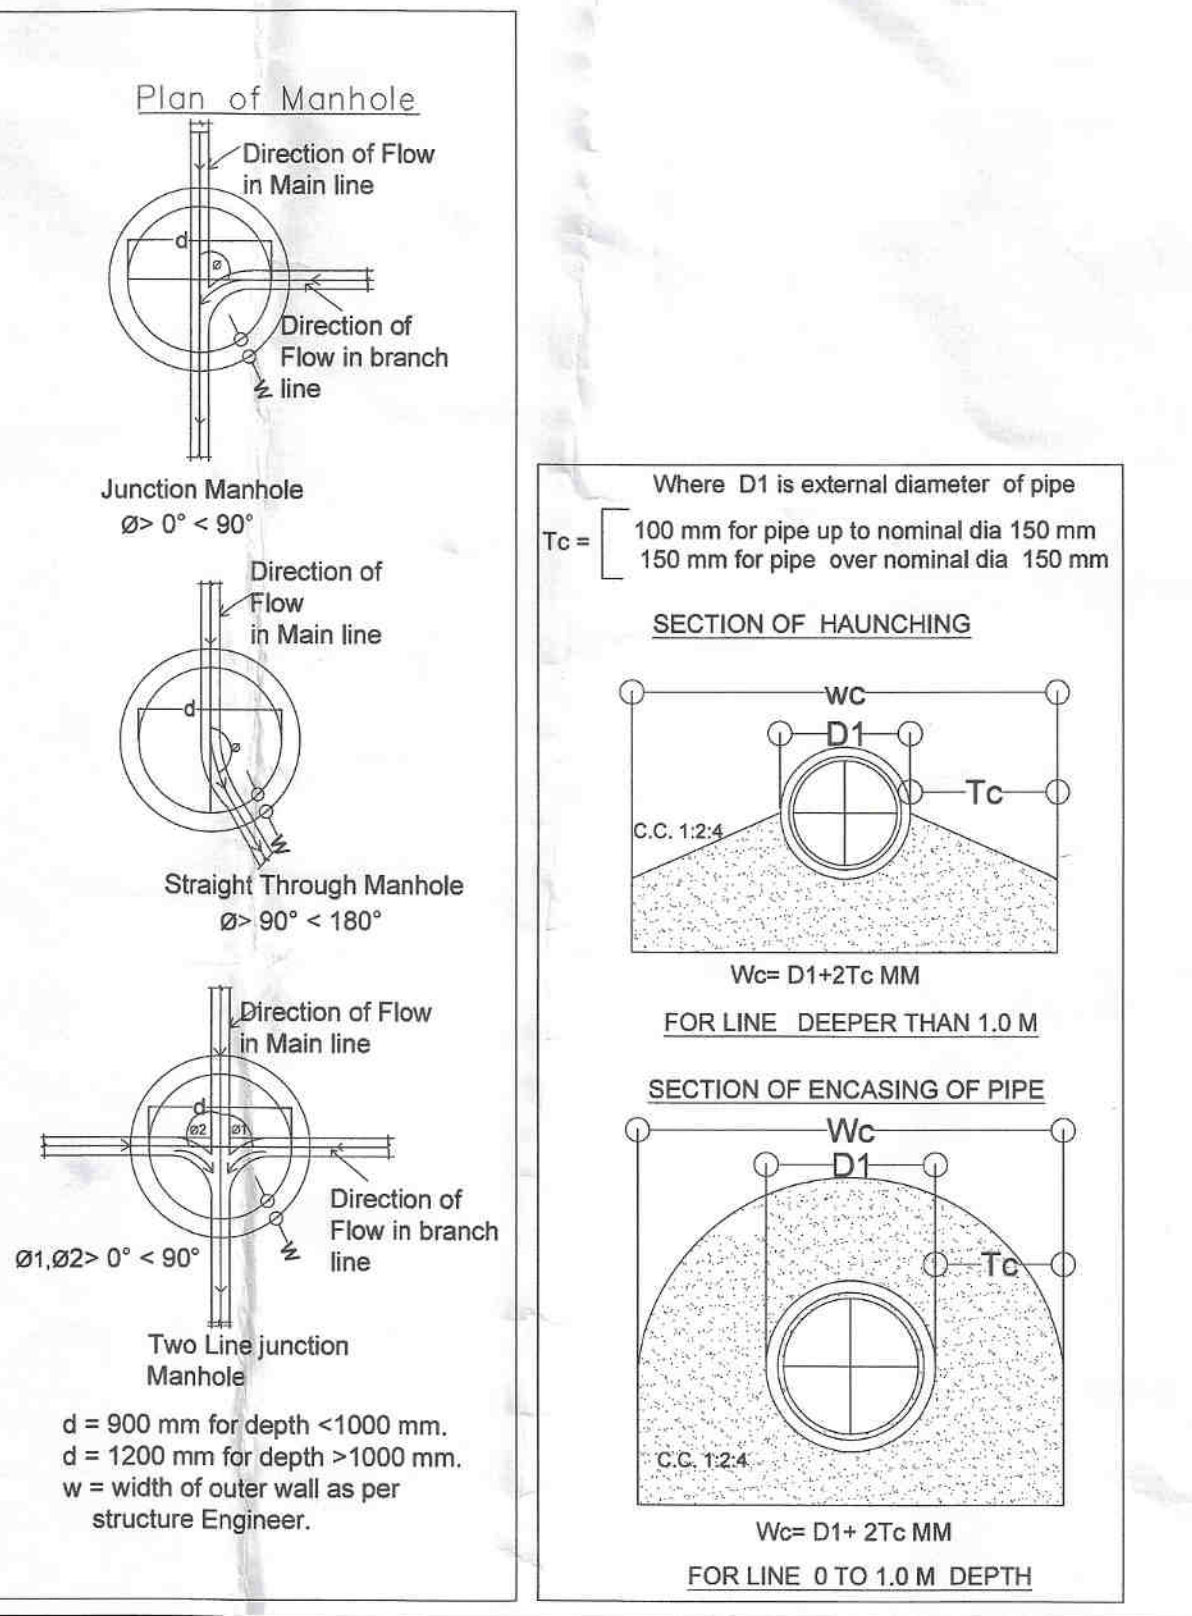

LEGEND

—	Sewer Line (DWC pipe conforming to IS:16098-2, Size As Per DWG.)
□	Mainhole
MH 1	Mainhole No.
SL 1	Starting line No.
→	Flow Direction

Width of Manhole

S. No.	Depth	Width
1.	Upto 900 mm	600 x 600 mm
2.	0.9 And Upto 2.5 m	900 mm

NOTES:-

- THE SEWER LINE SHALL BE LAID ON P.C.C. (150TH) OVER COMPACTED EARTH.
- SEWER LINE SHALL BE TESTED FOR ITS LEAKAGE/INFILTRATION AS RELEVANT IS CODEMANUAL BEFORE ITS COMMISSIONING.
- ALL MANHOLES SHOULD HAVE UNICUT PIPE INSIDE AT BASE WHICH SHALL BE CUT DURING COMMISSIONING.
- THE MINIMUM INVERT LEVEL SHALL BE 500 MM BELOW EXISTING GROUND.
- MAXIMUM DISTANCE BETWEEN TWO MANHOLES SHALL BE AS PER THE GIVEN TABLE OR AS PER DESIGN.
- DROP MANHOLE SHALL BE PROVIDED WHERE THE DIFFERENCE OF TWO INVERT LEVEL AT A JOINT IS MORE THAN 600 MM.
- ALL PIPES USED UPTO DIAMETER 150MM SHOULD BE SWR CONFORMING TO IS:15092 & FITTINGS SHOULD CONFORM TO IS:14735-99 & DIAMETER MORE THAN 150MM SHOULD BE UPVC PRESSURE PIPES & CONFORM TO IS:4985:2000 CLASS B.
- THE WIDTH DIAMETER OF THE MANHOLE SHOULD NOT BE LESS THAN INTERNAL DIAMETER OF THE SEWER + 150MM BENCHING ON BOTH SIDES (150MM + 150MM).
- MANHOLES SHOULD BE BUILT AT EVERY CHANGE OF ALIGNMENT, GRADIENT OR DIAMETER, AT THE HEAD OF ALL SEWERS & BRANCHES & AT EVERY JUNCTION OF TWO OR MORE SEWERS.
- ON SEWERS WHICH ARE TO BE CLEANED MANUALLY, WHICH CANNOT BE ENTERED FOR CLEANING OR INSPECTION, THE MAXIMUM DISTANCE BETWEEN MANHOLES CAN BE AT 30M MAXIMUM.