


NOTES :

- This drg. is the property of KGN Architects and is not to be used or reproduced without permission.
- Contractors must verify dimensions on the job and report any discrepancies if any to this office at earliest.
- Drgs. not to be scaled. Written dimensions to be followed.
- All dimensions in MM only unless specified otherwise.
- Drawings shall be read in conjunction with service / structure related drawings.
- All columns & shear walls adjoining the staircase and ramp shall be casted in conjunction of staircase and ramp drawings issued separately.

EXTERNAL SEWAGE NOTES:-	
S.NO.	DESCRIPTION
1.	ALL DIMENSIONS ARE IN MILLIMETERS UNLESS NOTED OTHERWISE.
2.	WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED.
3.	PLEASE COORDINATE THIS DRAWING WITH ALL OTHER RELEVANT DRAWINGS OF ALL THE SERVICES.
4.	SHOP DRAWINGS SHALL BE PREPARED BY THE CONTRACTOR AND SUBMITTED IN CASE OF ANY CHANGES IN LAYOUT AS PER SITE CONDITIONS.
5.	ALL LINES SHOWING IN LAYOUT ARE CENTER LINES.
6.	FOR LOCATION OF MANHOLE PLEASE REFER SETTING OUT PLAN ISSUED BY LANDSCAPE CONSULTANT.
7.	INVERT LEVEL/LOCATION AND SIZES OF EXTERNAL SEWER SHALL BE CHECKED AT SITE BEFORE EXECUTION IF EXISTING SEWER HIGHER THAN THE PURPOSE INVERT LEVEL. PLEASE CONSULT PROJECT ARCHITECT/CONSULTANTS.
8.	ALL EXTERNAL SEWER LINE (MANHOLE TO MANHOLE CONNECTION) SHALL BE LAID IN DOUBLE WALL CORRUGATED PVC PIPE OF CLASS SN-8.
9.	ALL SEWER LINE SHALL BE LAID ON PCC BED.
10.	ALL BURIED PIPES SHALL BE SET FOR LEAKAGES AND STRAIGHTNESS AS PER SPECIFICATION.
11.	TRENCH SHALL BE REFILLED ONLY AFTER PIPE TESTING.
12.	THE DEPTH OF MANHOLE SHOULD BE MEASURED FROM F.G.L - F.G.L.

SEWERAGE LEGEND :		
S.No.	SYMBOL	DESCRIPTION
1.	●	SEWERAGE MANHOLE
2.	—	PROPOSED SEWERAGE LINE
3.	→	FLOW DIRECTION
4.	■	SEWERAGE MANHOLE (600x600)

SCHEDULE OF SEWERAGE MANHOLE:-			
S.No.	DESCRIPTION	DEPTH	TYPE
1.	910mm DIA	0.600m TO 1.600m	A
2.	1220mm DIA	1.600m TO 2.300m	B
3.	1520mm DIA	2.300m TO 9.000m	C

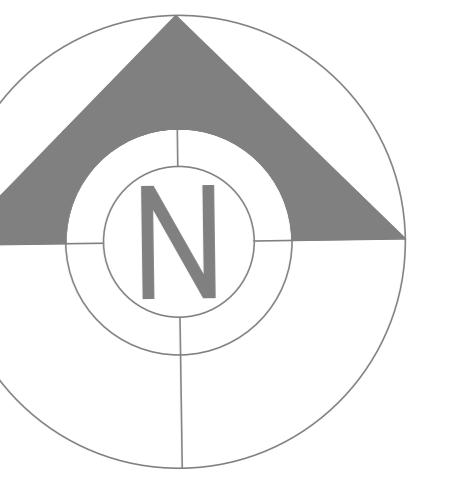

REV. NO. DATE. REMARKS

MEP CONSULTANT

PKV Consulting Engineers (P) Ltd.
 C-815, DDA Flats, Loni Road, Delhi -110093
 TELEFAX - 011-22816297
 E-mail:- pramod@pkv.co.in
info@pkv.co.in

PROJECT:-

INDRAPRASTHA ELITE ESTATES
 AT KHASRA NO.98,99,101M,VILLAGE NARAYAN NAGAR URF
 RAMPUR, LONI, GHAZIABAD, UTTAR PRADESH.

CLIENT:-

M/S ACCURATE MARK SERVE PVT.LTD

ARCHITECTS :-

KGN
ARCHITECTS
 PLOT NO 1, 2ND FLOOR JT TRACTOR AGENCY,
 PREM ENCLAVE, KRISHNA NAGAR,
 DELHI-MEERUT ROAD, GHAZIABAD

DRAWING NAME:-
EXTERNAL PLUMBING SEWERAGE LAYOUT PLAN

DRAWN BY:- KARAN SCALE :- 1:450@A1

CHECK BY:- PKS PAPER SIZE :- A1


DATE:- 10-06-2025 DRAWING NO :-



OTHERS PROPERTY

NOTES :

- This drg. is the property of KGN Architects and is not to be used or reproduced without permission.
- Contractors must verify dimensions on the job and report any discrepancies if any to this office at earliest.
- Drgs. not to be scaled. Written dimensions to be followed.
- All dimensions in MM only unless specified otherwise.
- Drawings shall be read in conjunction with service / structure related drawings .
- All the columns & shear walls adjoining the staircase and ramp shall be casted in conjunction of staircase and ramp drawings issued separately.

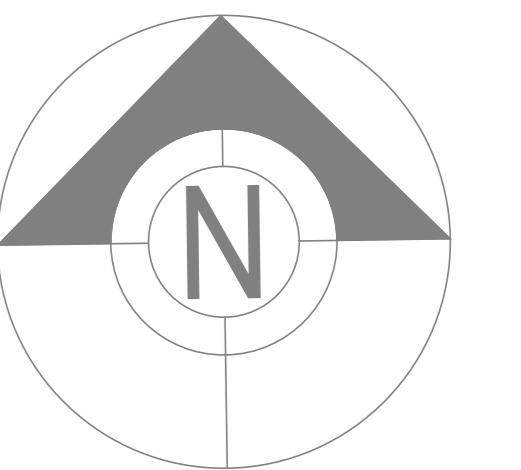

REV. NO. DATE. REMARKS

MEP CONSULTANT

PKV Consulting Engineers (P) Ltd.
 C-815, DDA Flats, Loni Road, Delhi -110093
 TELEFAX - 011-22816297
 E-mail:- pramod@pkv.co.in
 info@pkv.co.in

PROJECT:-

INDRAPRASTHA ELITE ESTATES
 AT KHASRA NO.98,99,101M,VILLAGE NARAYAN NAGAR URF
 RAMPUR, LONI, GHAZIABAD, UTTAR PRADESH.

CLIENT:-

M/S ACCURATE MARK SERVE PVT.LTD

ARCHITECTS :-

**KGN
ARCHITECTS**
 PLOT NO. 1, 2ND FLOOR JT TRACTOR AGENCY,
 PREM ENCLAVE, KRISHNA NAGAR,
 DELHI-MEERUT ROAD, GHAZIABAD

DRAWING NAME:-
EXTERNAL PLUMBING DRAINAGE LAYOUT PLANDRAWN BY:-
KARANSCALE :-
1:450@A1CHECK BY:-
PKSPAPER SIZE :-
A1DATE:-
10-06-2025

DRAWING NO :-

EXTERNAL PLUMBING DRAINAGE NOTES:-	
S.NO.	DESCRIPTION
1.	ALL DIMENSIONS ARE IN MILLIMETERS UNLESS NOTED OTHERWISE
2.	WRITTEN DIMENSIONS ARE TO BE FOLLOWED. DRAWINGS ARE NOT TO BE SCALED
3.	PLEASE CO-ORDINATE THIS DRAWING WITH ALL OTHER RELEVANT DRAWINGS OF ALL THE SERVICES.
4.	SHOP DRAWINGS SHALL BE PREPARED BY THE CONTRACTOR AND SUBMITTED IN CASE OF ANY CHANGES IN LAYOUT AS PER SITE CONDITIONS.
5.	ALL LINES SHOWING IN LAYOUT ARE CENTER LINES.
6.	FOR LOCATION OF MANHOLE PLEASE REFER ROAD SECTION & DESIGN CHART.
7.	INVERT LEVEL/LOCATION AND SIZES OF EXTERNAL DRAIN SHALL BE CHECKED AT SITE BEFORE EXECUTION IF EXISTING DRAIN HIGHER THEN THE PURPOSE INVERT LEVEL PLEASE CONSULTS PROJECT ARCHITECT/CONSULTANTS.
8.	ALL DRAIN LINE SHALL BE LAID ON P.C.BED.
9.	ALL BURIED PIPES SHALL BE TESTED FOR LEAKAGES AND STRAIGHTNESS AS PER SPECIFICATION.
10.	TRENCH SHALL BE REFILLED ONLY AFTER PIPE TESTING.
11.	ALL STORM WATER LINE SHALL BE LAID IN S & S RCC (NP2) PIPE CONFORMING TO IS : 458.
12.	THE DEPTH OF MANHOLE SHOULD BE MEASURED FROM F.G.L - F.G.L.

DRAINAGE LEGEND :		
S.No.	SYMBOL	DESCRIPTION
1.		DRAINAGE MANHOLE (SIZE 910mm x 1220mm x 1520mm Dia)
2.		RAIN WATER HARVESTING PIT
3.		DRAINAGE LINE
4.		FLOW DIRECTION
5.		300mm WIDE SAUCER DRAIN
6.		CATCH BASIN 400x300

SCHEDULE OF DRAINAGE MANHOLE:-			
S.No.	DESCRIPTION	DEPTH	TYPE
1.	910mm Dia	0.600m TO 1.600m	A
2.	1220mm Dia	1.600m TO 2.300m	B
3.	1520mm Dia	2.300m TO 9.000m	C

